

**Key**

- Proposed OHL Alignment
- Proposed Steel Lattice Tower
- Limit of Deviation (OHL / Underground Cable)
- Existing 132 kV OHL to be Dismantled (Steel Lattice)
- Existing Access Track to be Upgraded
- New Permanent Access Track (construction type to be determined)
- - - New Temporary Access Track
- New Temporary Spur to Towers
- Limit of Deviation (Access Tracks)
- 250m Study Area

**National importance for carbon-rich soil, deep peat and priority peatland habitat**


- CLASS 1 All vegetation cover is priority peatland habitats. All soils are carbon-rich soils and deep peat
- CLASS 2 The vegetation cover is dominated by priority peatland habitats. All soils are carbon-rich soil and deep peat
- CLASS 3 Dominant vegetation cover is not priority peatland habitat but is associated with wet and acidic type. Occasional peatland habitats can be found. Most soils are carbon-rich soils, with some areas of deep peat
- CLASS 4 Area unlikely to be associated with peatland habitats or wet and acidic type. Area unlikely to include carbon-rich soils
- CLASS 5 Soil information takes precedence over vegetation data. No peatland habitat recorded. May also show bare soil. All soils are carbon-rich soil and deep peat
- Mineral soils - Peatland habitats are not typically found on such soils
- Non-soil (i.e. loch, built up area, rock and scree)

Crown copyright and database right 2022 all rights reserved.  
Ordnance Survey Licence number EL273236.  
The Carbon and Peatland map is based on soil and land cover map data produced by the James Hutton Institute. Used with the permission of The James Hutton Institute. All rights reserved.

Project No: LT91  
Project: Skye Reinforcement Project  
EIA Report

Title: Figure V2-7.3  
Peatland Classification  
Map 15 - Section 4

Drawn by: AA Date: 05/09/2022  
Drawing: 04707.00020.0107.0

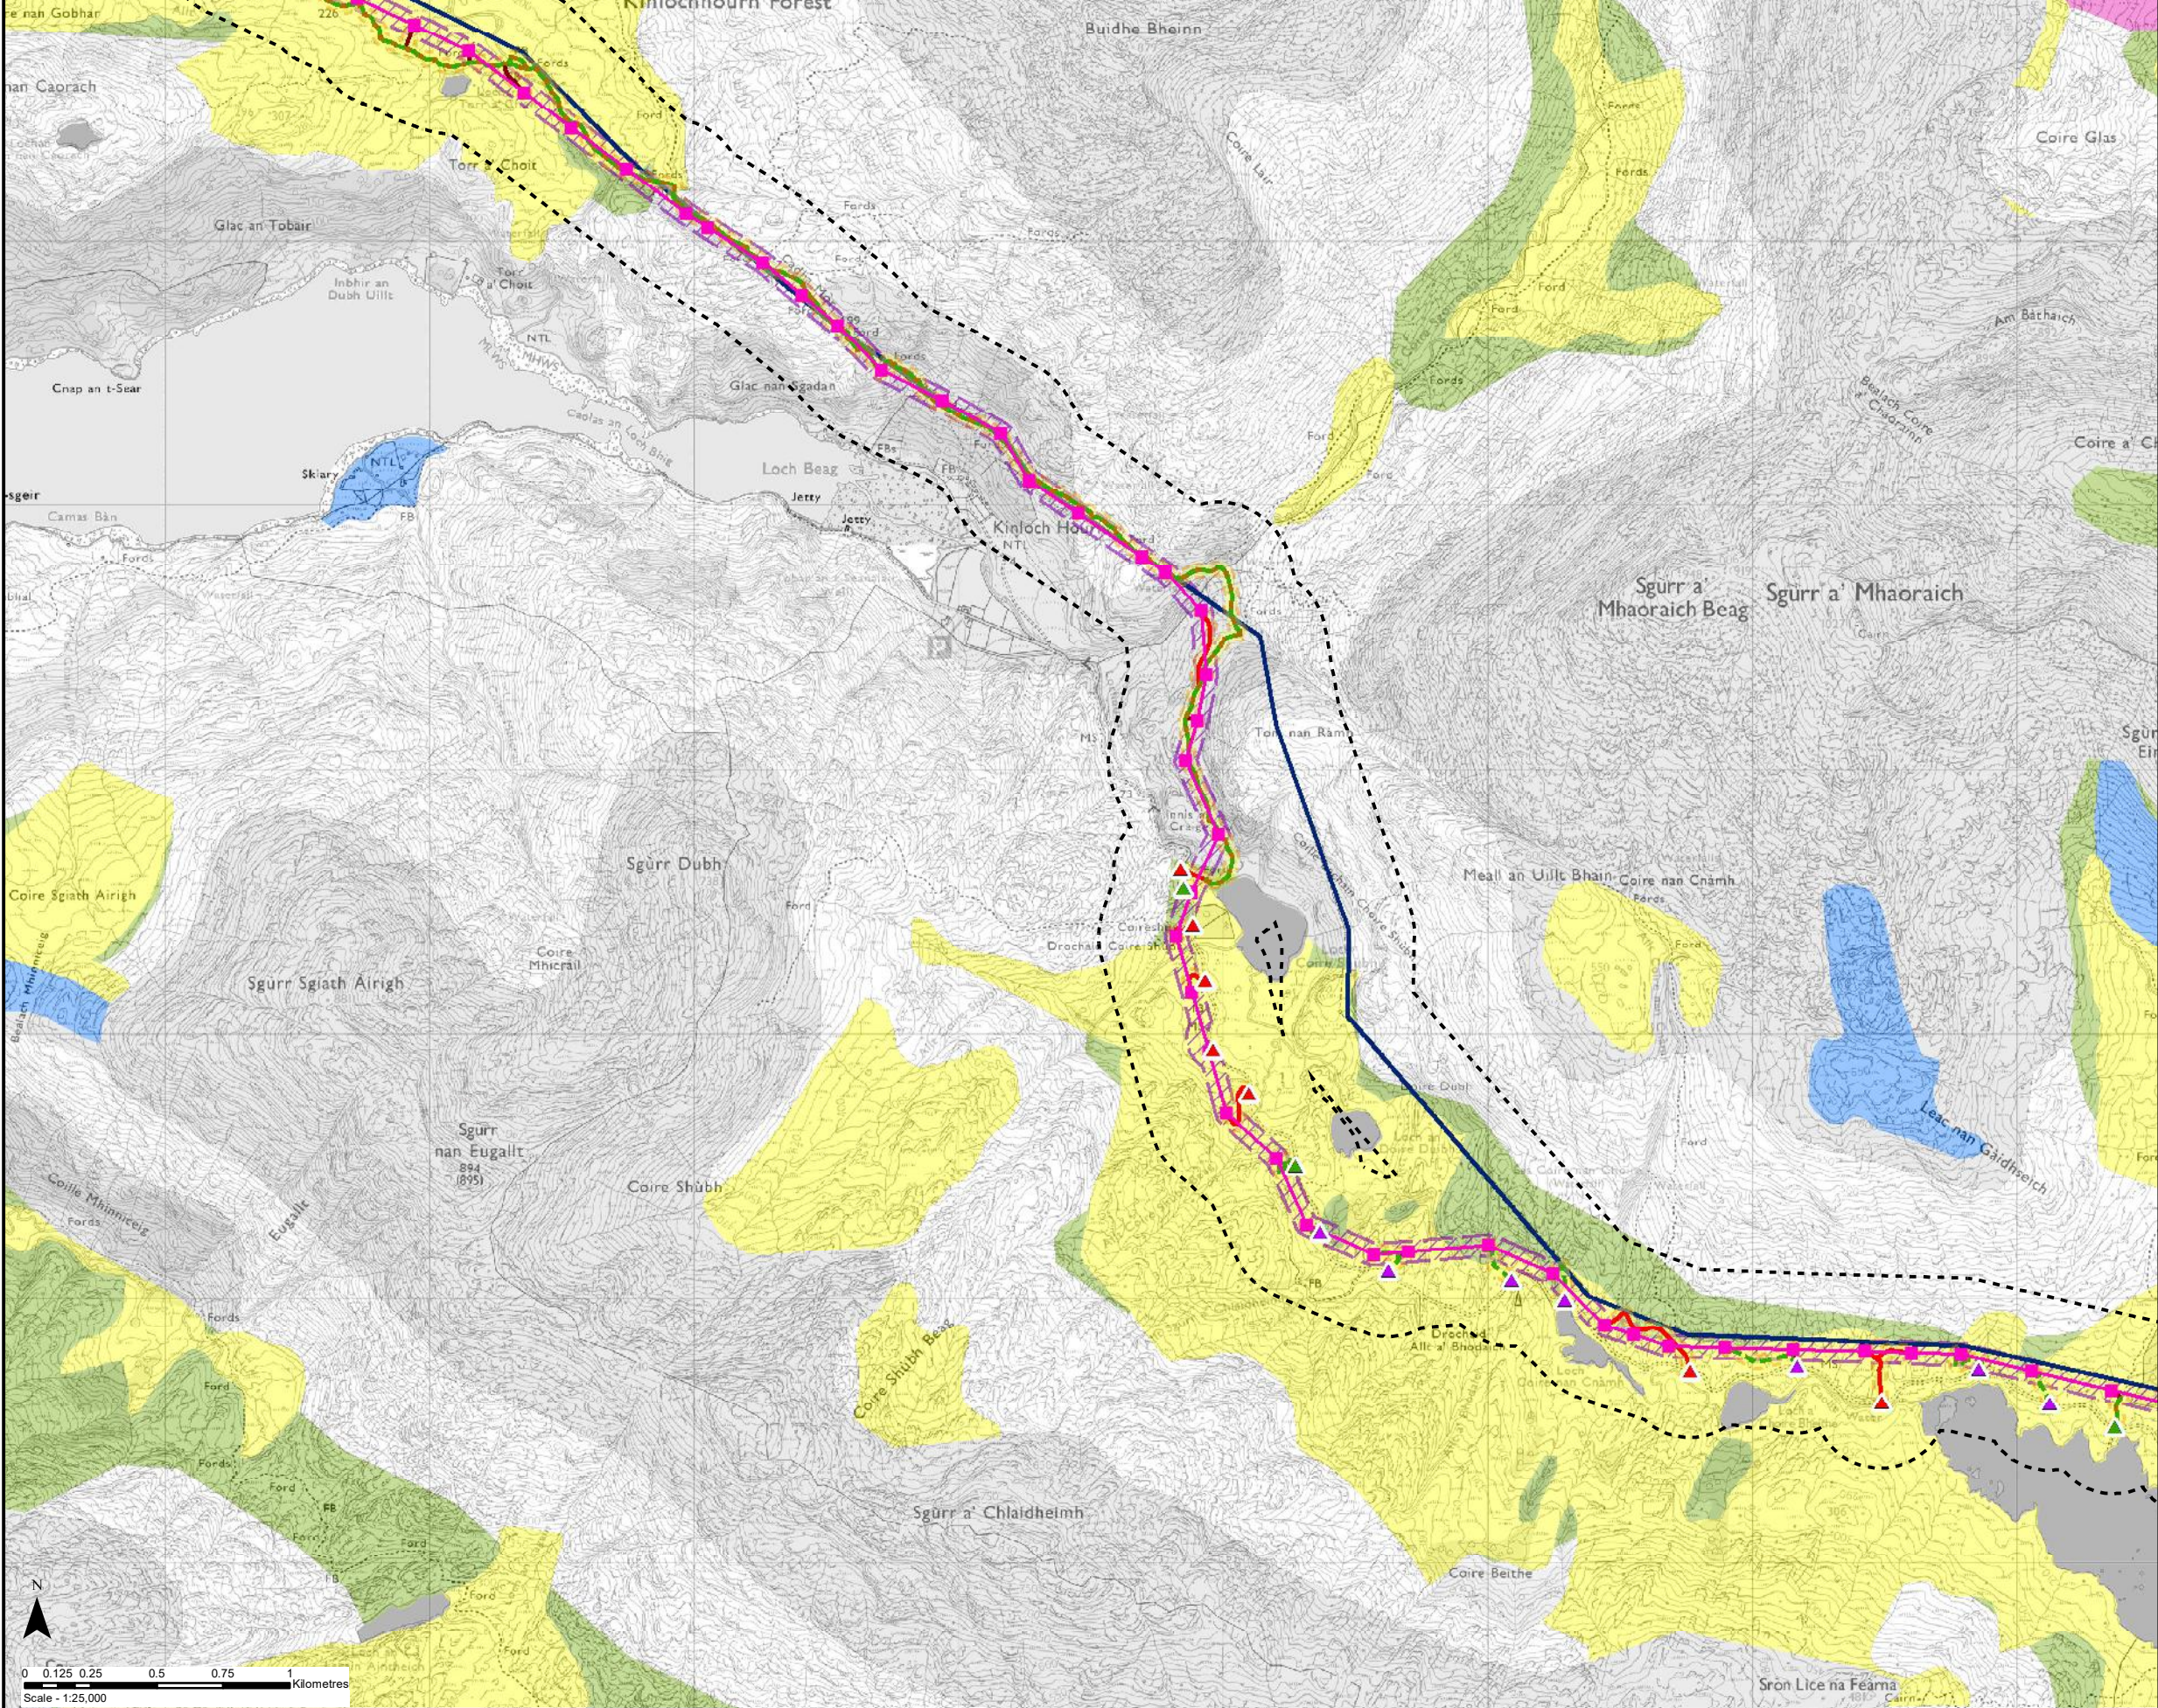

**Key**

- Proposed OHL Alignment
- Proposed Steel Lattice Tower
- Limit of Deviation (OHL / Underground Cable)
- Existing 132 kV OHL to be Dismantled (Steel Lattice)
- Existing Access Track to be Upgraded
- New Permanent Access Track (construction type to be determined)
- New Temporary Access Track
- New Temporary Spur to Towers
- Existing Bellmouth
- New Bellmouth
- Temporary Bellmouth
- Limit of Deviation (Access Tracks)
- 250m Study Area

**National importance for carbon-rich soil, deep peat and priority peatland habitat**

- CLASS 1 All vegetation cover is priority peatland habitats. All soils are carbon-rich soils and deep peat
- CLASS 2 The vegetation cover is dominated by priority peatland habitats. All soils are carbon-rich soil and deep peat
- CLASS 3 Dominant vegetation cover is not priority peatland habitat but is associated with wet and acidic type. Occasional peatland habitats can be found. Most soils are carbon-rich soils, with some areas of deep peat
- CLASS 4 Area unlikely to be associated with peatland habitats or wet and acidic type. Area unlikely to include carbon-rich soils
- CLASS 5 Soil information takes precedence over vegetation data. No peatland habitat recorded. May also show bare soil. All soils are carbon-rich soil and deep peat
- Mineral soils - Peatland habitats are not typically found on such soils
- Non-soil (i.e. loch, built up area, rock and scree)


Crown copyright and database right 2022 all rights reserved.  
Ordnance Survey Licence number EL273236.  
The Carbon and Peatland map is based on soil and land cover map data produced by the James Hutton Institute. Used with the permission of The James Hutton Institute. All rights reserved.


Project No: LT91  
Project: Skye Reinforcement Project  
EIA Report

Title: Figure V2-7.3  
Peatland Classification  
Map 16 - Section 4

Drawn by: AA Date: 05/09/2022

Drawing: 04707.00020.0107.0

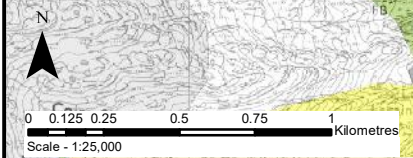

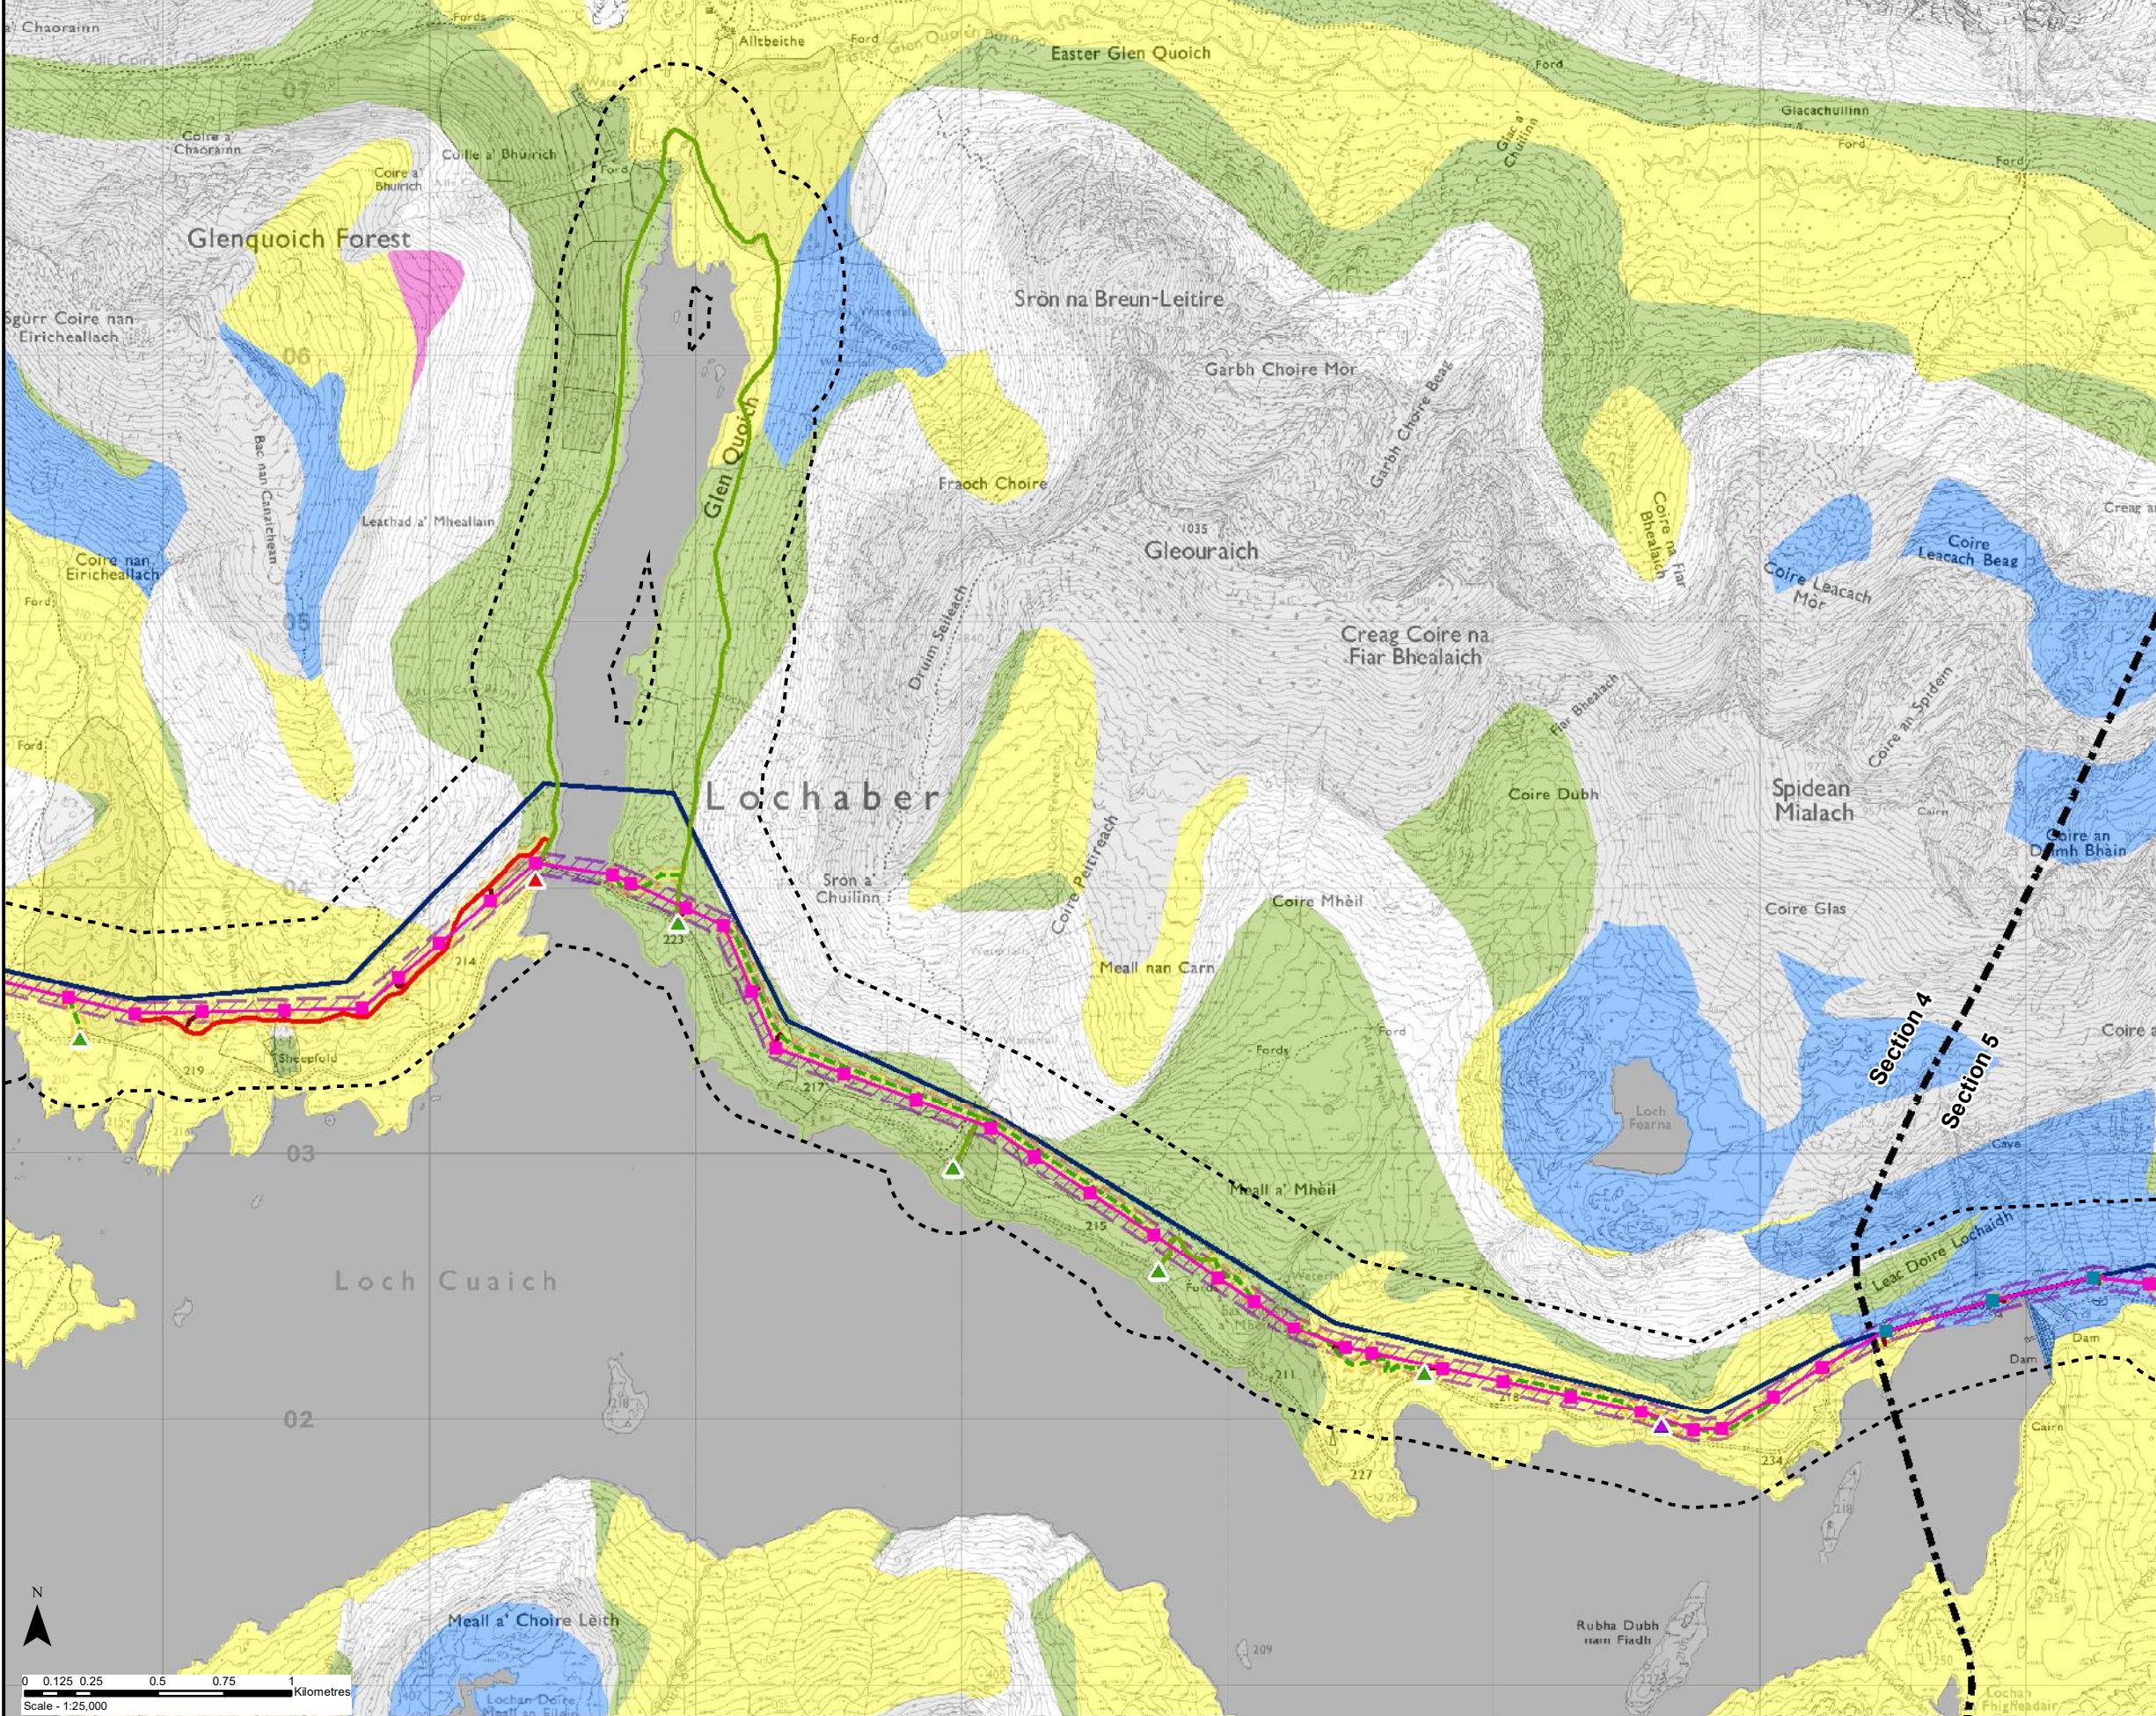

**Key**

- Proposed OHL Alignment
  - Proposed Steel Lattice Tower
  - Existing NeSTS Tower to be Retained
  - Limit of Deviation (OHL / Underground Cable)
  - Existing 132 kV OHL to be Dismantled (Steel Lattice)
  - Existing Access Track
  - New Permanent Access Track (construction type to be determined)
  - - - New Temporary Access Track
  - New Temporary Spur to Towers
  - ▲ Existing Bellmouth
  - ▲ New Bellmouth
  - ▲ Temporary Bellmouth
  - Limit of Deviation (Access Tracks)
  - 250m Study Area
- National importance for carbon-rich soil, deep peat and priority peatland habitat**
- CLASS 1 All vegetation cover is priority peatland habitats. All soils are carbon-rich soils and deep peat
  - CLASS 2 The vegetation cover is dominated by priority peatland habitats. All soils are carbon-rich soil and deep peat
  - CLASS 3 Dominant vegetation cover is not priority peatland habitat but is associated with wet and acidic type. Occasional peatland habitats can be found. Most soils are carbon-rich soils, with some areas of deep peat
  - CLASS 4 Area unlikely to be associated with peatland habitats or wet and acidic type. Area unlikely to include carbon-rich soils
  - CLASS 5 Soil information takes precedence over vegetation data. No peatland habitat recorded. May also show bare soil. All soils are carbon-rich soil and deep peat
  - Mineral soils - Peatland habitats are not typically found on such soils
  - Non-soil (i.e. loch, built up area, rock and scree)


Crown copyright and database right 2022 all rights reserved.  
Ordnance Survey Licence number EL273236.  
The Carbon and Peatland map is based on soil and land cover map data produced by the James Hutton Institute. Used with the permission of The James Hutton Institute. All rights reserved.


Project No: LT91  
Project: Skye Reinforcement Project  
EIA Report

Title: Figure V2-7.3  
Peatland Classification  
Map 17 - Sections 4 & 5

Drawn by: AA Date: 05/09/2022

Drawing: 04707.00020.0107.0

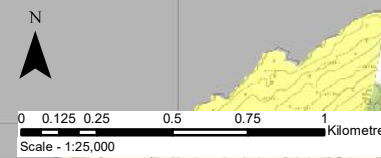

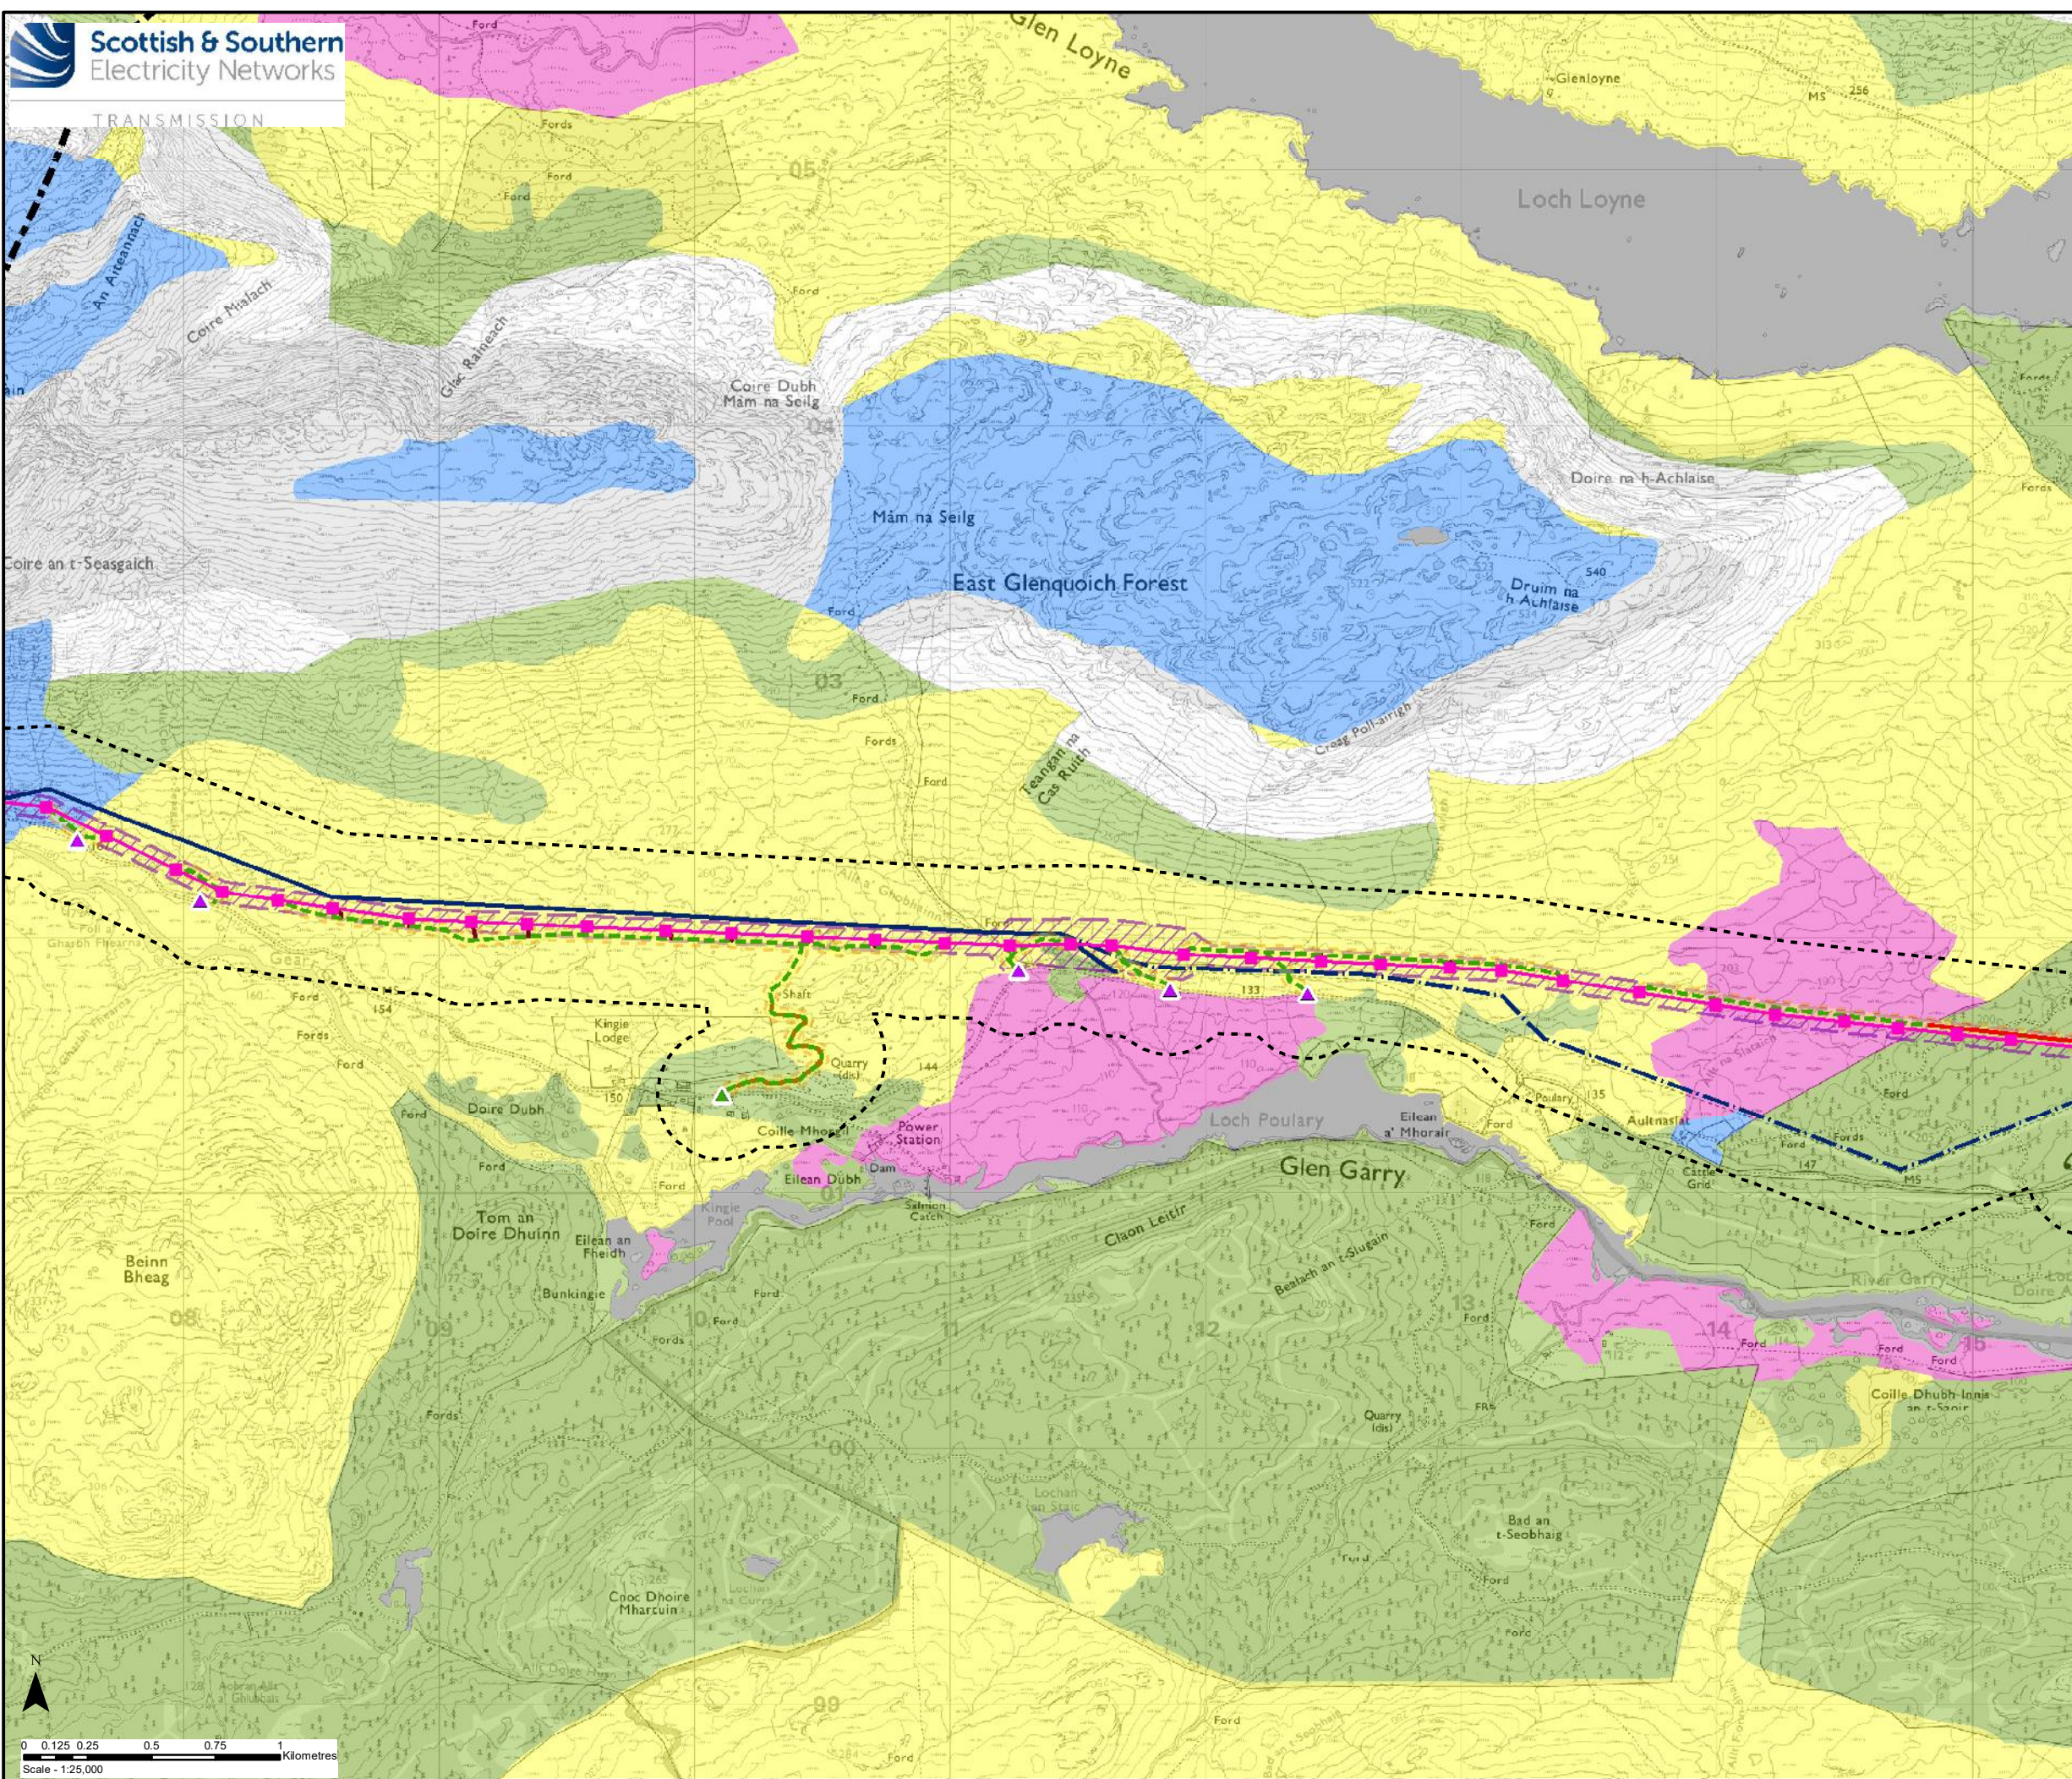

**Key**

- Proposed OHL Alignment
  - Proposed Steel Lattice Tower
  - Limit of Deviation (OHL / Underground Cable)
  - Existing 132 kV OHL to be Dismantled (Steel Lattice)
  - - - Existing 132 kV OHL to be Dismantled (Wood Pole)
  - Existing Access Track to be Upgraded
  - New Permanent Access Track (construction type to be determined)
  - - - New Temporary Access Track
  - New Temporary Spur to Towers
  - ▲ Existing Bellmouth
  - ▲ Temporary Bellmouth
  - Limit of Deviation (Access Tracks)
  - 250m Study Area
- National importance for carbon-rich soil, deep peat and priority peatland habitat**
- CLASS 1 All vegetation cover is priority peatland habitats. All soils are carbon-rich soils and deep peat
  - CLASS 2 The vegetation cover is dominated by priority peatland habitats. All soils are carbon-rich soil and deep peat
  - CLASS 3 Dominant vegetation cover is not priority peatland habitat but is associated with wet and acidic type. Occasional peatland habitats can be found. Most soils are carbon-rich soils, with some areas of deep peat
  - CLASS 4 Area unlikely to be associated with peatland habitats or wet and acidic type. Area unlikely to include carbon-rich soils
  - CLASS 5 Soil information takes precedence over vegetation data. No peatland habitat recorded. May also show bare soil. All soils are carbon-rich soil and deep peat
  - Mineral soils - Peatland habitats are not typically found on such soils
  - Non-soil (i.e. loch, built up area, rock and scree)


Crown copyright and database right 2022 all rights reserved.  
Ordnance Survey Licence number EL273236.  
The Carbon and Peatland map is based on soil and land cover map data produced by the James Hutton Institute. Used with the permission of The James Hutton Institute. All rights reserved.


Project No: LT91  
Project: Skye Reinforcement Project  
EIA Report

Title: Figure V2-7.3  
Peatland Classification  
Map 18 - Section 5

Drawn by: AA Date: 05/09/2022

Drawing: 04707.00020.0107.0

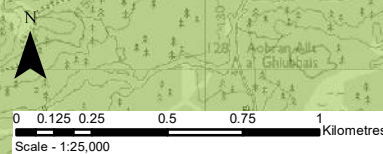

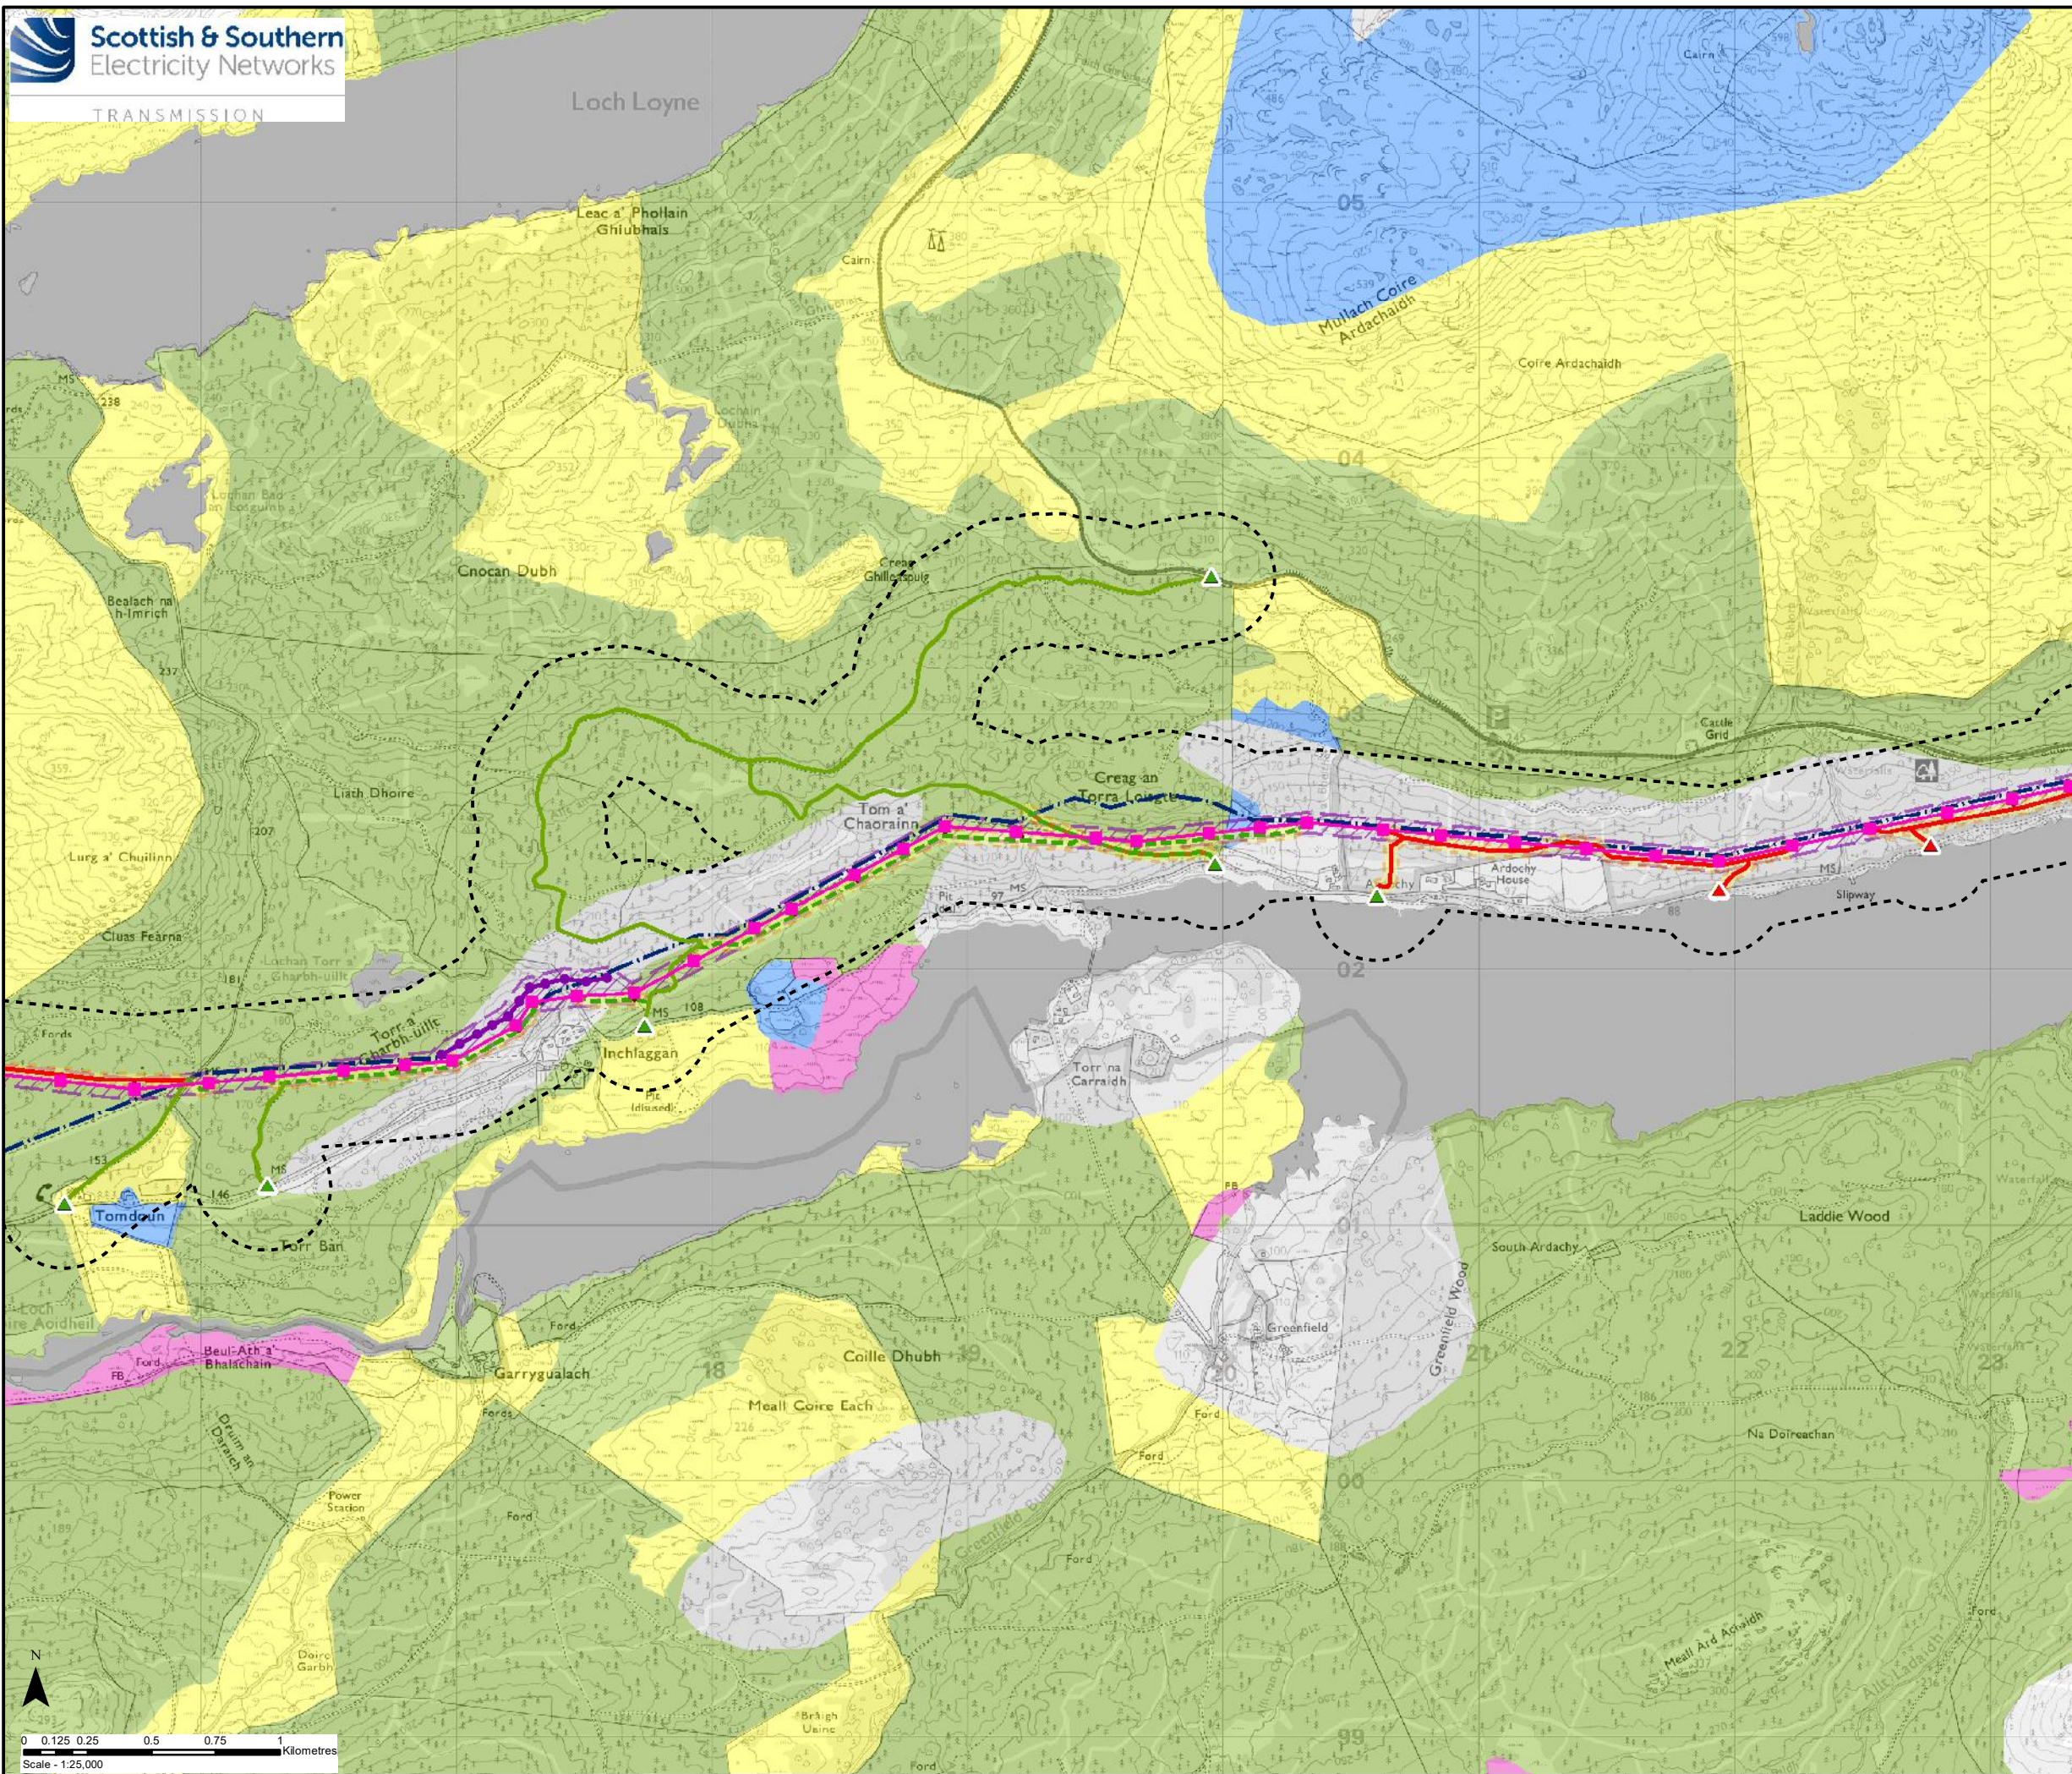


- Key**
- Proposed OHL Alignment
  - Temporary 132kV Diversion
  - Proposed Steel Lattice Tower
  - Temporary 132kV Diversion Poles
  - Limit of Deviation (OHL / Underground Cable)
  - Existing 132 kV OHL to be Dismantled (Wood Pole)
  - Existing Access Track
  - Existing Access Track to be Upgraded
  - New Permanent Access Track (construction type to be determined)
  - New Temporary Access Track
  - New Temporary Spur to Towers
  - ▲ Existing Bellmouth
  - ▲ New Bellmouth
  - Limit of Deviation (Access Tracks)
  - 250m Study Area

**National importance for carbon-rich soil, deep peat and priority peatland habitat**

- CLASS 1 All vegetation cover is priority peatland habitats. All soils are carbon-rich soils and deep peat
- CLASS 2 The vegetation cover is dominated by priority peatland habitats. All soils are carbon-rich soil and deep peat
- CLASS 3 Dominant vegetation cover is not priority peatland habitat but is associated with wet and acidic type. Occasional peatland habitats can be found. Most soils are carbon-rich soils, with some areas of deep peat
- CLASS 4 Area unlikely to be associated with peatland habitats or wet and acidic type. Area unlikely to include carbon-rich soils
- CLASS 5 Soil information takes precedence over vegetation data. No peatland habitat recorded. May also show bare soil. All soils are carbon-rich soil and deep peat
- Mineral soils - Peatland habitats are not typically found on such soils
- Non-soil (i.e. loch, built up area, rock and scree)

Crown copyright and database right 2022 all rights reserved.  
Ordnance Survey Licence number EL273236.  
The Carbon and Peatland map is based on soil and land cover map data produced by the James Hutton Institute. Used with the permission of The James Hutton Institute. All rights reserved.

Project No:	LT91
Project:	Skye Reinforcement Project EIA Report
Title:	Figure V2-7.3 Peatland Classification Map 19 - Section 5
Drawn by:	AA
Date:	05/09/2022
Drawing:	04707.00020.0107.0

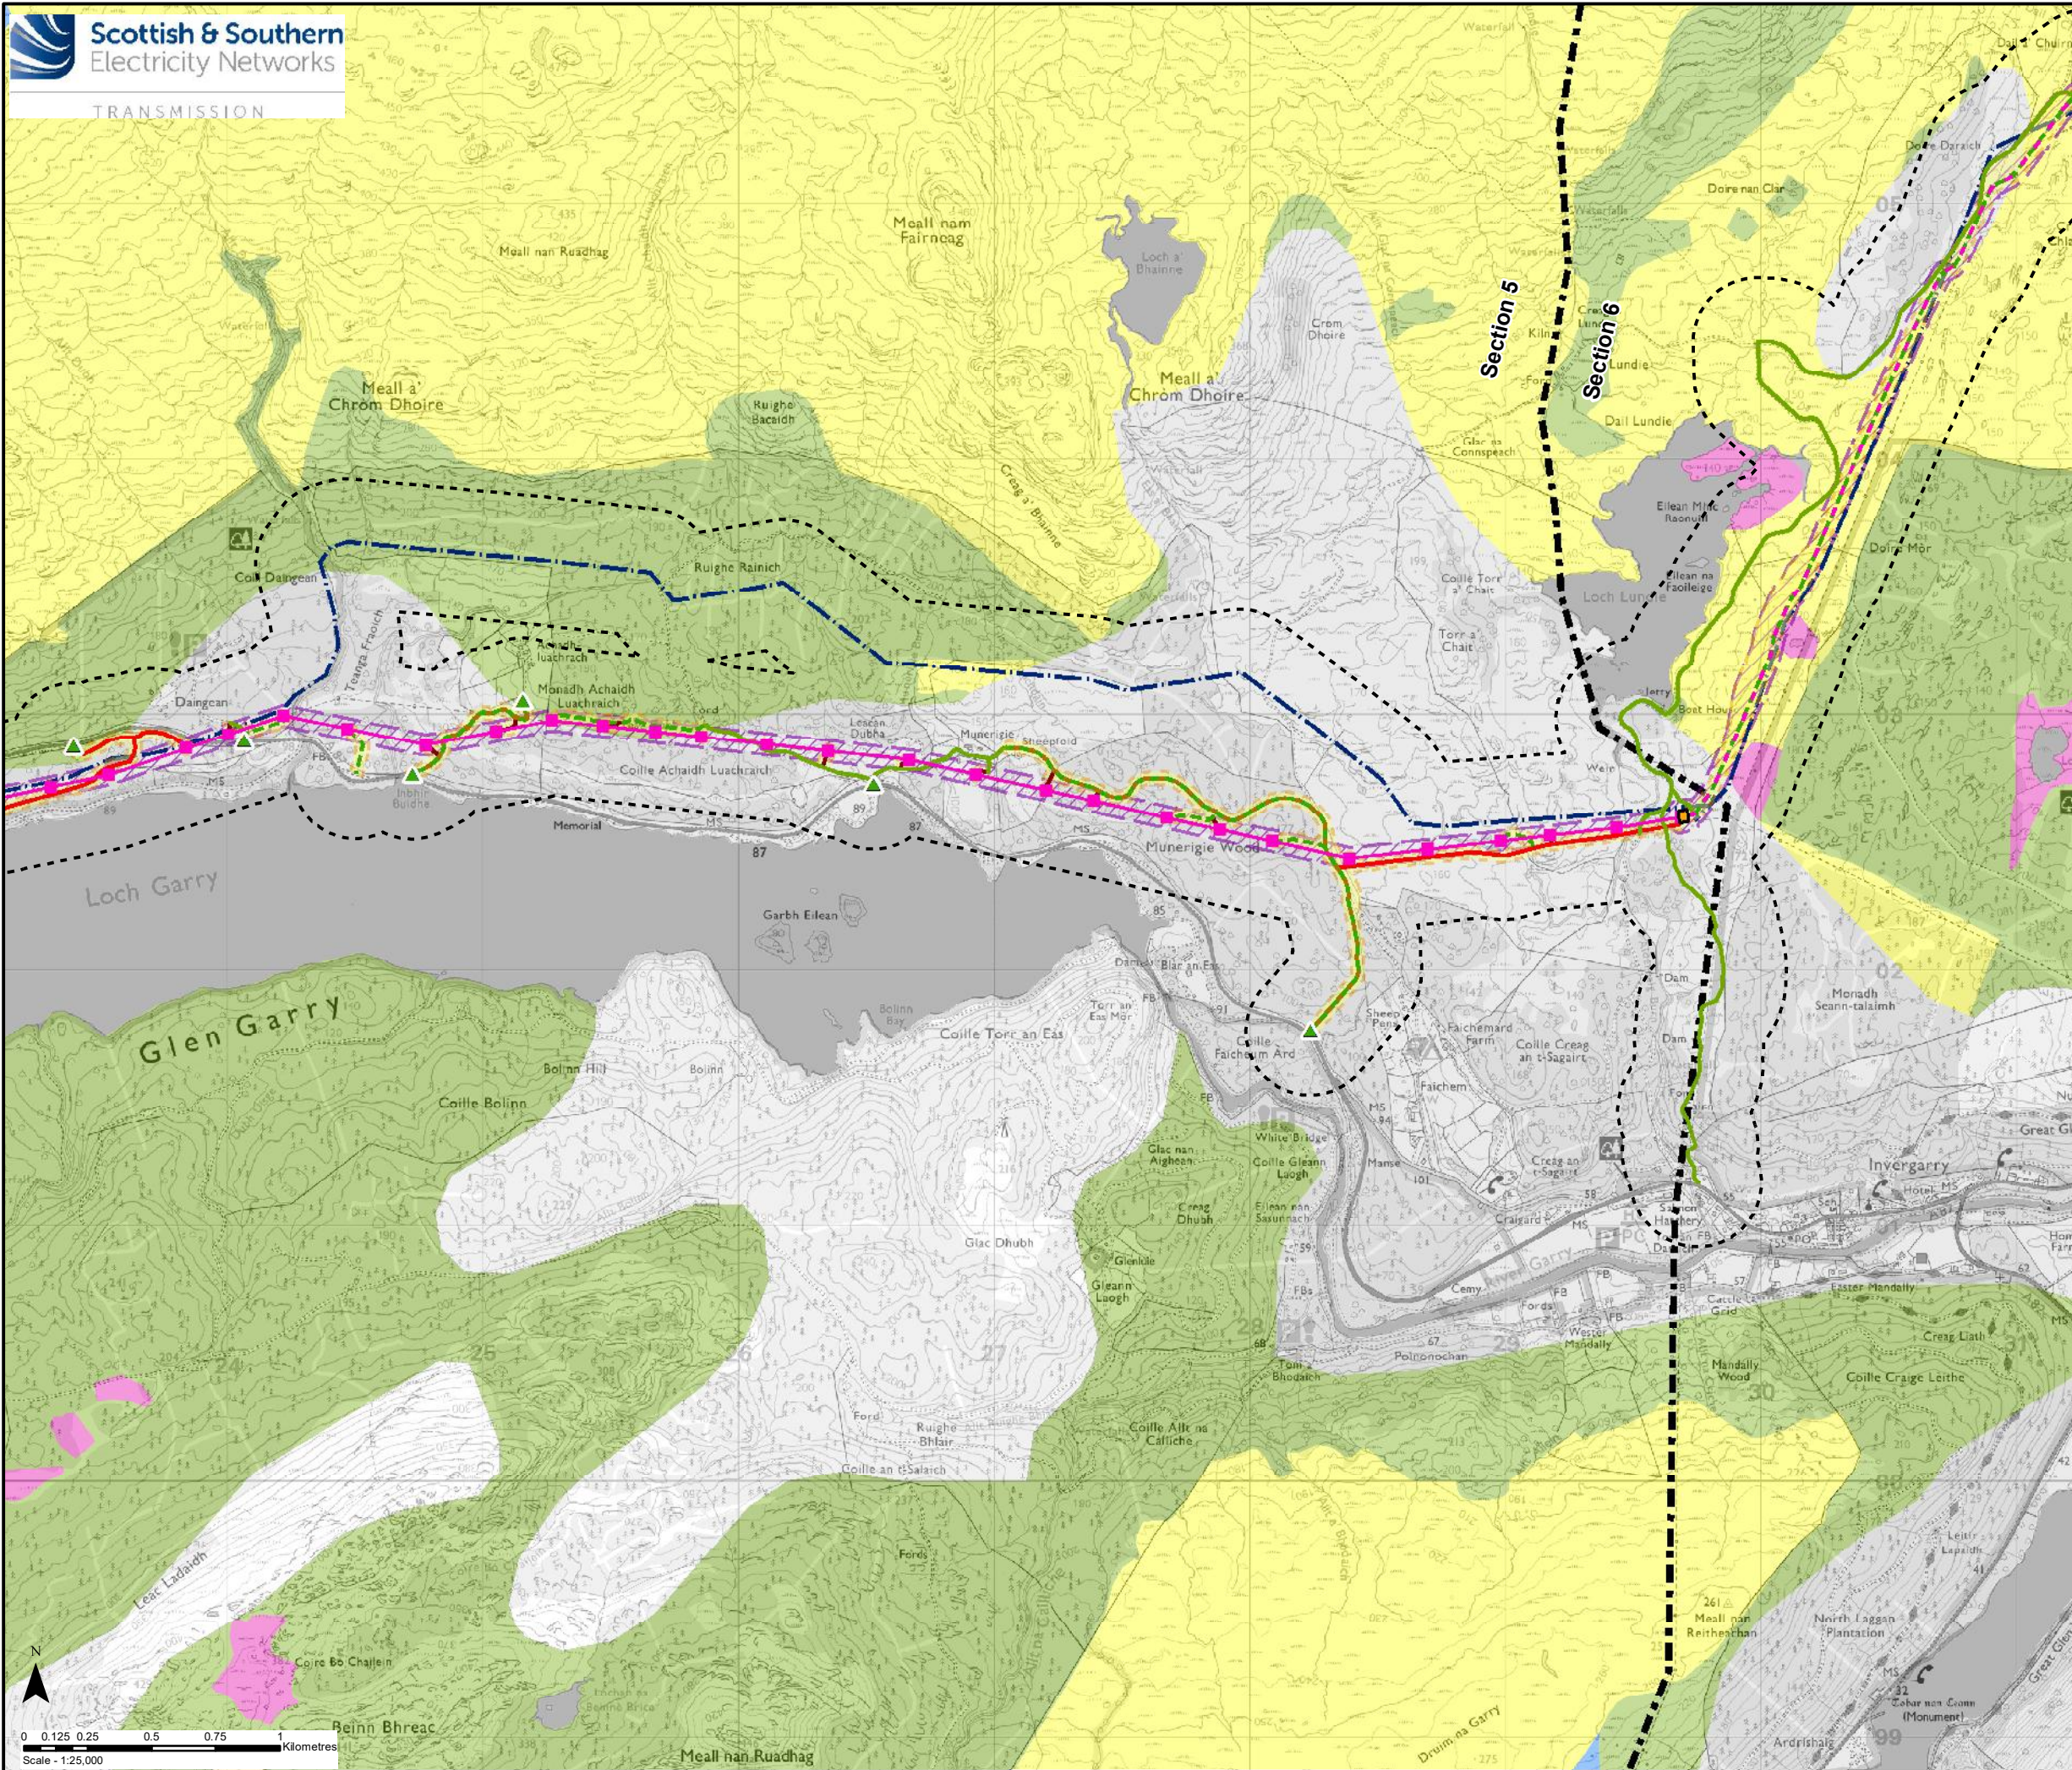

- Key**
- Proposed OHL Alignment
  - - - Proposed Underground Cable
  - Proposed Steel Lattice Tower
  - ★ Horizontal Directional Drill (HDD) Location (Indicative)
  - Limit of Deviation (OHL / Underground Cable)
  - Existing 132 kV OHL to be Dismantled (Wood Pole)
  - Existing Access Track
  - Existing Access Track to be Upgraded
  - New Permanent Access Track (construction type to be determined)
  - - - New Temporary Access Track
  - New Temporary Spur to Towers
  - ▲ Existing Bellmouth
  - Limit of Deviation (Access Tracks)
  - Sealing End Compound
  - 250m Study Area

**National importance for carbon-rich soil, deep peat and priority peatland habitat**

CLASS 1 All vegetation cover is priority peatland habitats. All soils are carbon-rich soils and deep peat

CLASS 2 The vegetation cover is dominated by priority peatland habitats. All soils are carbon-rich soil and deep peat

CLASS 3 Dominant vegetation cover is not priority peatland habitat but is associated with wet and acidic type. Occasional peatland habitats can be found. Most soils are carbon-rich soils, with some areas of deep peat

CLASS 4 Area unlikely to be associated with peatland habitats or wet and acidic type. Area unlikely to include carbon-rich soils

CLASS 5 Soil information takes precedence over vegetation data. No peatland habitat recorded. May also show bare soil. All soils are carbon-rich soil and deep peat

Mineral soils - Peatland habitats are not typically found on such soils

Non-soil (i.e. loch, built up area, rock and scree)


Crown copyright and database right 2022 all rights reserved.  
 Ordnance Survey Licence number EL273236.  
 The Carbon and Peatland map is based on soil and land cover map data produced by the James Hutton Institute. Used with the permission of The James Hutton Institute. All rights reserved.


Project No: LT91  
 Project: Skye Reinforcement Project  
 EIA Report

Title: Figure V2-7.3  
 Peatland Classification  
 Map 20 - Sections 5 & 6

Drawn by: AA      Date: 05/09/2022

Drawing: 04707.00020.0107.0



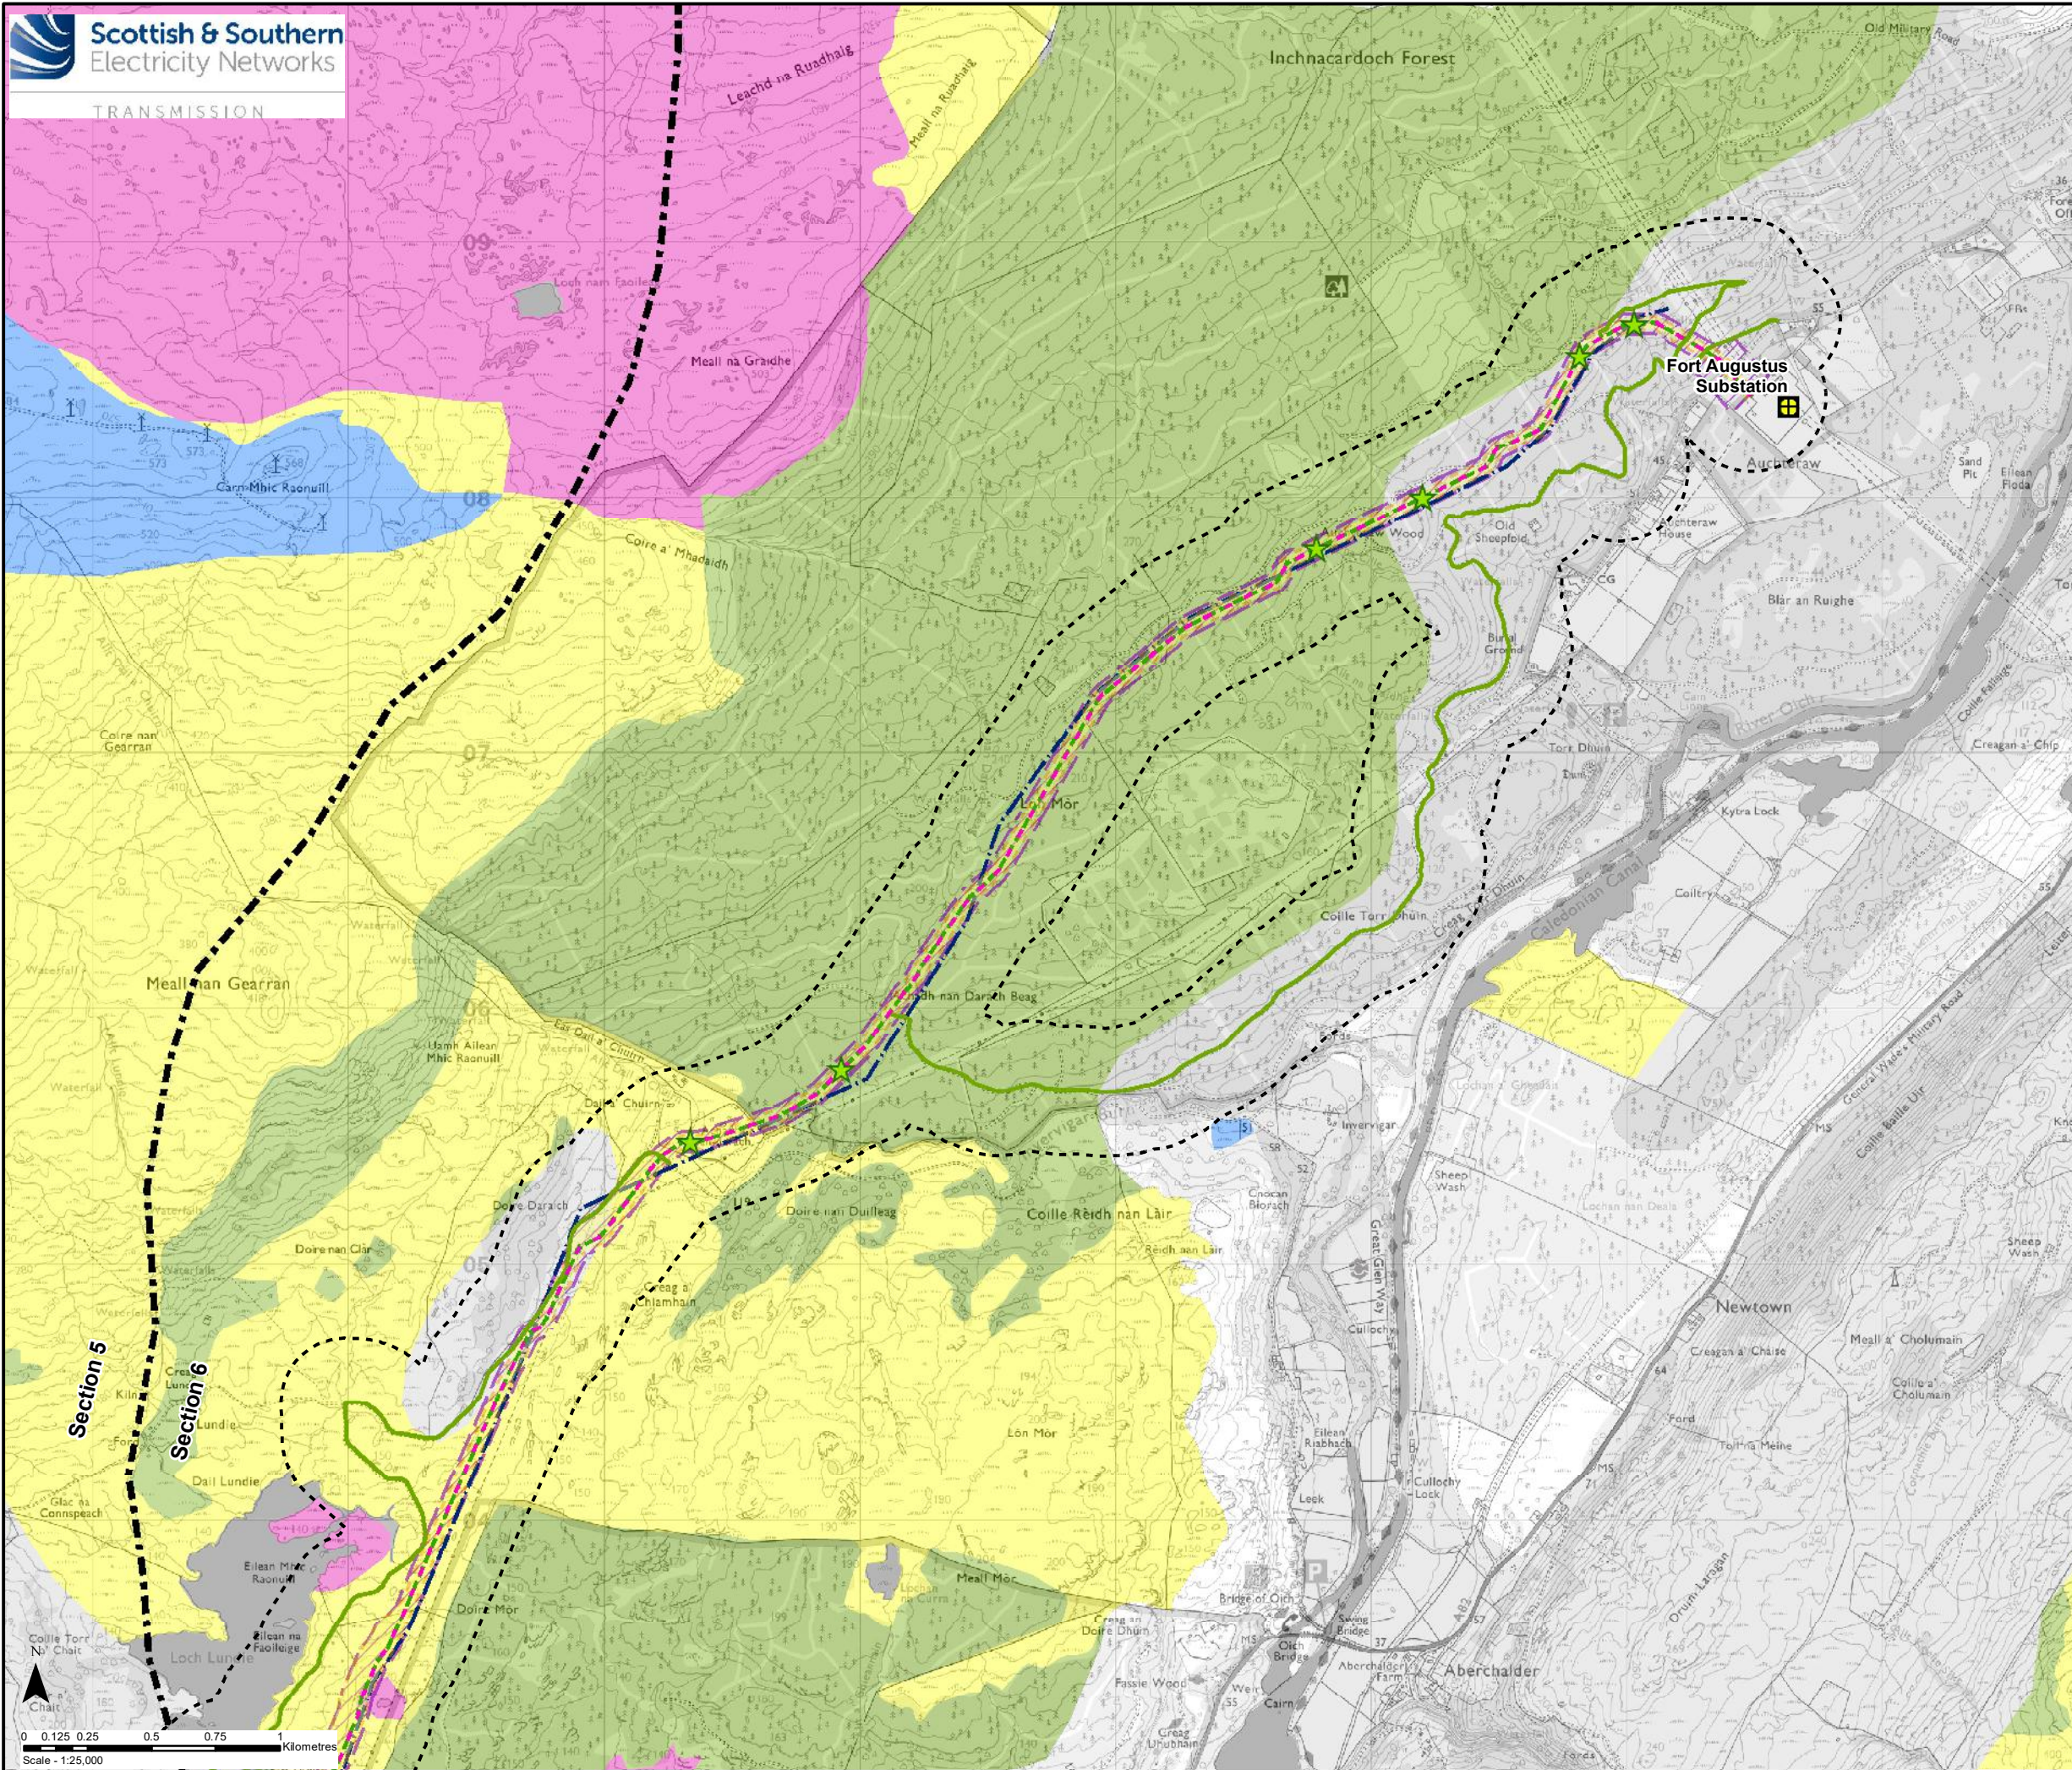

**Key**

- Proposed OHL Alignment
- - - Proposed Underground Cable
- ★ Horizontal Directional Drill (HDD) Location (Indicative)
- Limit of Deviation (OHL / Underground Cable)
- Existing 132 kV OHL to be Dismantled (Wood Pole)
- Existing Access Track
- New Temporary Access Track
- Limit of Deviation (Access Tracks)
- + Existing Substation
- 250m Study Area

**National importance for carbon-rich soil, deep peat and priority peatland habitat**

- CLASS 1 All vegetation cover is priority peatland habitats. All soils are carbon-rich soils and deep peat
- CLASS 2 The vegetation cover is dominated by priority peatland habitats. All soils are carbon-rich soil and deep peat
- CLASS 3 Dominant vegetation cover is not priority peatland habitat but is associated with wet and acidic type. Occasional peatland habitats can be found. Most soils are carbon-rich soils, with some areas of deep peat
- CLASS 4 Area unlikely to be associated with peatland habitats or wet and acidic type. Area unlikely to include carbon-rich soils
- CLASS 5 Soil information takes precedence over vegetation data. No peatland habitat recorded. May also show bare soil. All soils are carbon-rich soil and deep peat
- Mineral soils - Peatland habitats are not typically found on such soils
- Non-soil (i.e. loch, built up area, rock and scree)

Crown copyright and database right 2022 all rights reserved.  
Ordnance Survey Licence number EL273236.  
The Carbon and Peatland map is based on soil and land cover map data produced by the James Hutton Institute. Used with the permission of The James Hutton Institute. All rights reserved.

Project No: LT91  
Project: Skye Reinforcement Project  
EIA Report

Title: Figure V2-7.3  
Peatland Classification  
Map 21 - Section 6

Drawn by: AA Date: 05/09/2022

Drawing: 04707.00020.0107.0