


TRANSMISSION

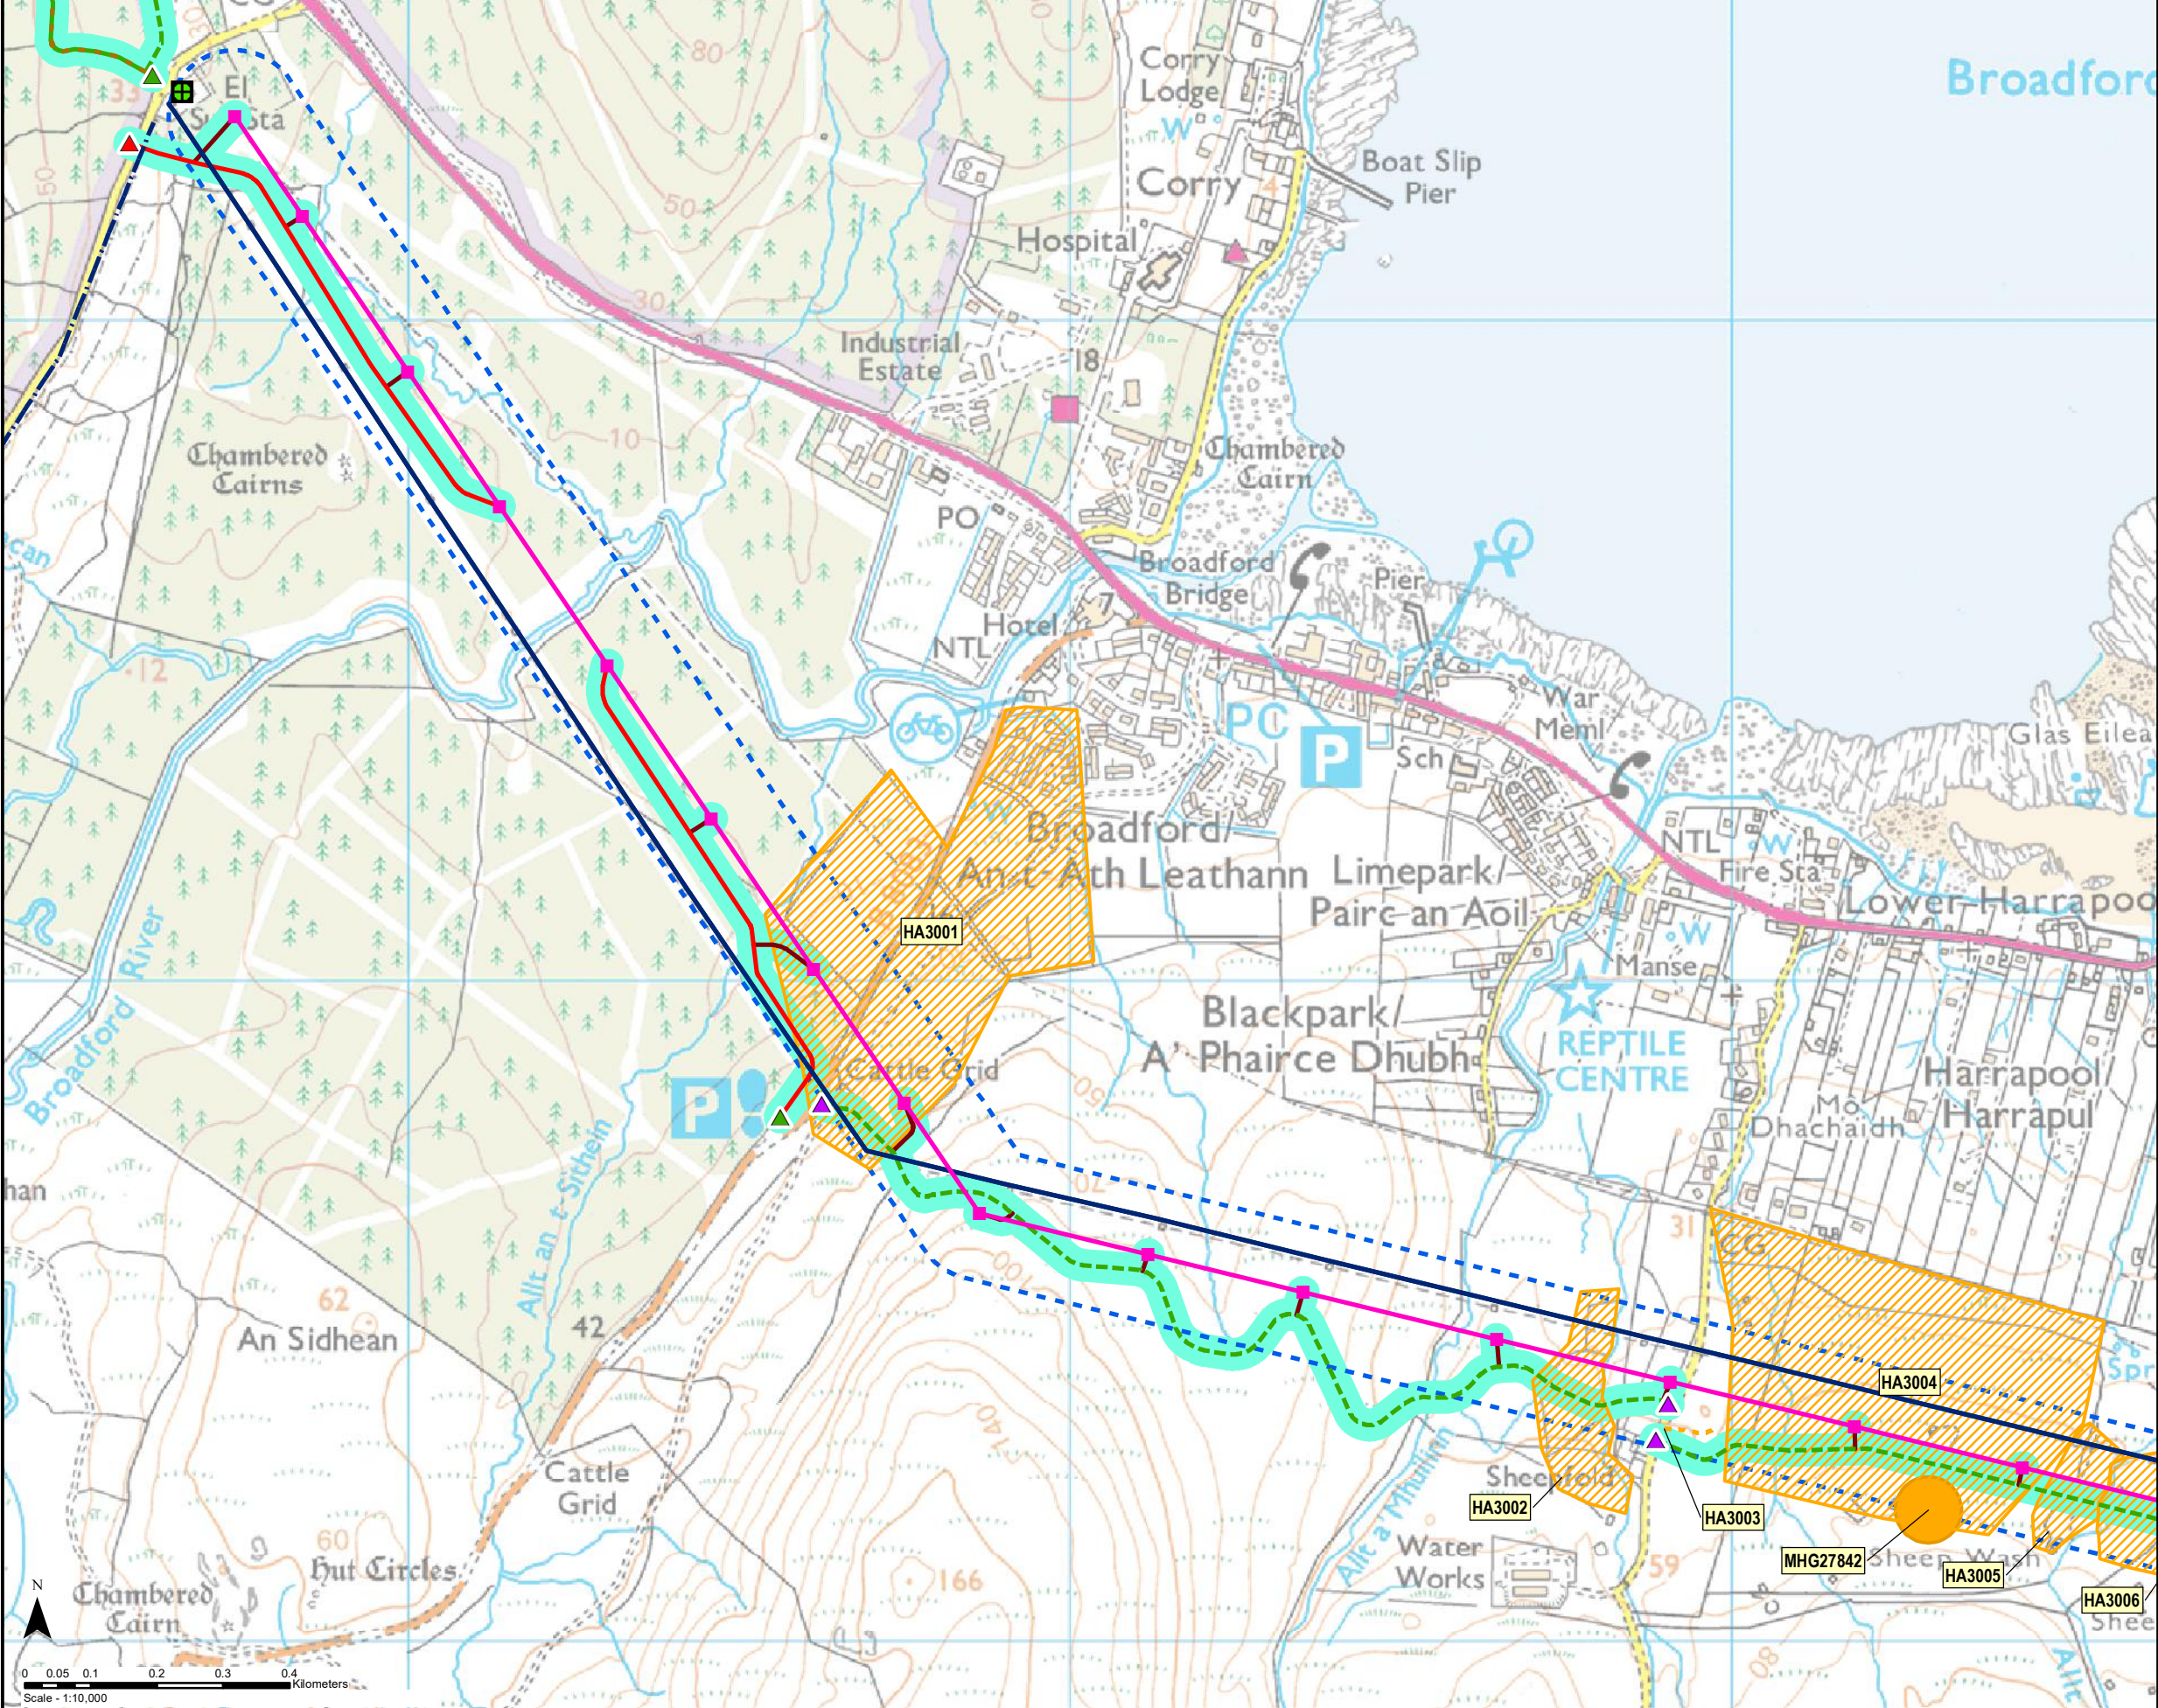

- Key**
- Proposed OHL Alignment
 - Existing Steel Lattice Tower to be Retained
 - Proposed Steel Lattice Tower
 - Proposed Sealing End Compound
 - Existing Access Track
 - Existing Access Track to be Upgraded
 - New Permanent Access Track (Cut / Fill Construction)
 - New Permanent Access Track (Floating Construction)
 - New Permanent Access Track (construction type to be determined)
 - - - New Temporary Access Track
 - New Temporary Spur to Towers
 - ▲ Existing Bellmouth
 - ▲ New Bellmouth
 - ▲ Temporary Bellmouth
 - Existing 132 kV OHL to be Dismantled (Steel Lattice)
 - - - Existing 132 kV OHL to be Dismantled (Wood Pole)
 - + Existing Substation
 - + Existing Substation to be Extended (separate application)
 - Inner Study Area (200m Corridor)
 - Inner Study Area (Access Track 50m Buffer)
 - Heritage Asset (area)
 - Heritage Asset (area)
 - Heritage Asset (linear)


Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2022 all rights reserved.
Ordnance Survey Licence number EL273236.

Project No: LT91
Project: Skye Reinforcement Project
EIA Report

Title: Figure-V2-8.1-S3a:
Heritage Assets in the Inner Study Area

Drawn by: TJ 01/09/2022

Drawing: Figure-V2-8.1-S3a

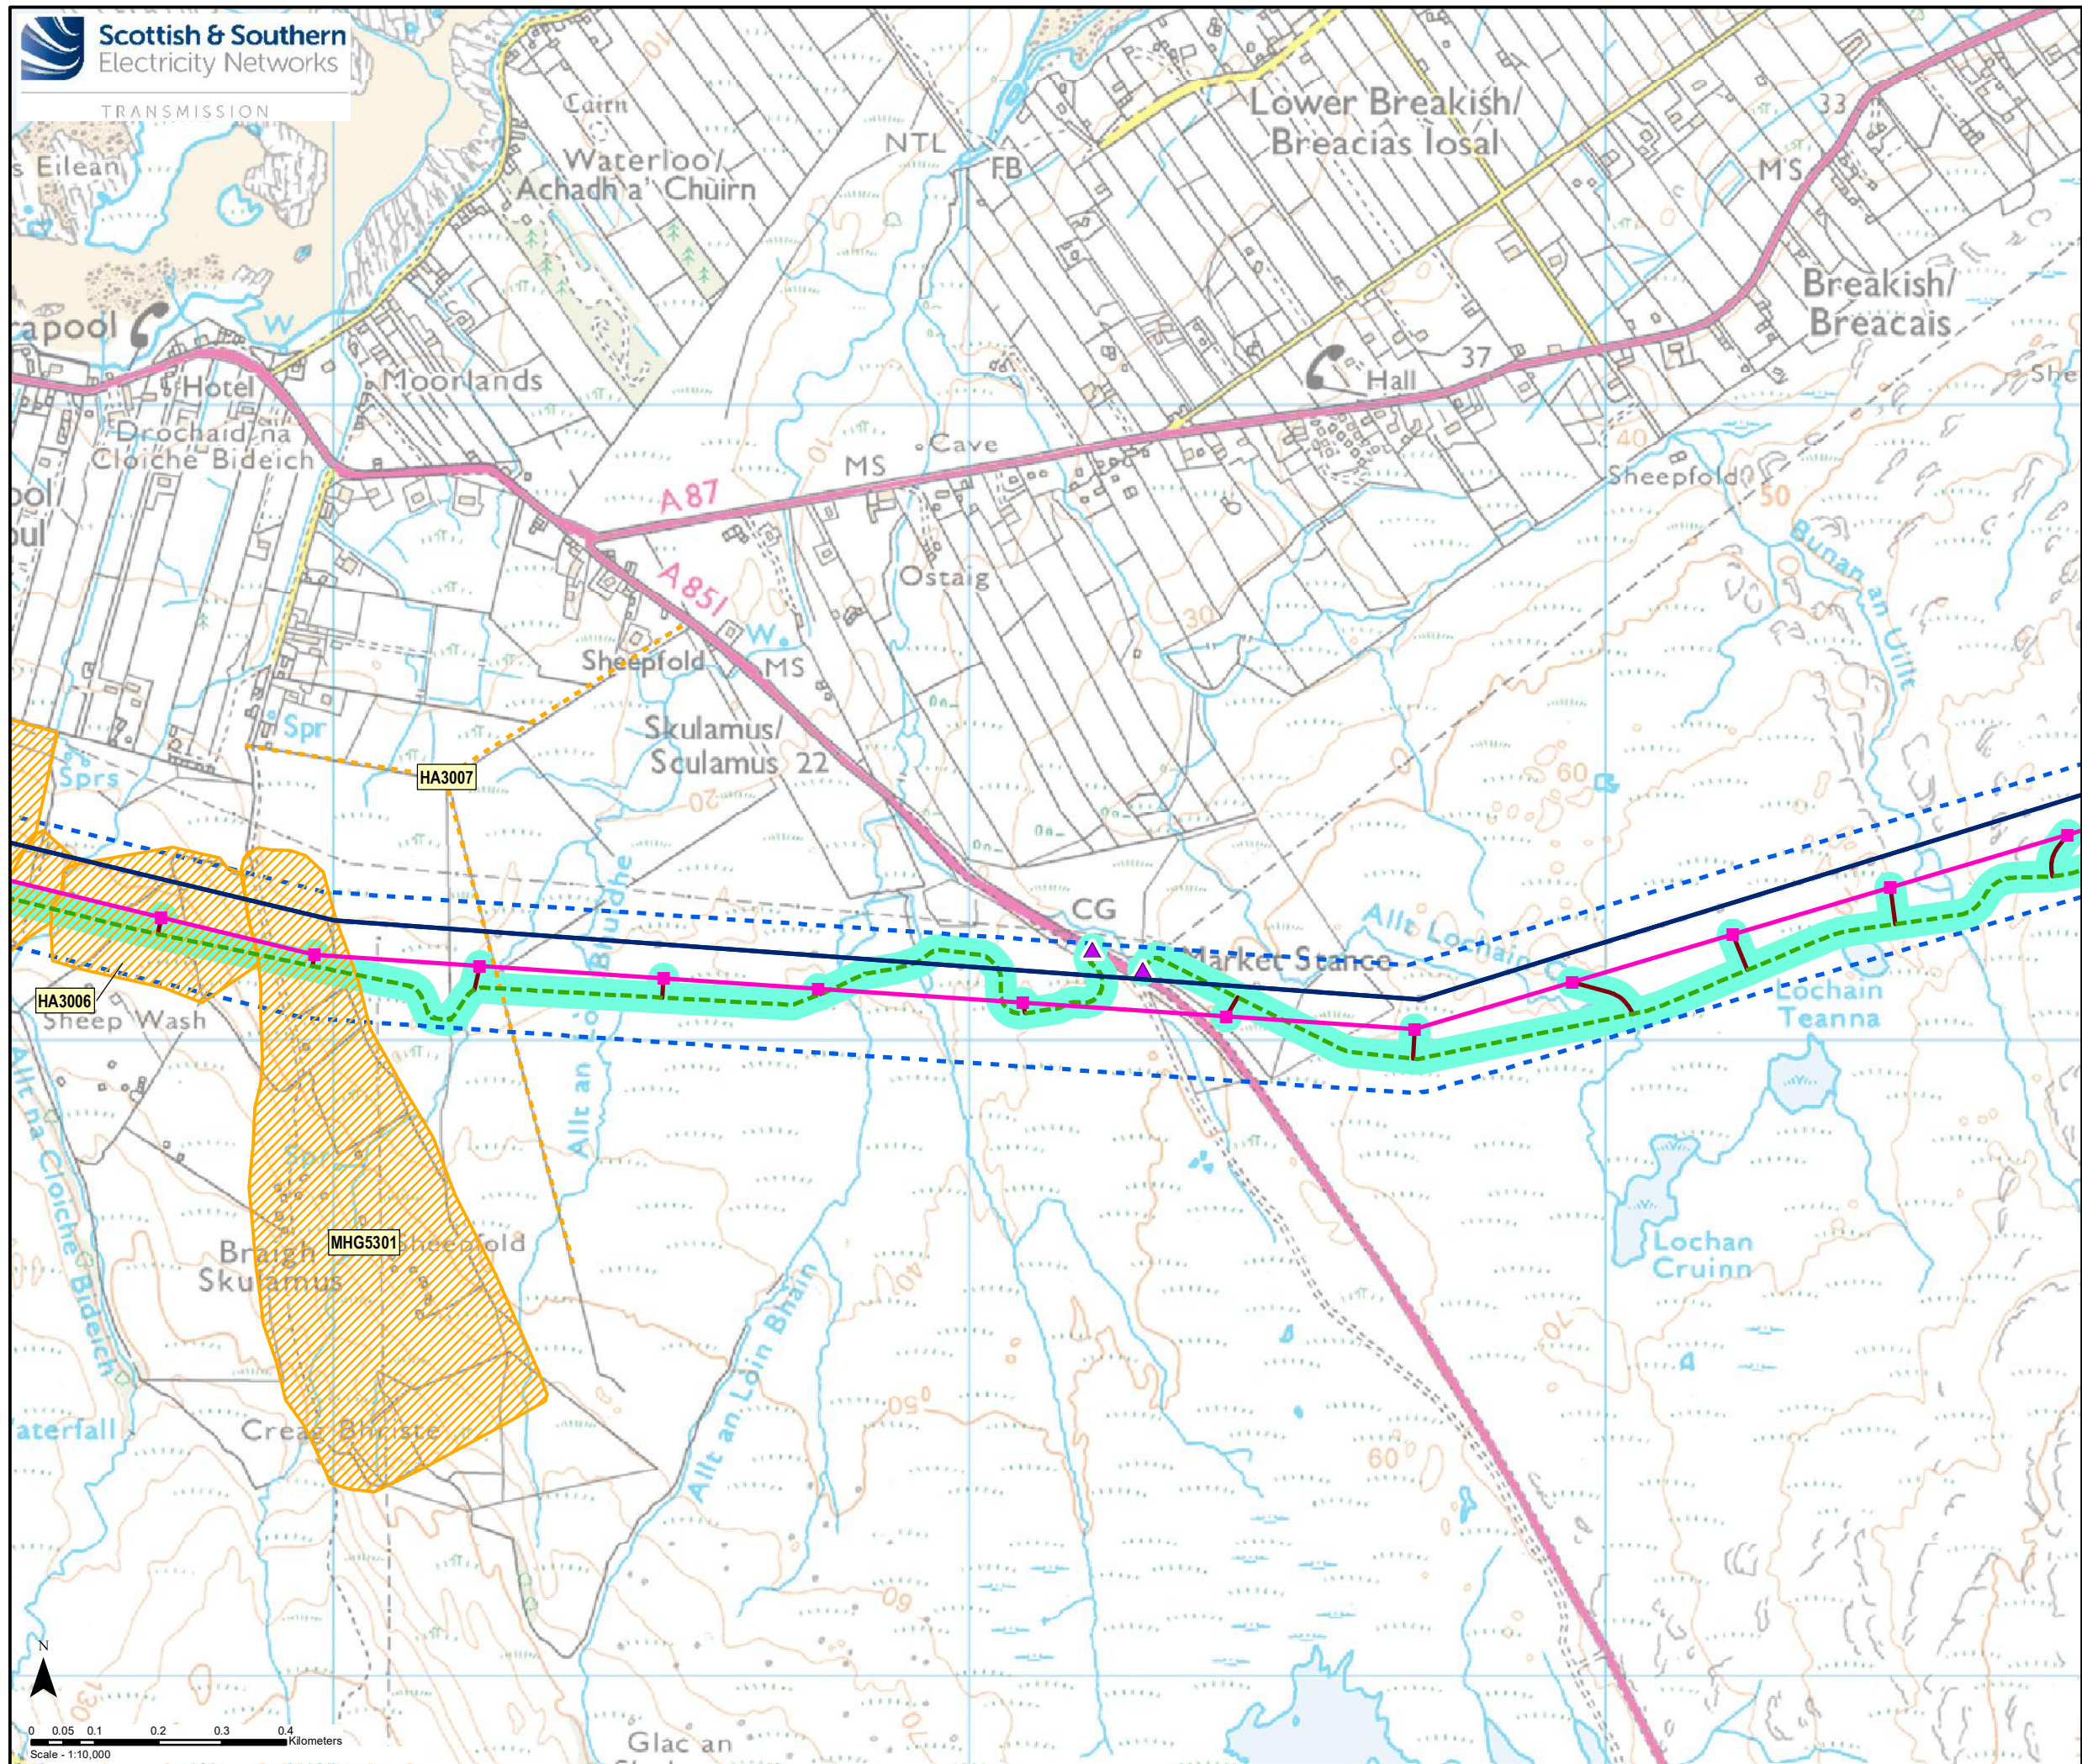


- Key**
- Proposed OHL Alignment
 - Existing Steel Lattice Tower to be Retained
 - Proposed Steel Lattice Tower
 - Proposed Sealing End Compound
 - Existing Access Track
 - Existing Access Track to be Upgraded
 - New Permanent Access Track (Cut / Fill Construction)
 - New Permanent Access Track (Floating Construction)
 - New Permanent Access Track (construction type to be determined)
 - - - New Temporary Access Track
 - New Temporary Spur to Towers
 - ▲ Existing Bellmouth
 - ▲ New Bellmouth
 - ▲ Temporary Bellmouth
 - Existing 132 kV OHL to be Dismantled (Steel Lattice)
 - - - Existing 132 kV OHL to be Dismantled (Wood Pole)
 - ⊕ Existing Substation
 - ⊕ Existing Substation to be Extended (separate application)
 - Inner Study Area (200m Corridor)
 - Inner Study Area (Access Track 50m Buffer)
 - Heritage Asset (area)
 - Heritage Asset (area)
 - Heritage Asset (linear)


Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2022 all rights reserved.
Ordnance Survey Licence number EL273236.

Project No: LT91
Project: Skye Reinforcement Project
EIA Report

Title: Figure-V2-8.1-S3b:
Heritage Assets in the Inner Study Area

Drawn by: TJ 01/09/2022
Drawing: Figure-V2-8.1-S3b

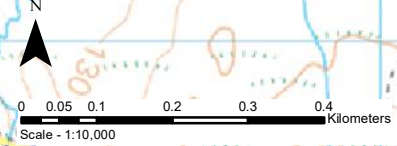

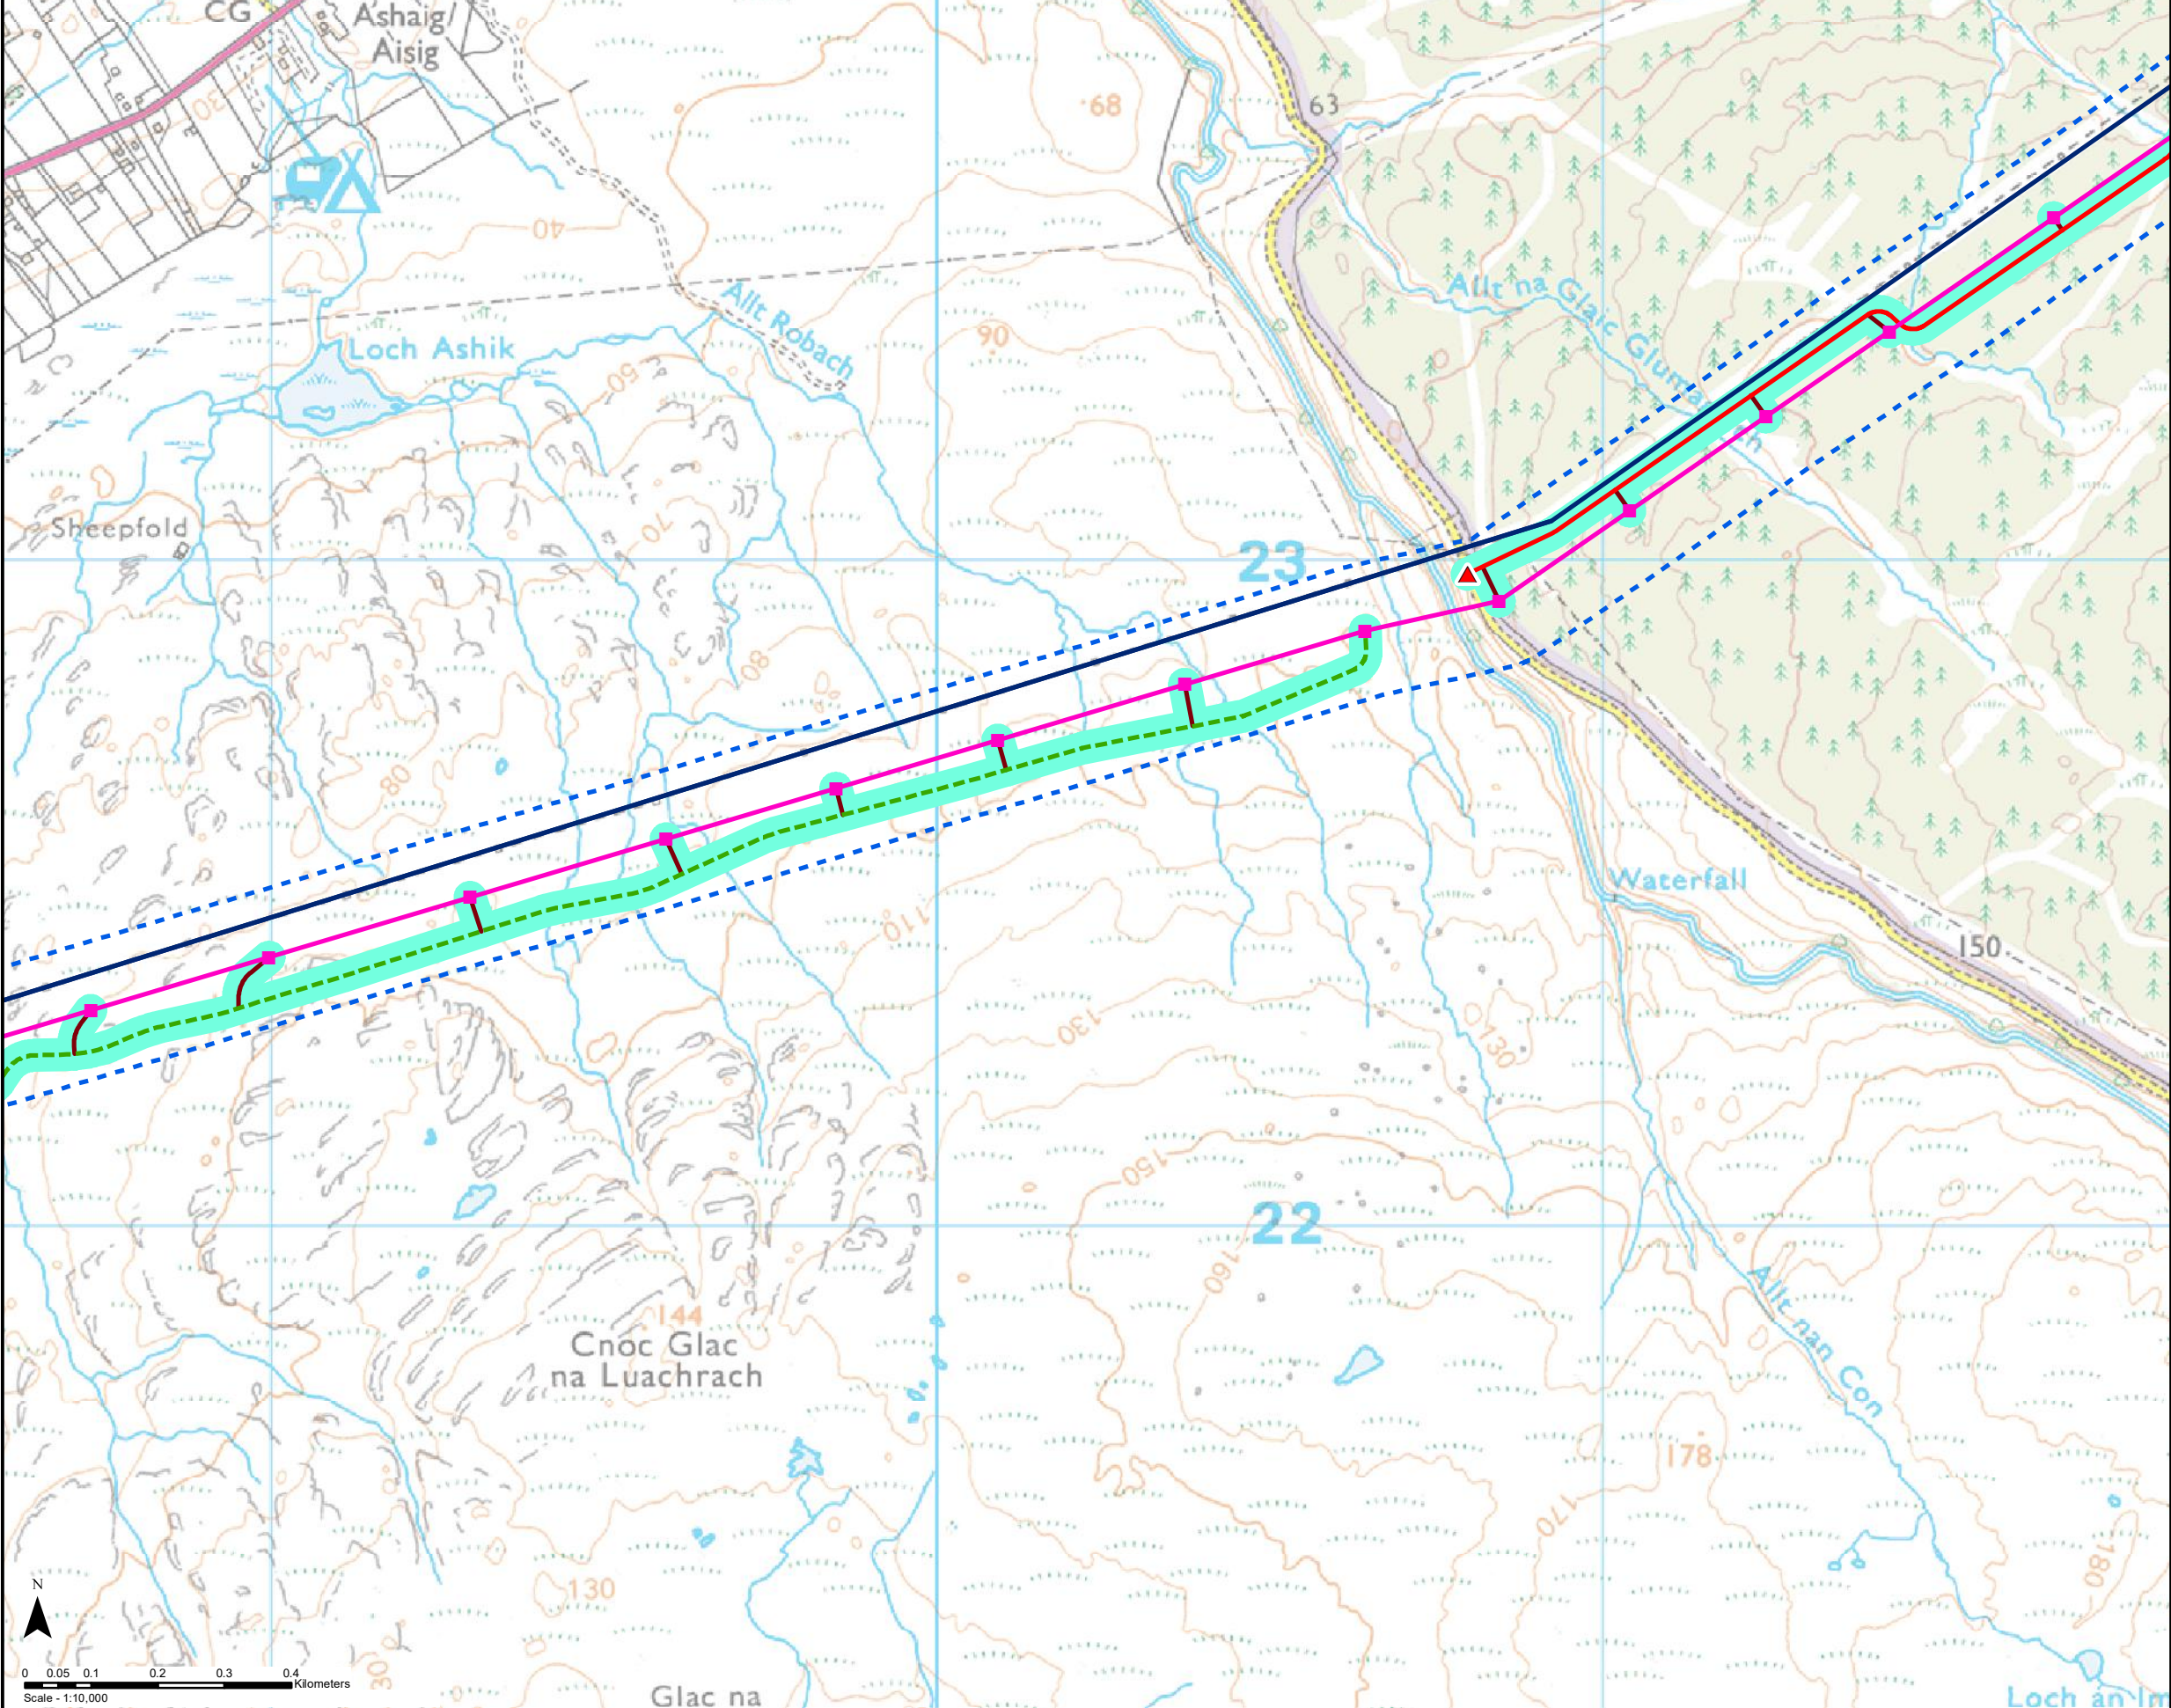

- Key**
- Proposed OHL Alignment
 - Existing Steel Lattice Tower to be Retained
 - Proposed Steel Lattice Tower
 - Proposed Sealing End Compound
 - Existing Access Track
 - Existing Access Track to be Upgraded
 - New Permanent Access Track (Cut / Fill Construction)
 - New Permanent Access Track (Floating Construction)
 - New Permanent Access Track (construction type to be determined)
 - - - New Temporary Access Track
 - New Temporary Spur to Towers
 - ▲ Existing Bellmouth
 - ▲ New Bellmouth
 - ▲ Temporary Bellmouth
 - Existing 132 kV OHL to be Dismantled (Steel Lattice)
 - - - Existing 132 kV OHL to be Dismantled (Wood Pole)
 - Existing Substation
 - Existing Substation to be Extended (separate application)
 - - - Inner Study Area (200m Corridor)
 - Inner Study Area (Access Track 50m Buffer)
 - Heritage Asset (area)
 - ▨ Heritage Asset (area)
 - - - Heritage Asset (linear)


Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2022 all rights reserved.
Ordnance Survey Licence number EL273236.


Project No: LT91
Project: Skye Reinforcement Project
EIA Report

Title: Figure-V2-8.1-S3c:
Heritage Assets in the Inner Study Area

Drawn by: TJ 01/09/2022

Drawing: Figure-V2-8.1-S3c

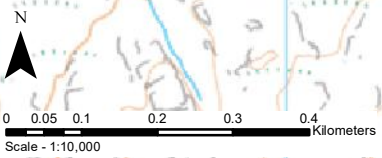

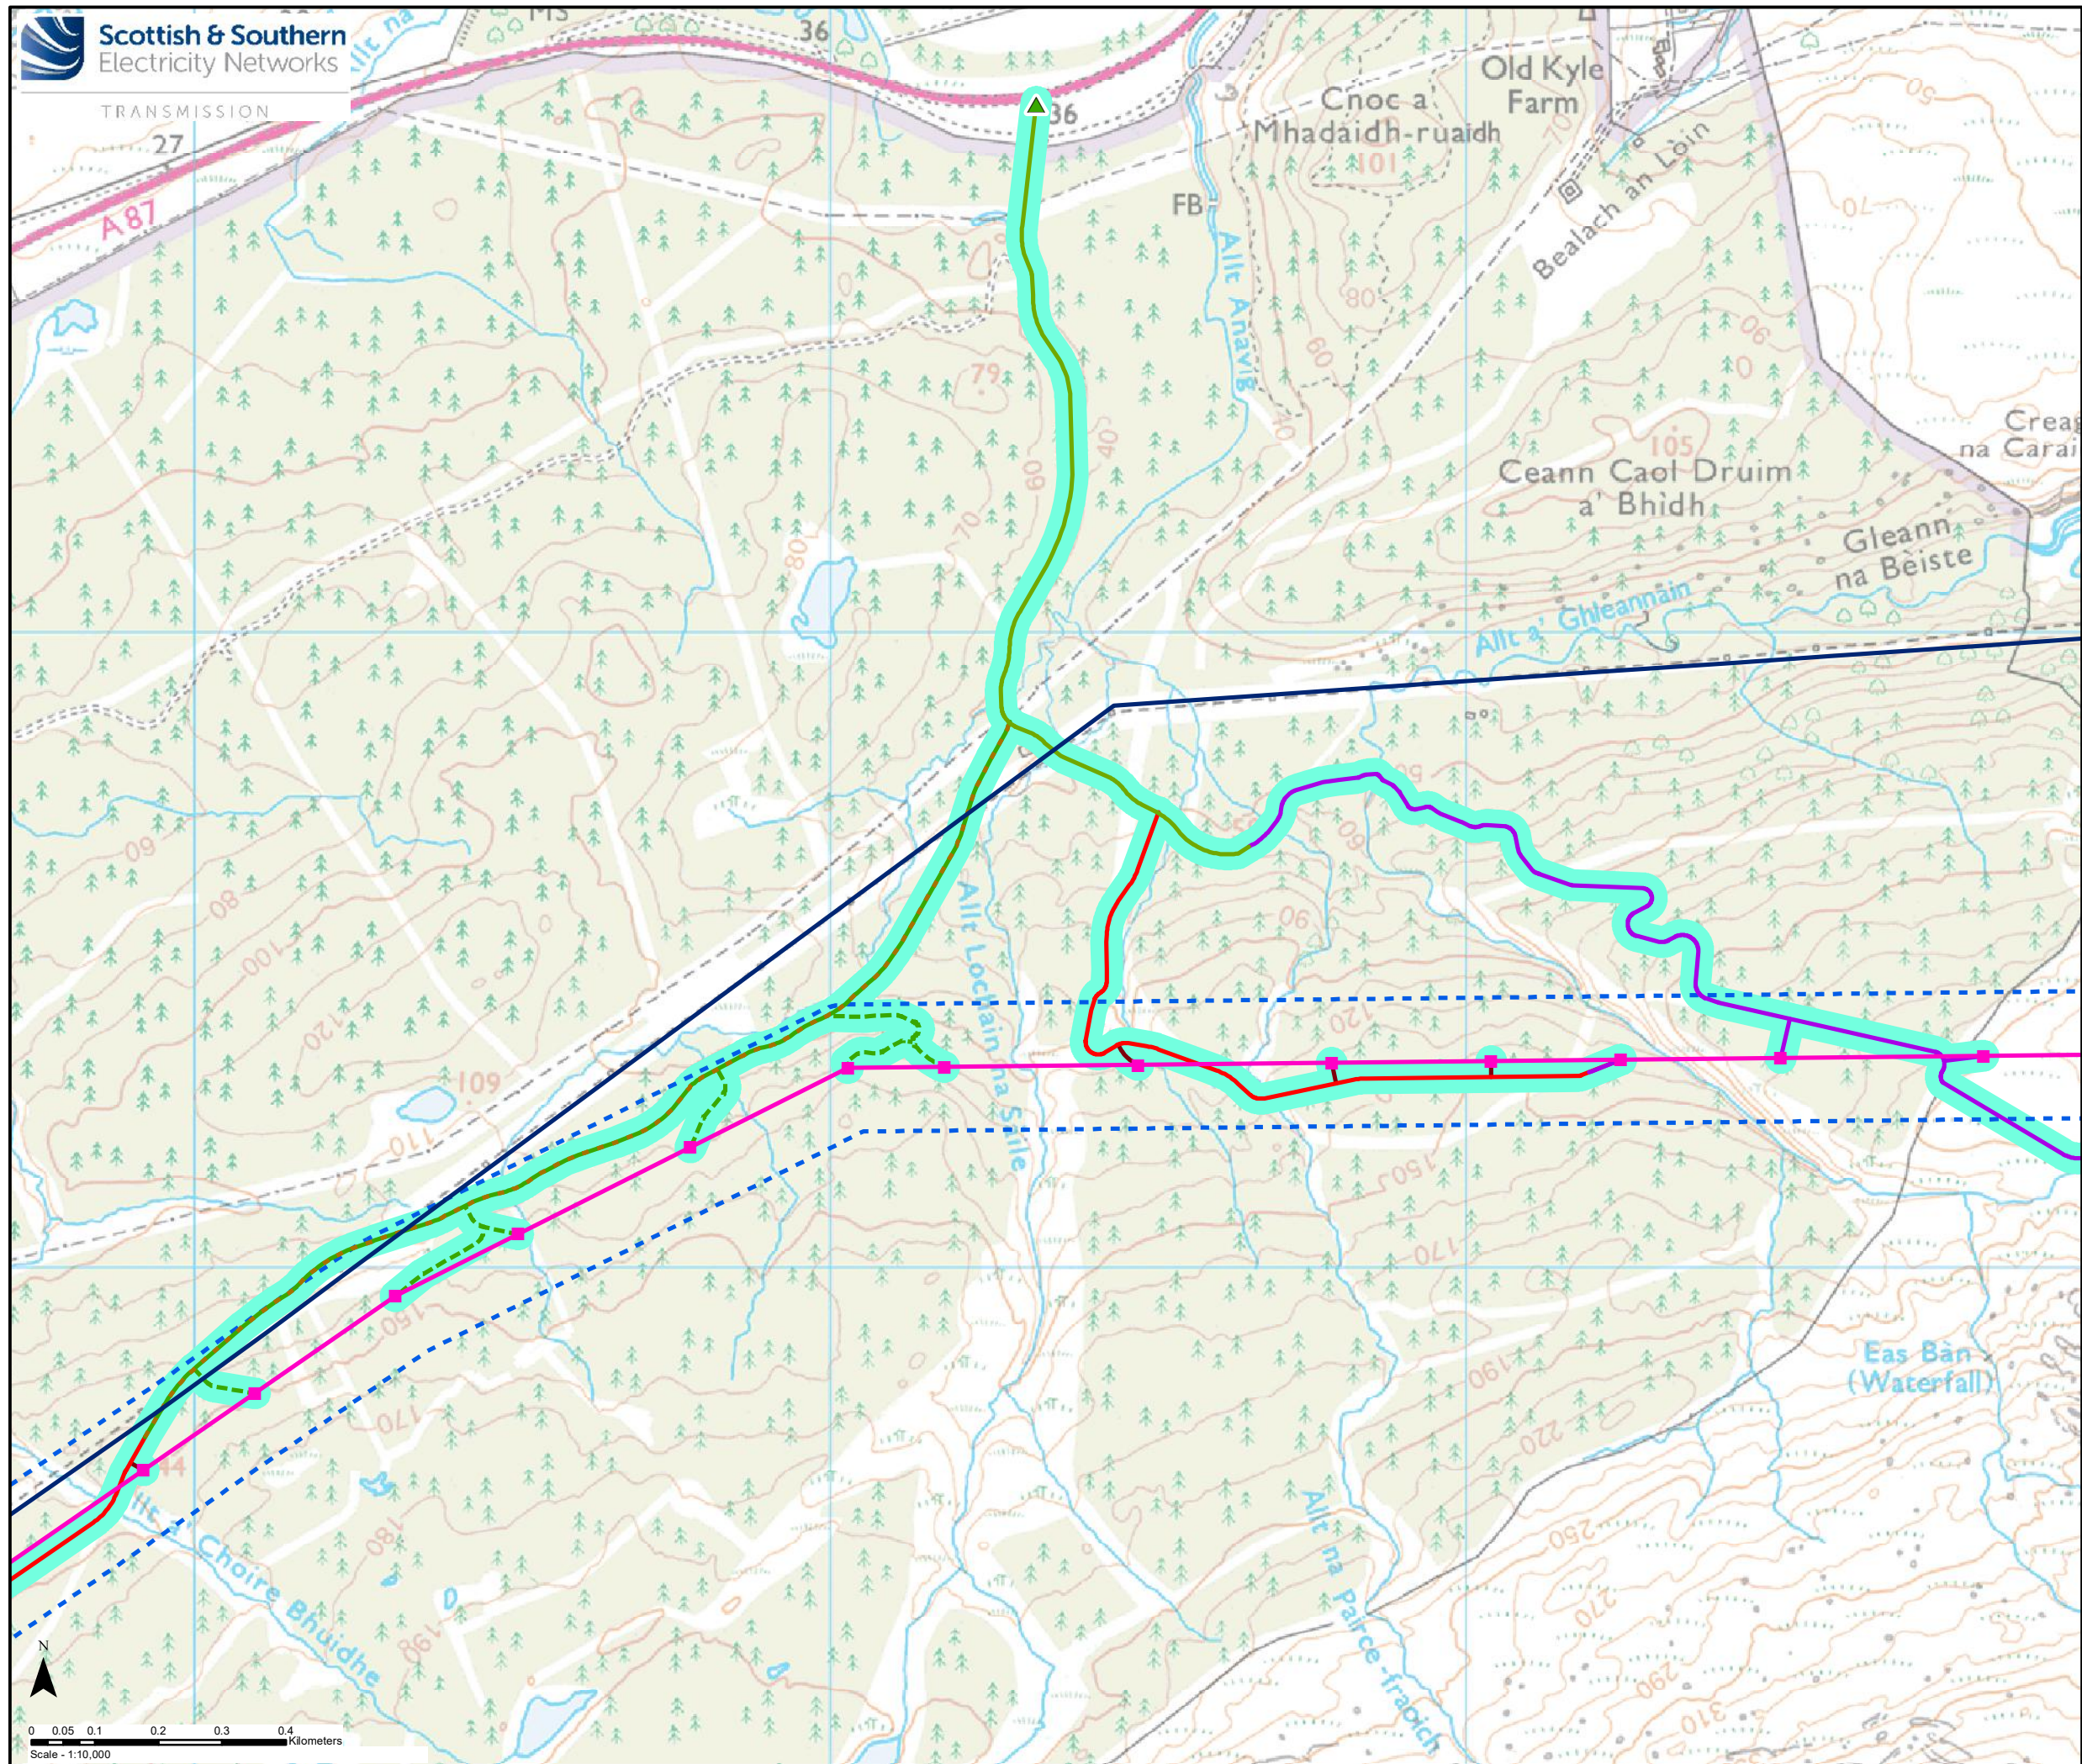


- Key**
- Proposed OHL Alignment
 - Existing Steel Lattice Tower to be Retained
 - Proposed Steel Lattice Tower
 - Proposed Sealing End Compound
 - Existing Access Track
 - Existing Access Track to be Upgraded
 - New Permanent Access Track (Cut / Fill Construction)
 - New Permanent Access Track (Floating Construction)
 - New Permanent Access Track (construction type to be determined)
 - New Temporary Access Track
 - New Temporary Spur to Towers
 - ▲ Existing Bellmouth
 - ▲ New Bellmouth
 - ▲ Temporary Bellmouth
 - Existing 132 kV OHL to be Dismantled (Steel Lattice)
 - Existing 132 kV OHL to be Dismantled (Wood Pole)
 - + Existing Substation
 - + Existing Substation to be Extended (separate application)
 - Inner Study Area (200m Corridor)
 - Inner Study Area (Access Track 50m Buffer)
 - Heritage Asset (area)
 - Heritage Asset (area)
 - Heritage Asset (linear)

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2022 all rights reserved.
Ordnance Survey Licence number EL273236.

Project No: LT91
Project: Skye Reinforcement Project
EIA Report

Title: Figure-V2-8.1-S3d:
Heritage Assets in the Inner Study Area

Drawn by: TJ 01/09/2022
Drawing: Figure-V2-8.1-S3d

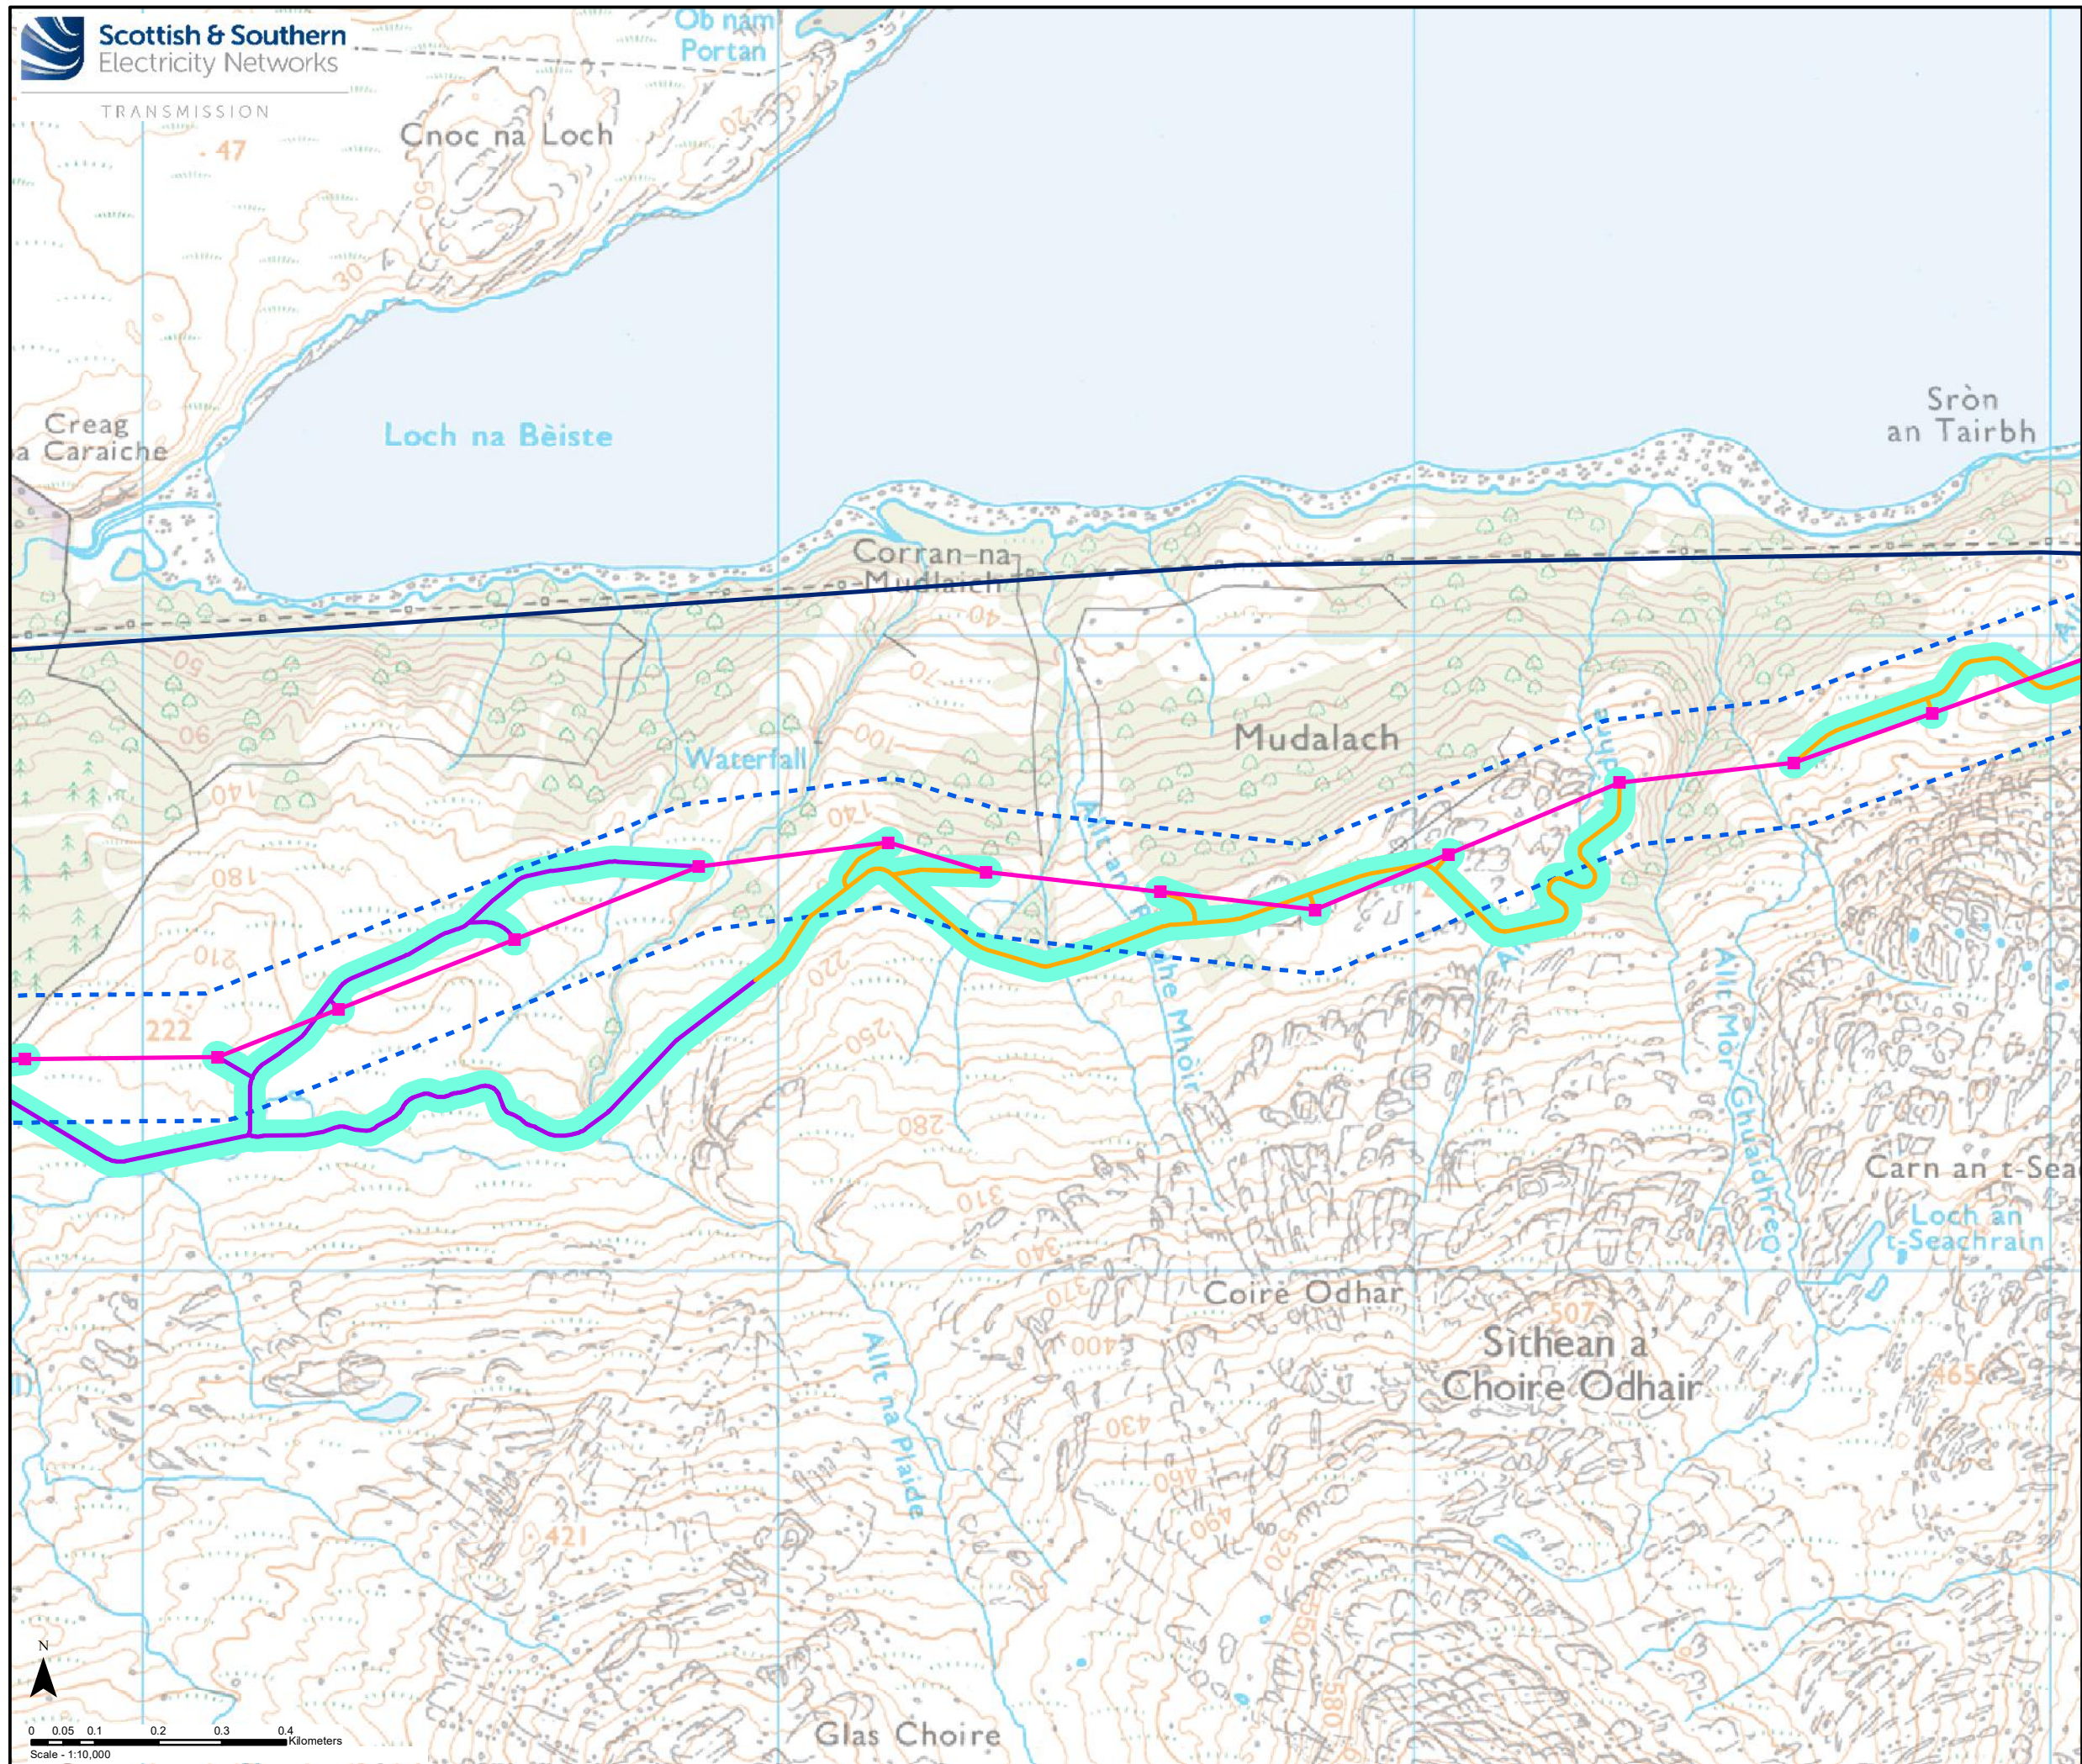

- Key**
- Proposed OHL Alignment
 - Existing Steel Lattice Tower to be Retained
 - Proposed Steel Lattice Tower
 - Proposed Sealing End Compound
 - Existing Access Track
 - Existing Access Track to be Upgraded
 - New Permanent Access Track (Cut / Fill Construction)
 - New Permanent Access Track (Floating Construction)
 - New Permanent Access Track (construction type to be determined)
 - - - New Temporary Access Track
 - New Temporary Spur to Towers
 - ▲ Existing Bellmouth
 - ▲ New Bellmouth
 - ▲ Temporary Bellmouth
 - Existing 132 kV OHL to be Dismantled (Steel Lattice)
 - - - Existing 132 kV OHL to be Dismantled (Wood Pole)
 - Existing Substation
 - Existing Substation to be Extended (separate application)
 - Inner Study Area (200m Corridor)
 - Inner Study Area (Access Track 50m Buffer)
 - Heritage Asset (area)
 - Heritage Asset (area)
 - Heritage Asset (linear)


Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2022 all rights reserved.
Ordnance Survey Licence number EL273236.


Project No: LT91
Project: Skye Reinforcement Project
EIA Report

Title: Figure-V2-8.1-S3e:
Heritage Assets in the Inner Study Area

Drawn by: TJ 01/09/2022

Drawing: Figure-V2-8.1-S3e

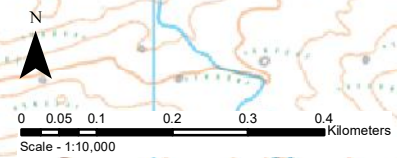

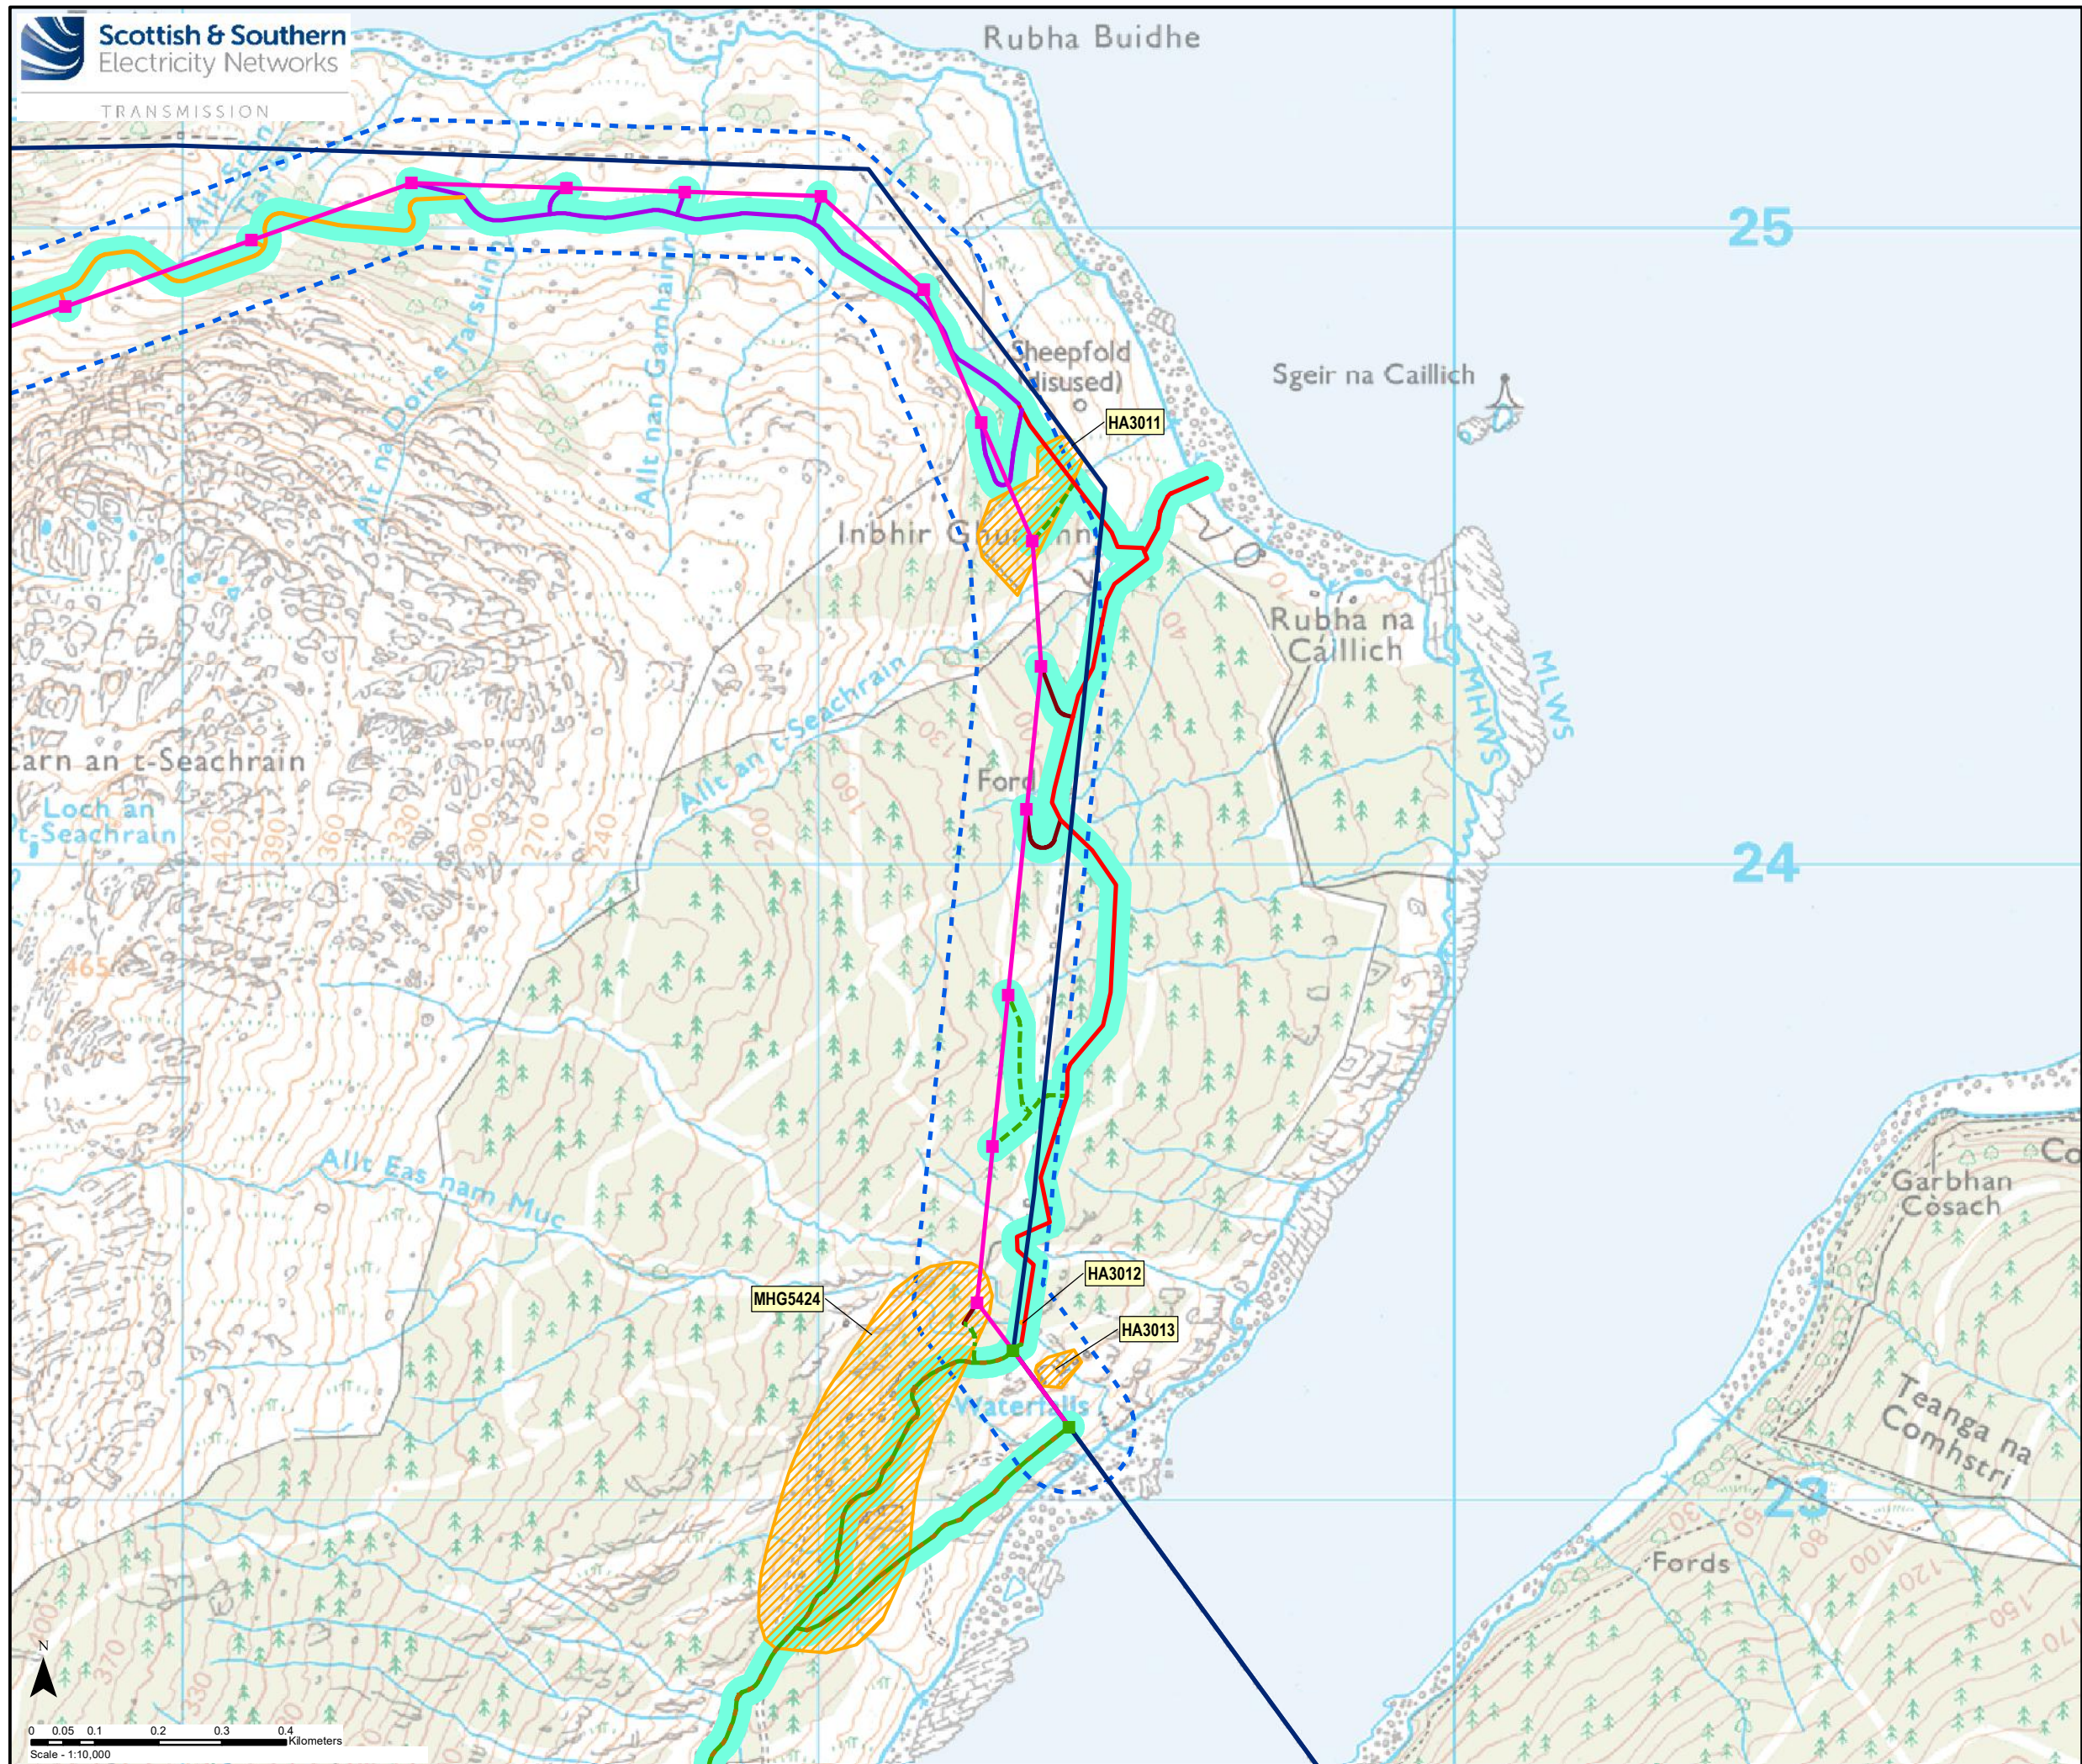

- Key**
- Proposed OHL Alignment
 - Existing Steel Lattice Tower to be Retained
 - Proposed Steel Lattice Tower
 - Proposed Sealing End Compound
 - Existing Access Track
 - Existing Access Track to be Upgraded
 - New Permanent Access Track (Cut / Fill Construction)
 - New Permanent Access Track (Floating Construction)
 - New Permanent Access Track (construction type to be determined)
 - - - New Temporary Access Track
 - New Temporary Spur to Towers
 - ▲ Existing Bellmouth
 - ▲ New Bellmouth
 - ▲ Temporary Bellmouth
 - Existing 132 kV OHL to be Dismantled (Steel Lattice)
 - - - Existing 132 kV OHL to be Dismantled (Wood Pole)
 - + Existing Substation
 - + Existing Substation to be Extended (separate application)
 - Inner Study Area (200m Corridor)
 - Inner Study Area (Access Track 50m Buffer)
 - Heritage Asset (area)
 - Heritage Asset (area)
 - Heritage Asset (linear)


Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2022 all rights reserved.
Ordnance Survey Licence number EL273236.

Project No: LT91
Project: Skye Reinforcement Project
EIA Report

Title: Figure-V2-8.1-S3f:
Heritage Assets in the Inner Study Area

Drawn by: TJ 01/09/2022

Drawing: Figure-V2-8.1-S3f

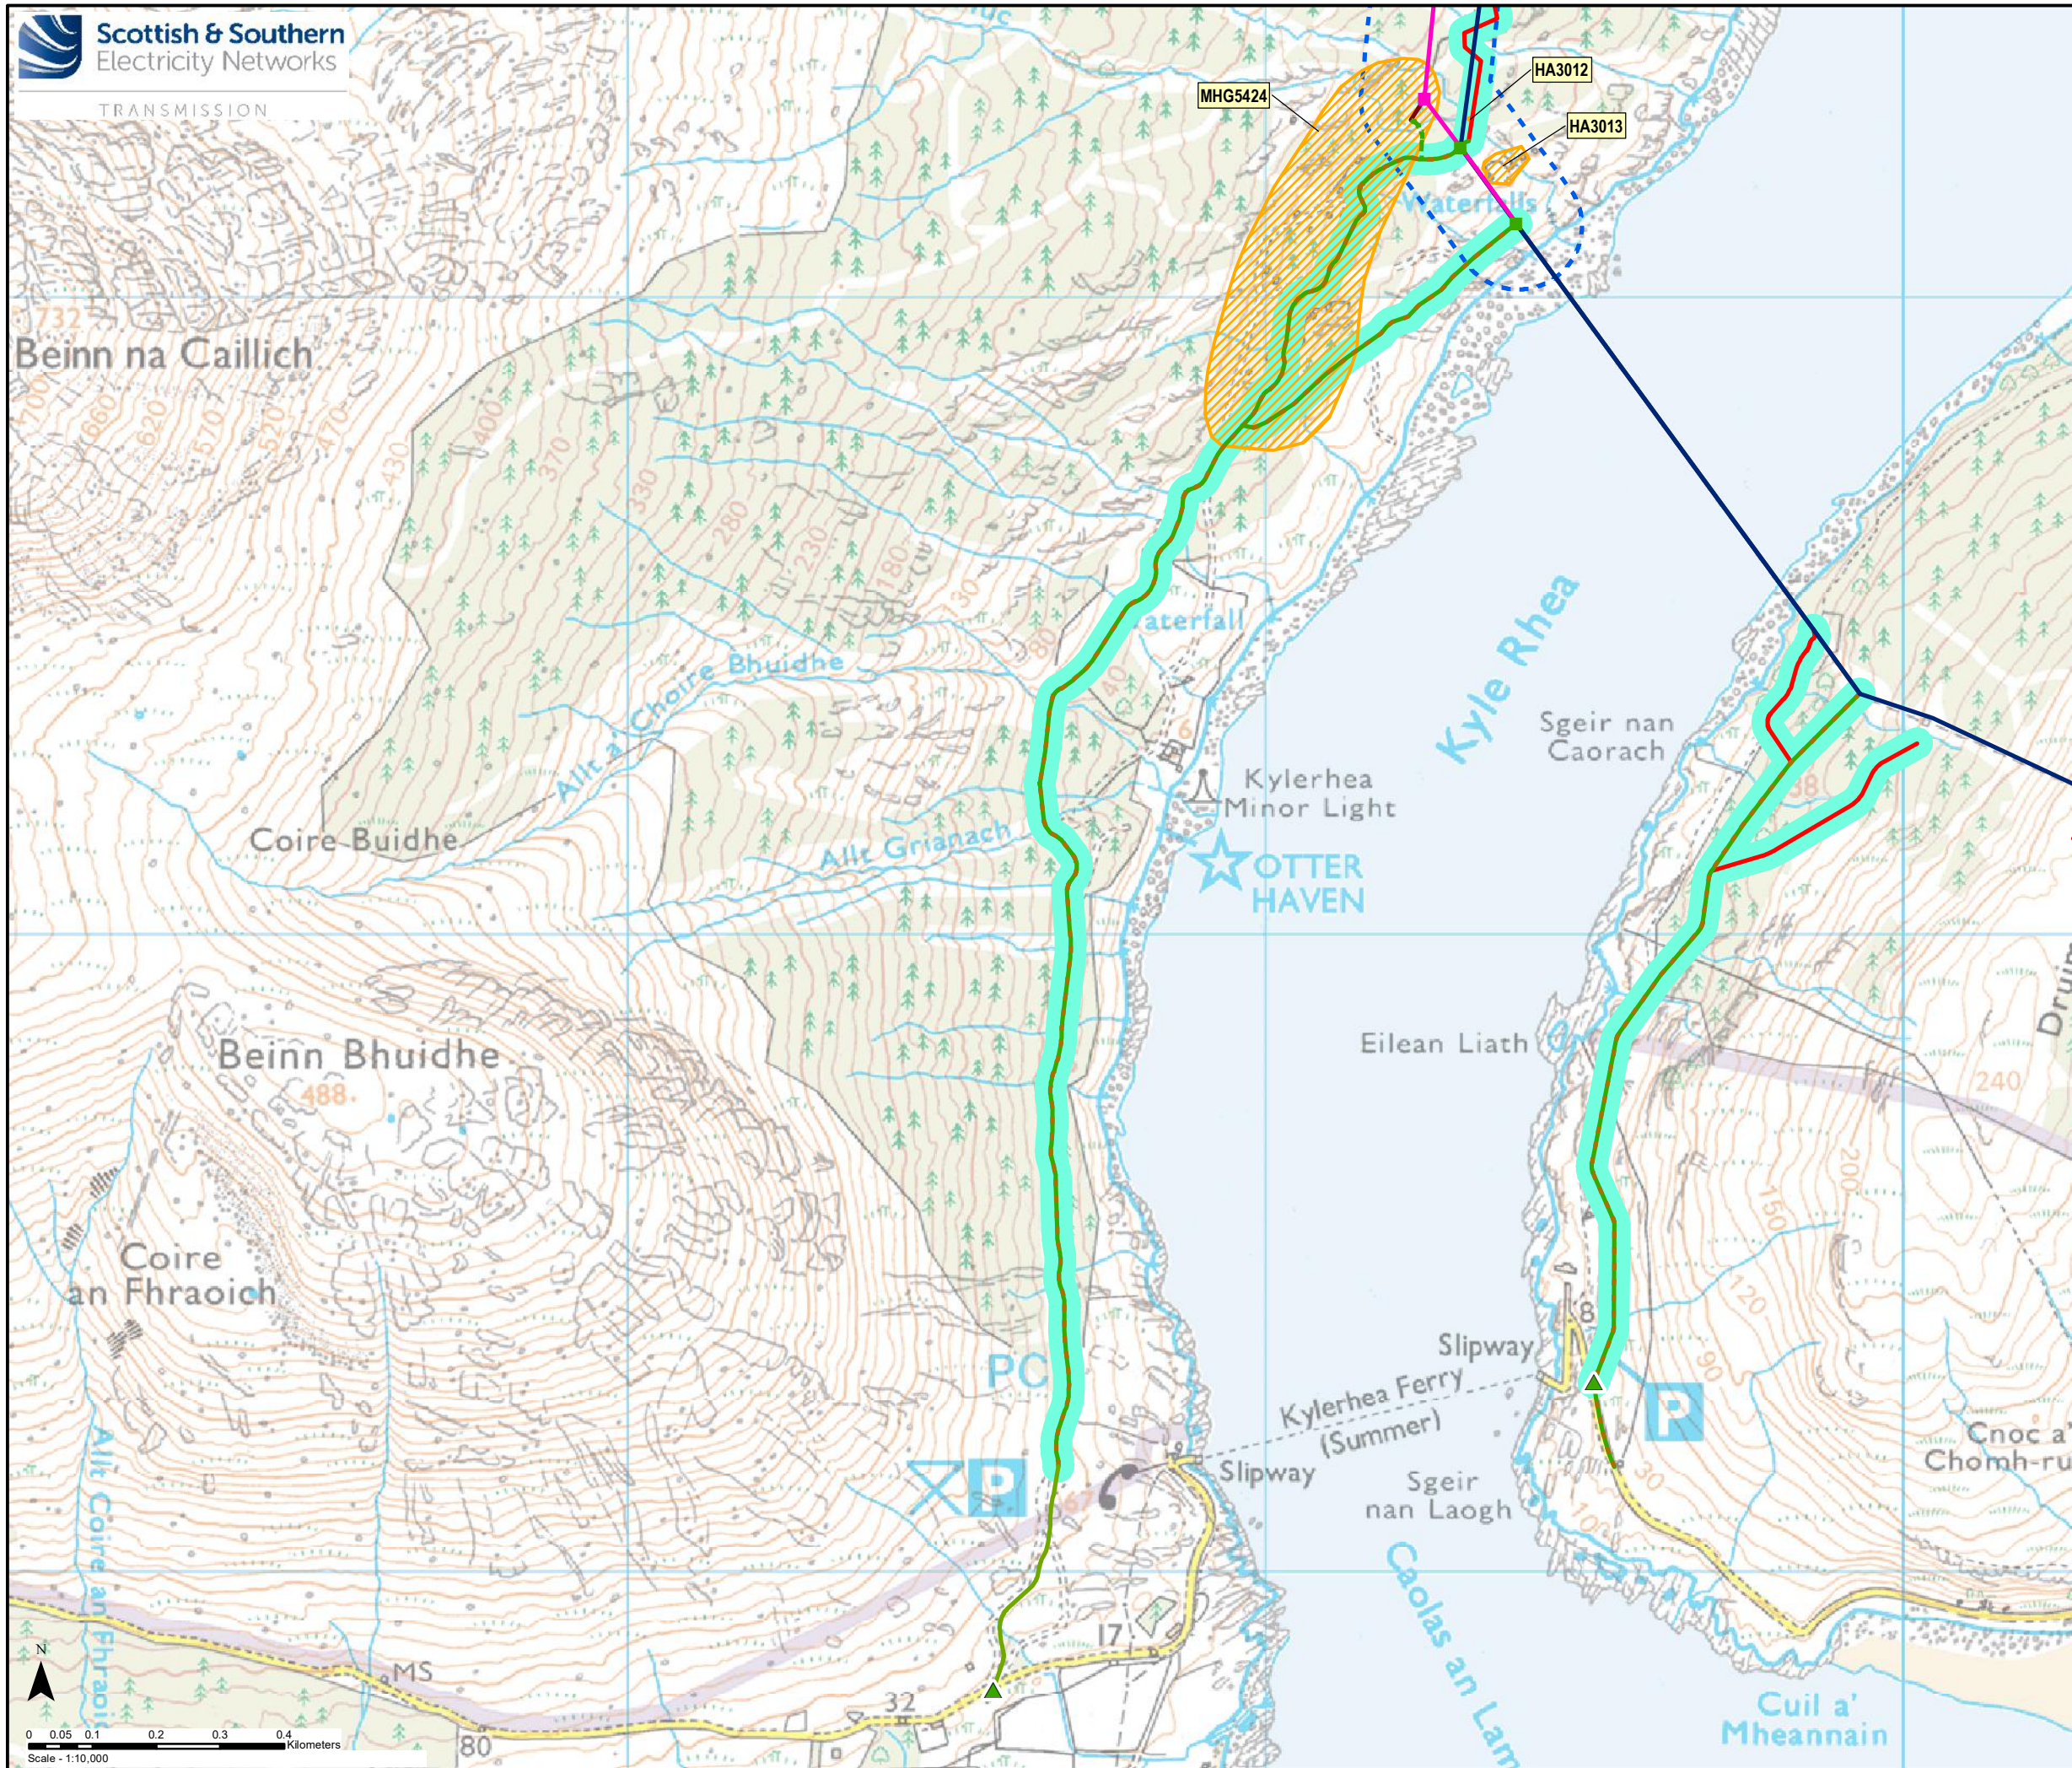

Key

- Proposed OHL Alignment
- Existing Steel Lattice Tower to be Retained
- Proposed Steel Lattice Tower
- Proposed Sealing End Compound
- Existing Access Track
- Existing Access Track to be Upgraded
- New Permanent Access Track (Cut / Fill Construction)
- New Permanent Access Track (Floating Construction)
- New Permanent Access Track (construction type to be determined)
- New Temporary Access Track
- New Temporary Spur to Towers
- ▲ Existing Bellmouth
- ▲ New Bellmouth
- ▲ Temporary Bellmouth
- Existing 132 kV OHL to be Dismantled (Steel Lattice)
- Existing 132 kV OHL to be Dismantled (Wood Pole)
- Existing Substation
- Existing Substation to be Extended (separate application)
- Inner Study Area (200m Corridor)
- Inner Study Area (Access Track 50m Buffer)
- Heritage Asset (area)
- Heritage Asset (area)
- Heritage Asset (linear)

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2022 all rights reserved.
Ordnance Survey Licence number EL273236.

Project No: LT91
Project: Skye Reinforcement Project
EIA Report

Title: Figure-V2-8.1-S3g:
Heritage Assets in the Inner Study Area

Drawn by: TJ 01/09/2022

Drawing: Figure-V2-8.1-S3g