

Key

- Section Divider
- Existing 132 kV OHL (to be replaced)
- Preferred Alignment (Overhead Line)
- ⋯ Preferred Alignment (Underground Cable)
- Sealing End Compound
- ▲ Substation

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2021 all rights reserved.
Ordnance Survey Licence number EL273236.


Project No: LT91
Project: Skye Reinforcement Project
Consultation Document (Alignment)

Title: Figure 3.2a - Preferred Alignment and Design Solution Section 2

Drawn by: SK 20/09/2021

Drawing: 119026-D-CD-3.2a-1.0.0



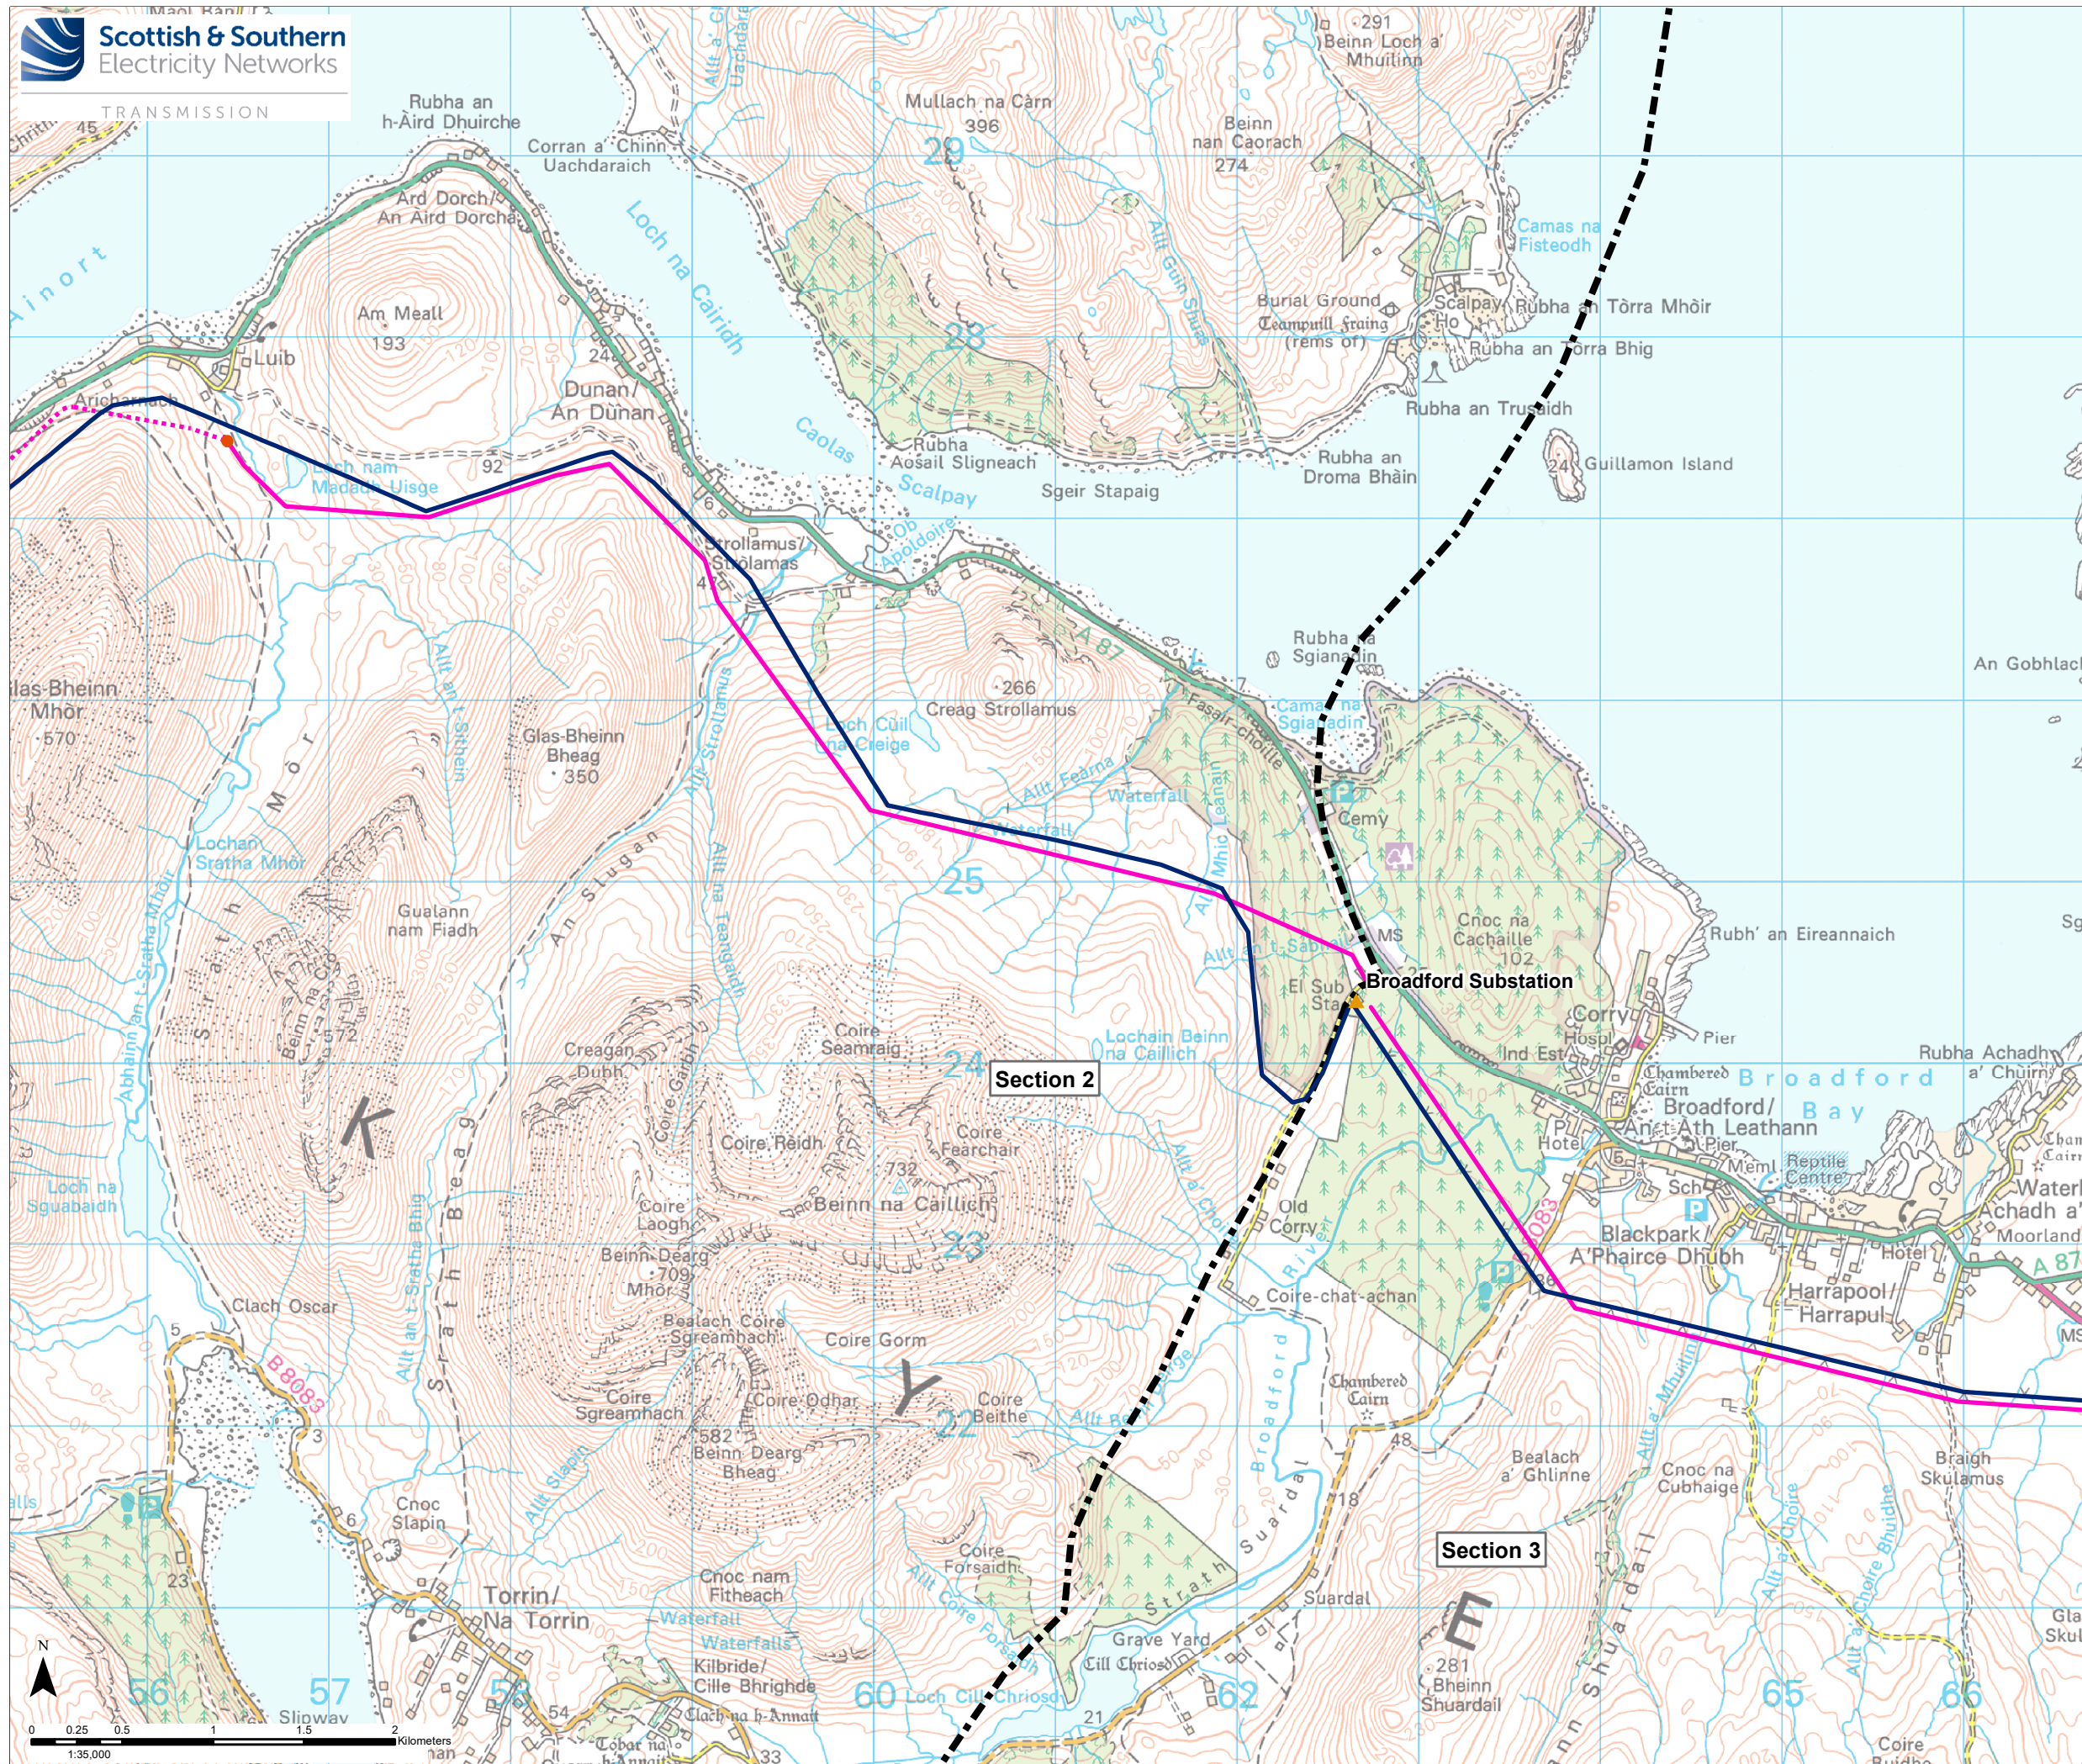

- Key**
- Section Divider
 - Existing 132 kV OHL (to be replaced)
 - Preferred Alignment (Overhead Line)
 - ... Preferred Alignment (Underground Cable)
 - Sealing End Compound
 - ▲ Substation

Section 2

Section 3

Reproduced by permission of Ordnance Survey on behalf of HMSO.
Crown copyright and database right 2021 all rights reserved.
Ordnance Survey Licence number EL273236.

Project No: LT91
Project: Skye Reinforcement Project
Consultation Document (Alignment)

Title: Figure 3.2b - Preferred Alignment and
Design Solution Section 2

Drawn by: SK 20/09/2021
Drawing: 119026-D-CD-3.2b-1.0.0

