


Section 4

Section 5

**EAST GLENQUOICH FOREST**

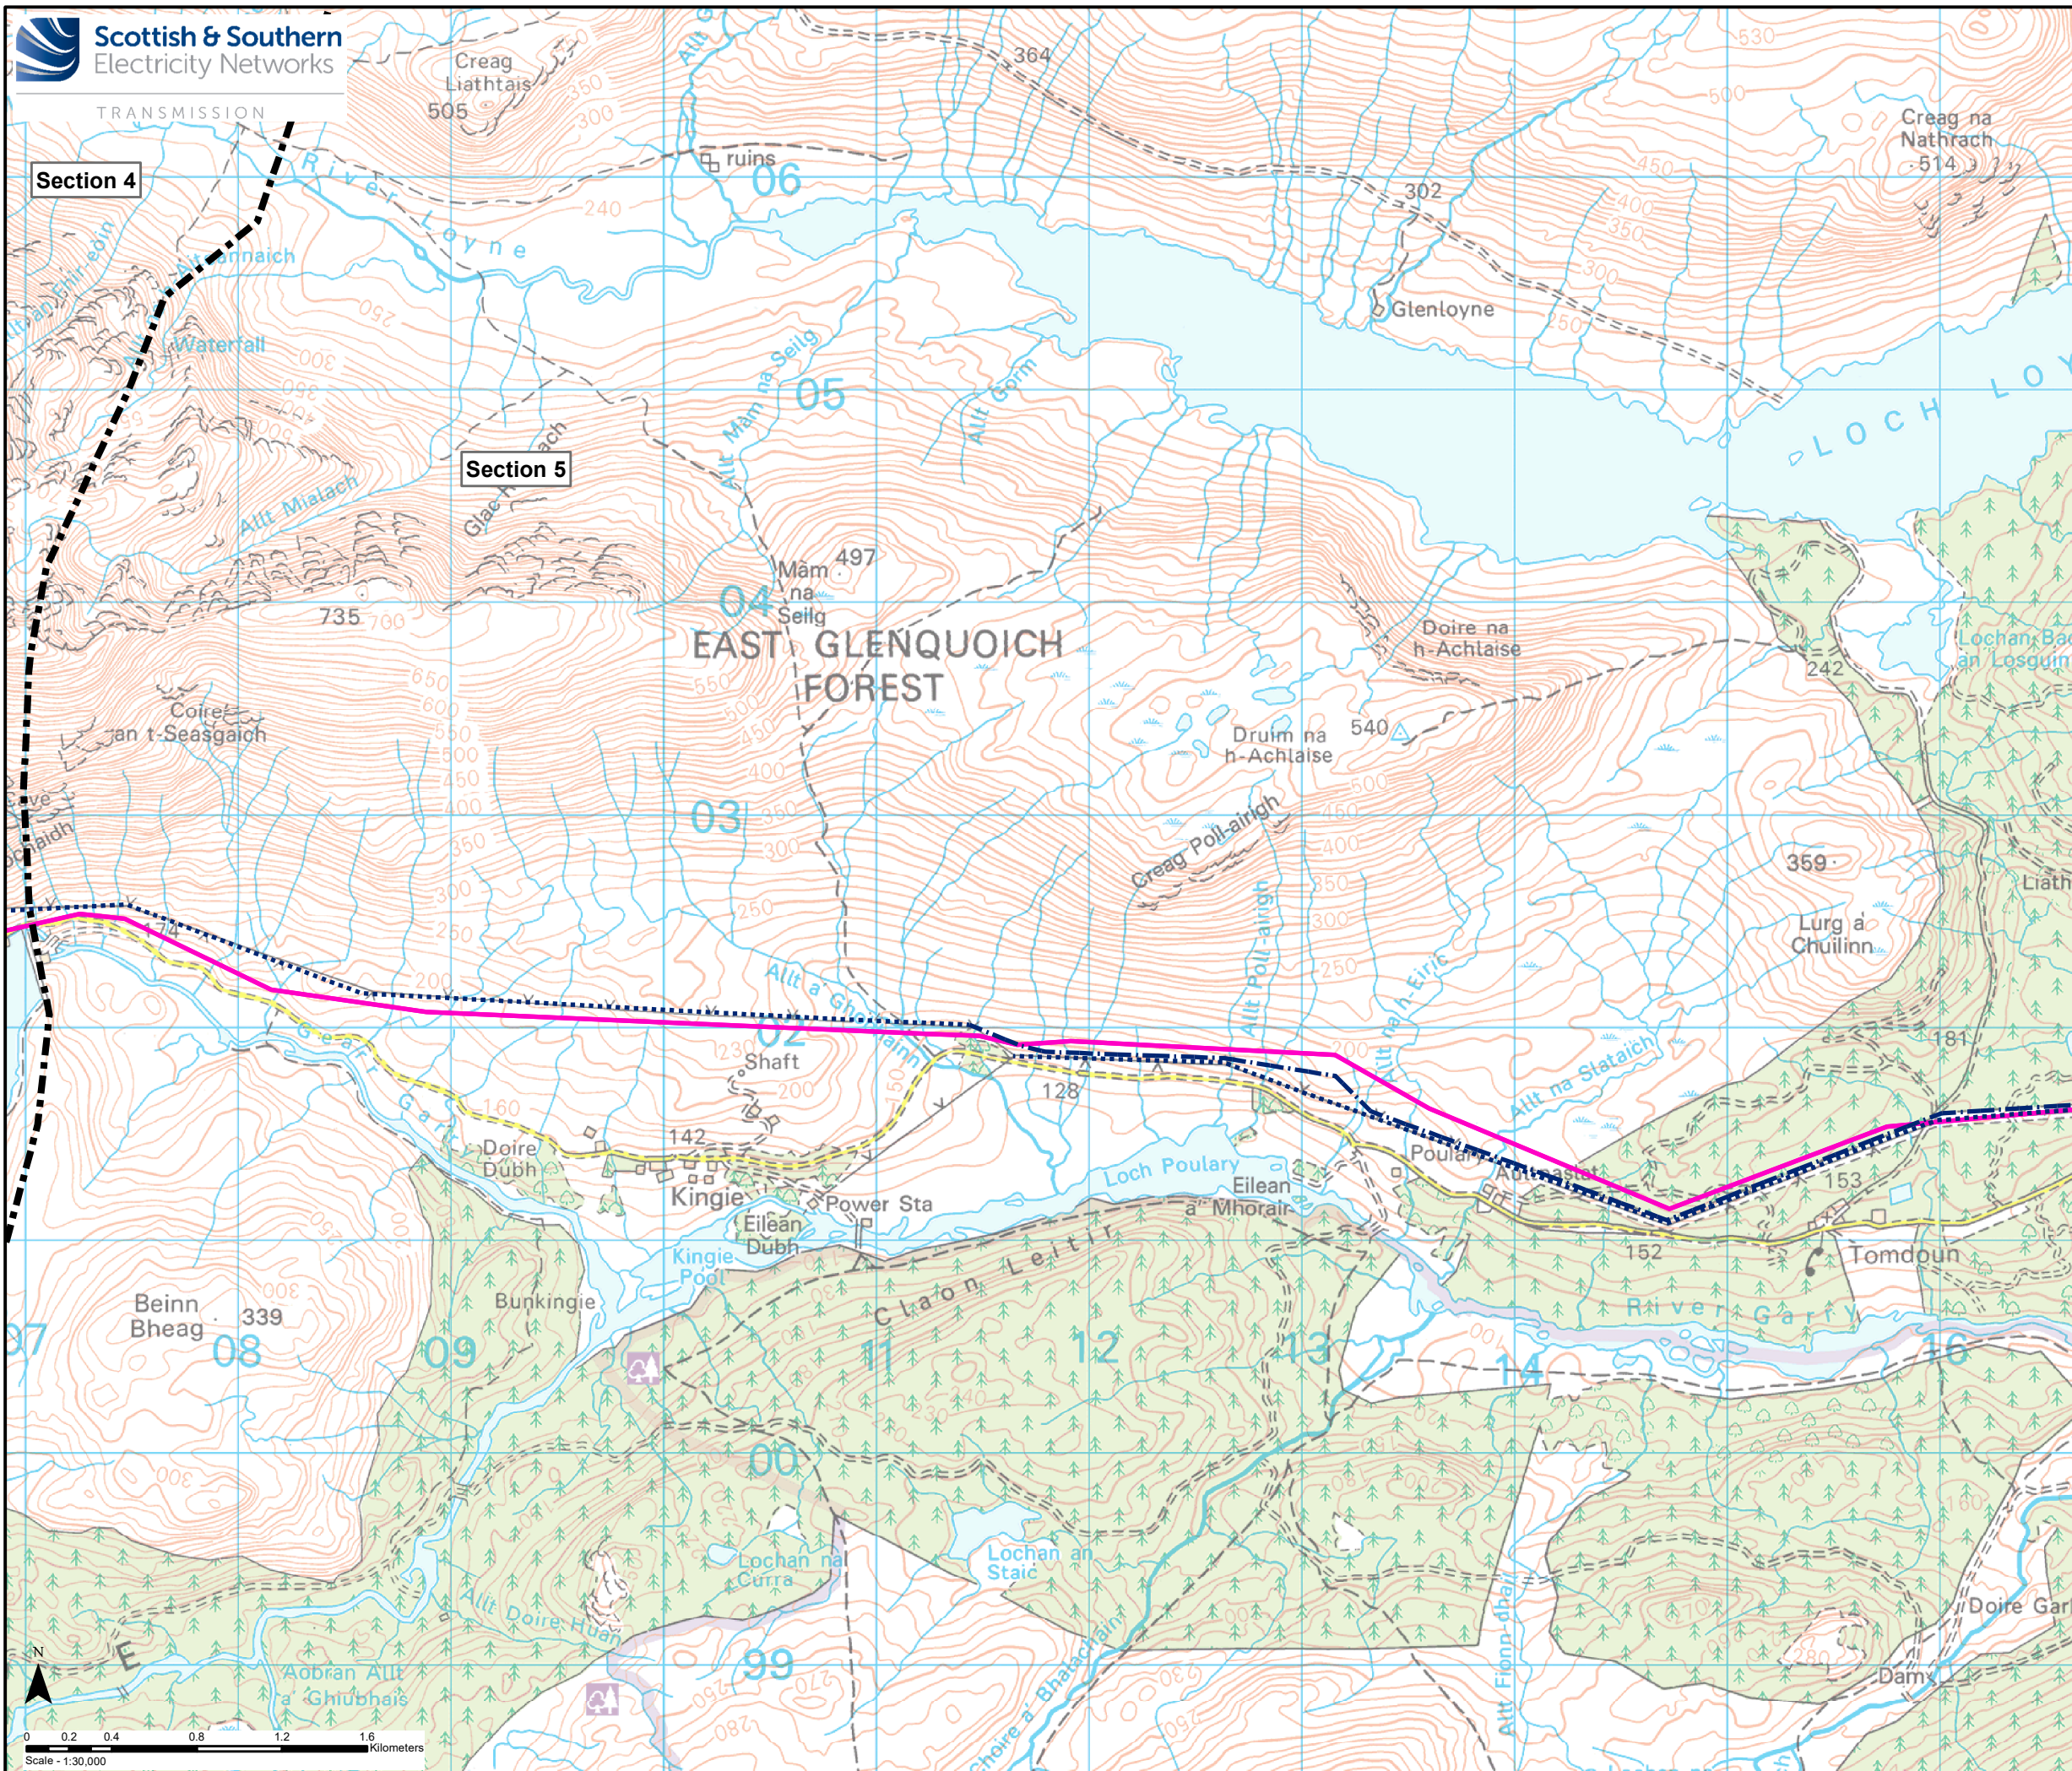


- Key**
- Section Divider
  - ..... Existing OHL to be Removed (Steel Lattice 132 kV)
  - - - Existing OHL to be Removed (Woodpole 132 kV)
  - Preferred Alignment


Reproduced by permission of Ordnance Survey on behalf of HMSO.  
Crown copyright and database right 2021 all rights reserved.  
Ordnance Survey Licence number EL273236.

Project No: LT91  
Project: Skye Reinforcement Project  
Consultation Document (Alignment)

Title: Figure 3.5a - Preferred Alignment and  
Design Solution Section 5

Drawn by: SK 20/09/2021  
Drawing: 119026-D-CD-3.5a-1.0.0

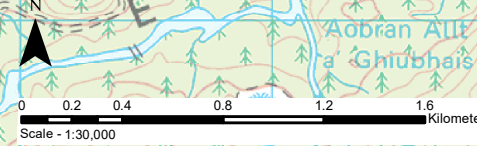

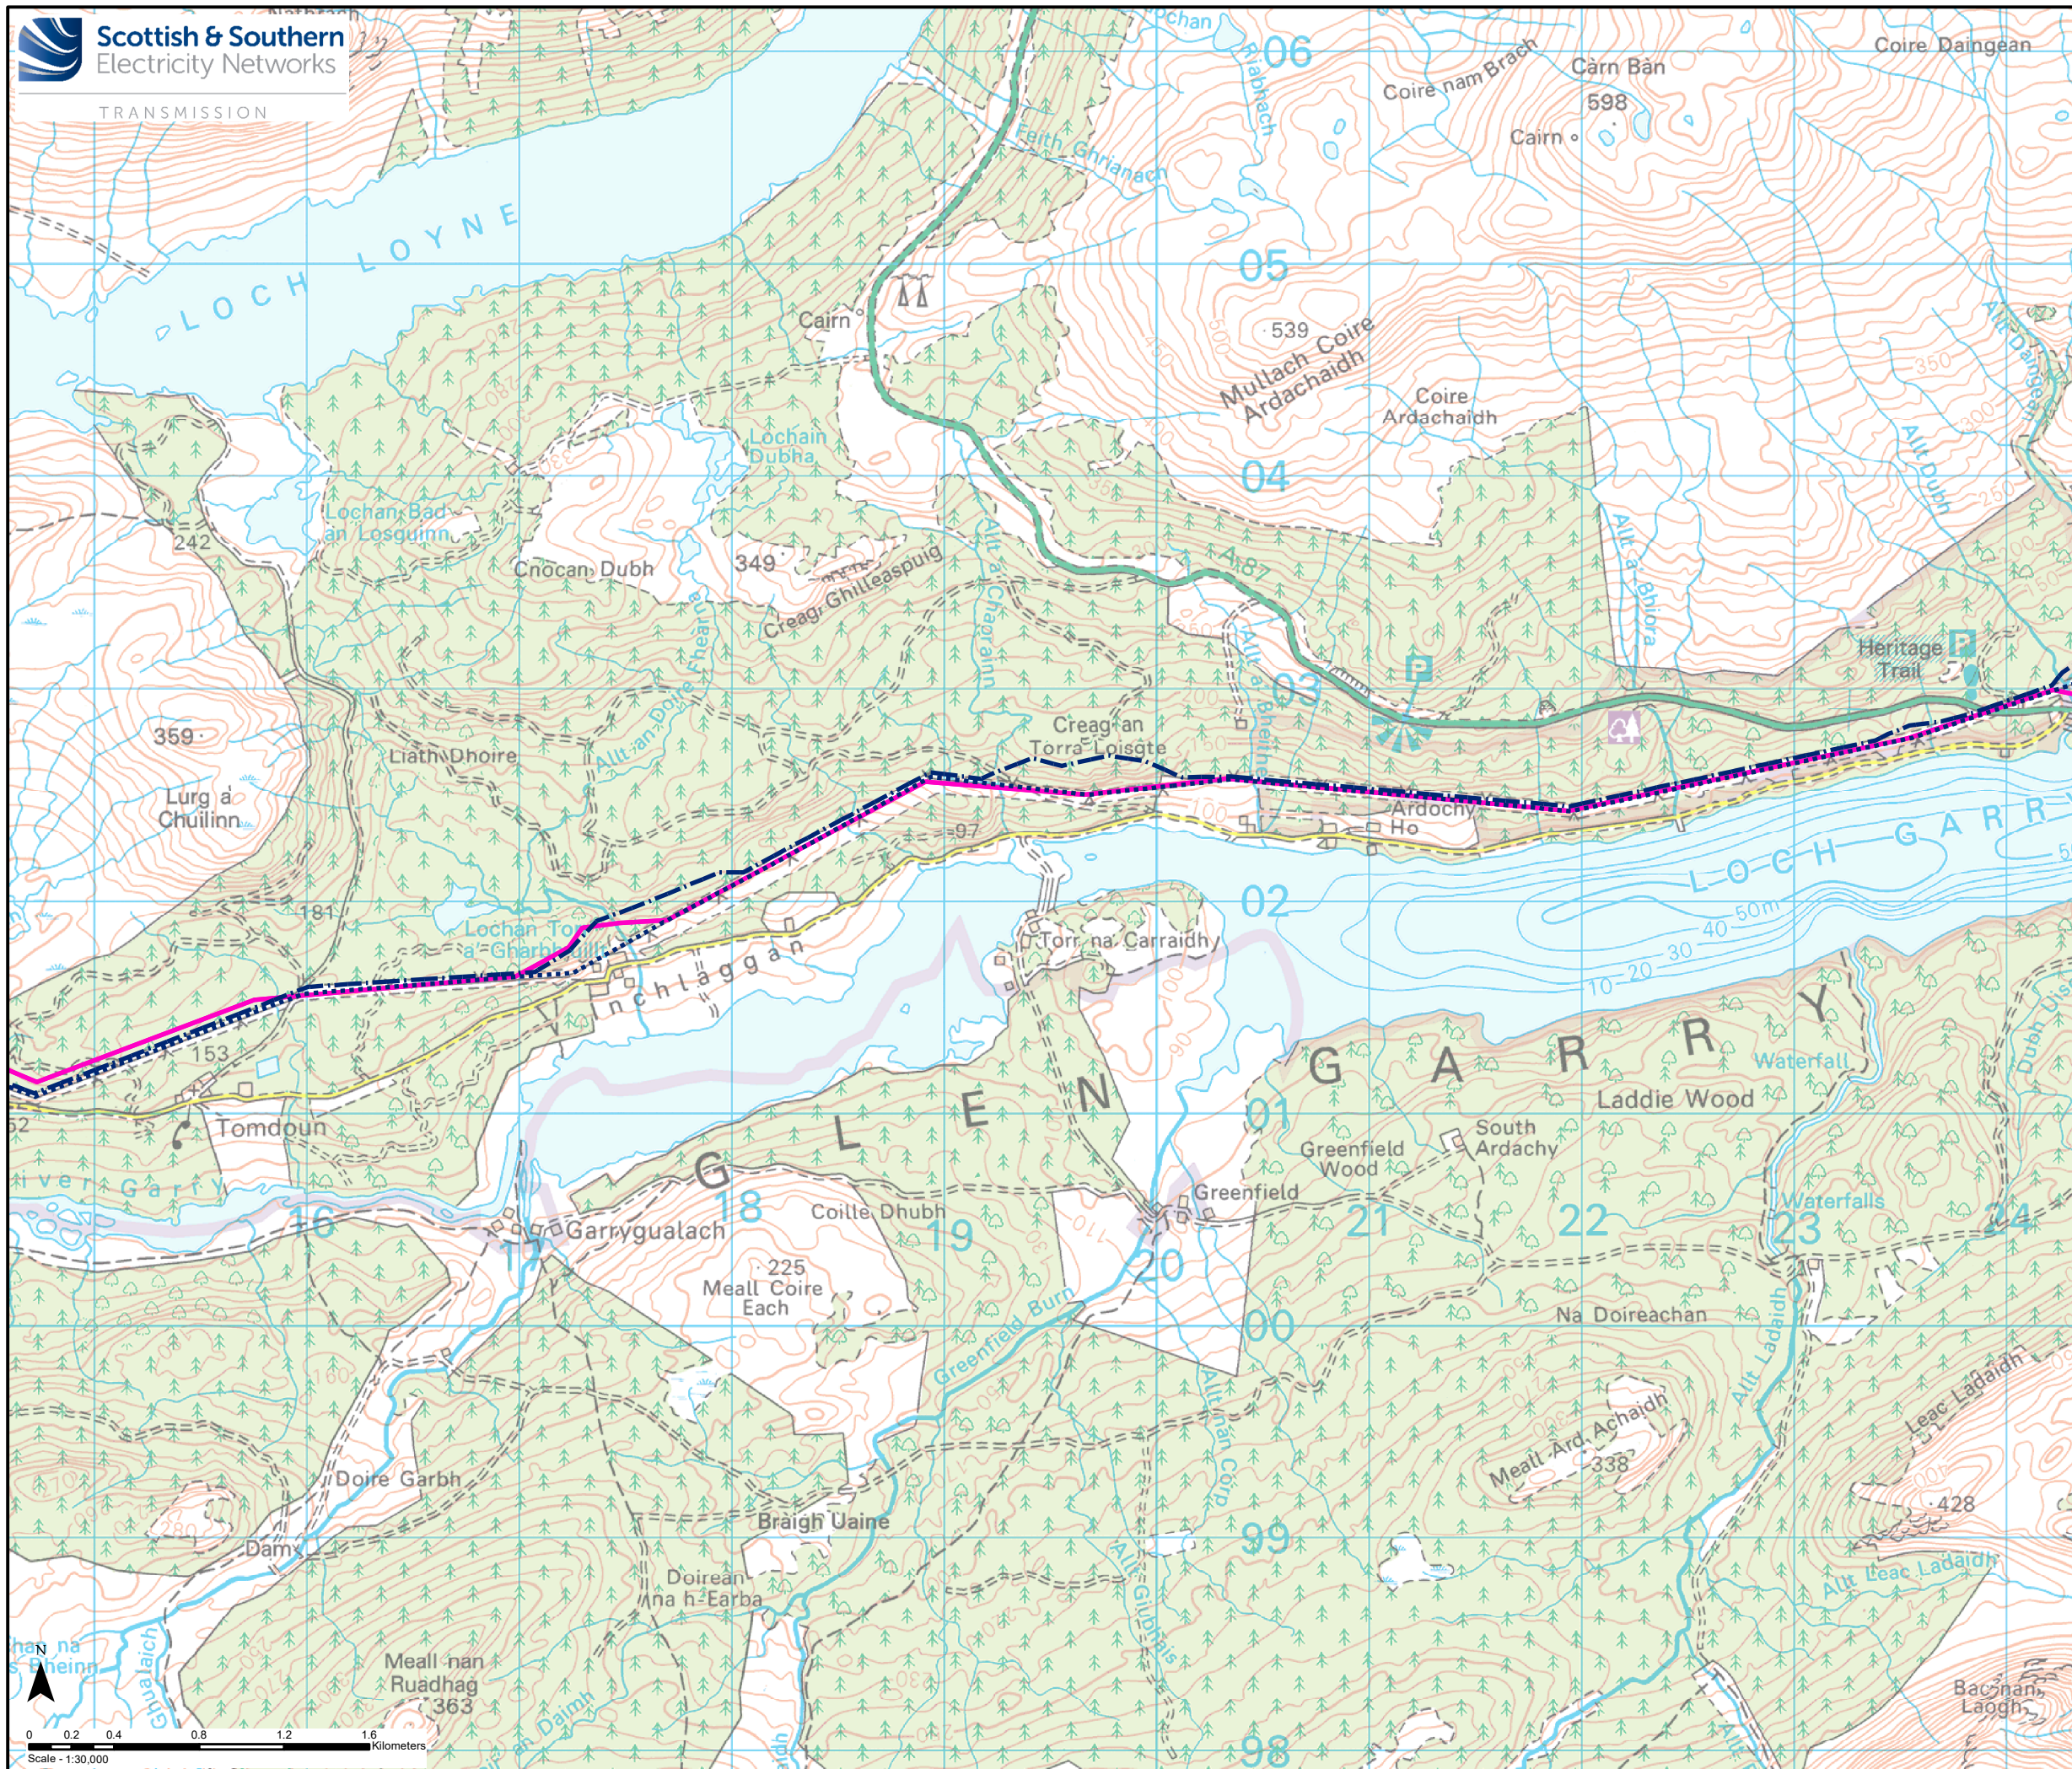

**Key**

- Section Divider
- ..... Existing OHL to be Removed (Steel Lattice 132 kV)
- - - Existing OHL to be Removed (Woodpole 132 kV)
- Preferred Alignment


Reproduced by permission of Ordnance Survey on behalf of HMSO.  
Crown copyright and database right 2021 all rights reserved.  
Ordnance Survey Licence number EL273236.

Project No: LT91  
Project: Skye Reinforcement Project  
Consultation Document (Alignment)

Title: Figure 3.5b - Preferred Alignment and  
Design Solution Section 5

Drawn by: SK 20/09/2021

Drawing: 119026-D-CD-3.5b-1.0.0

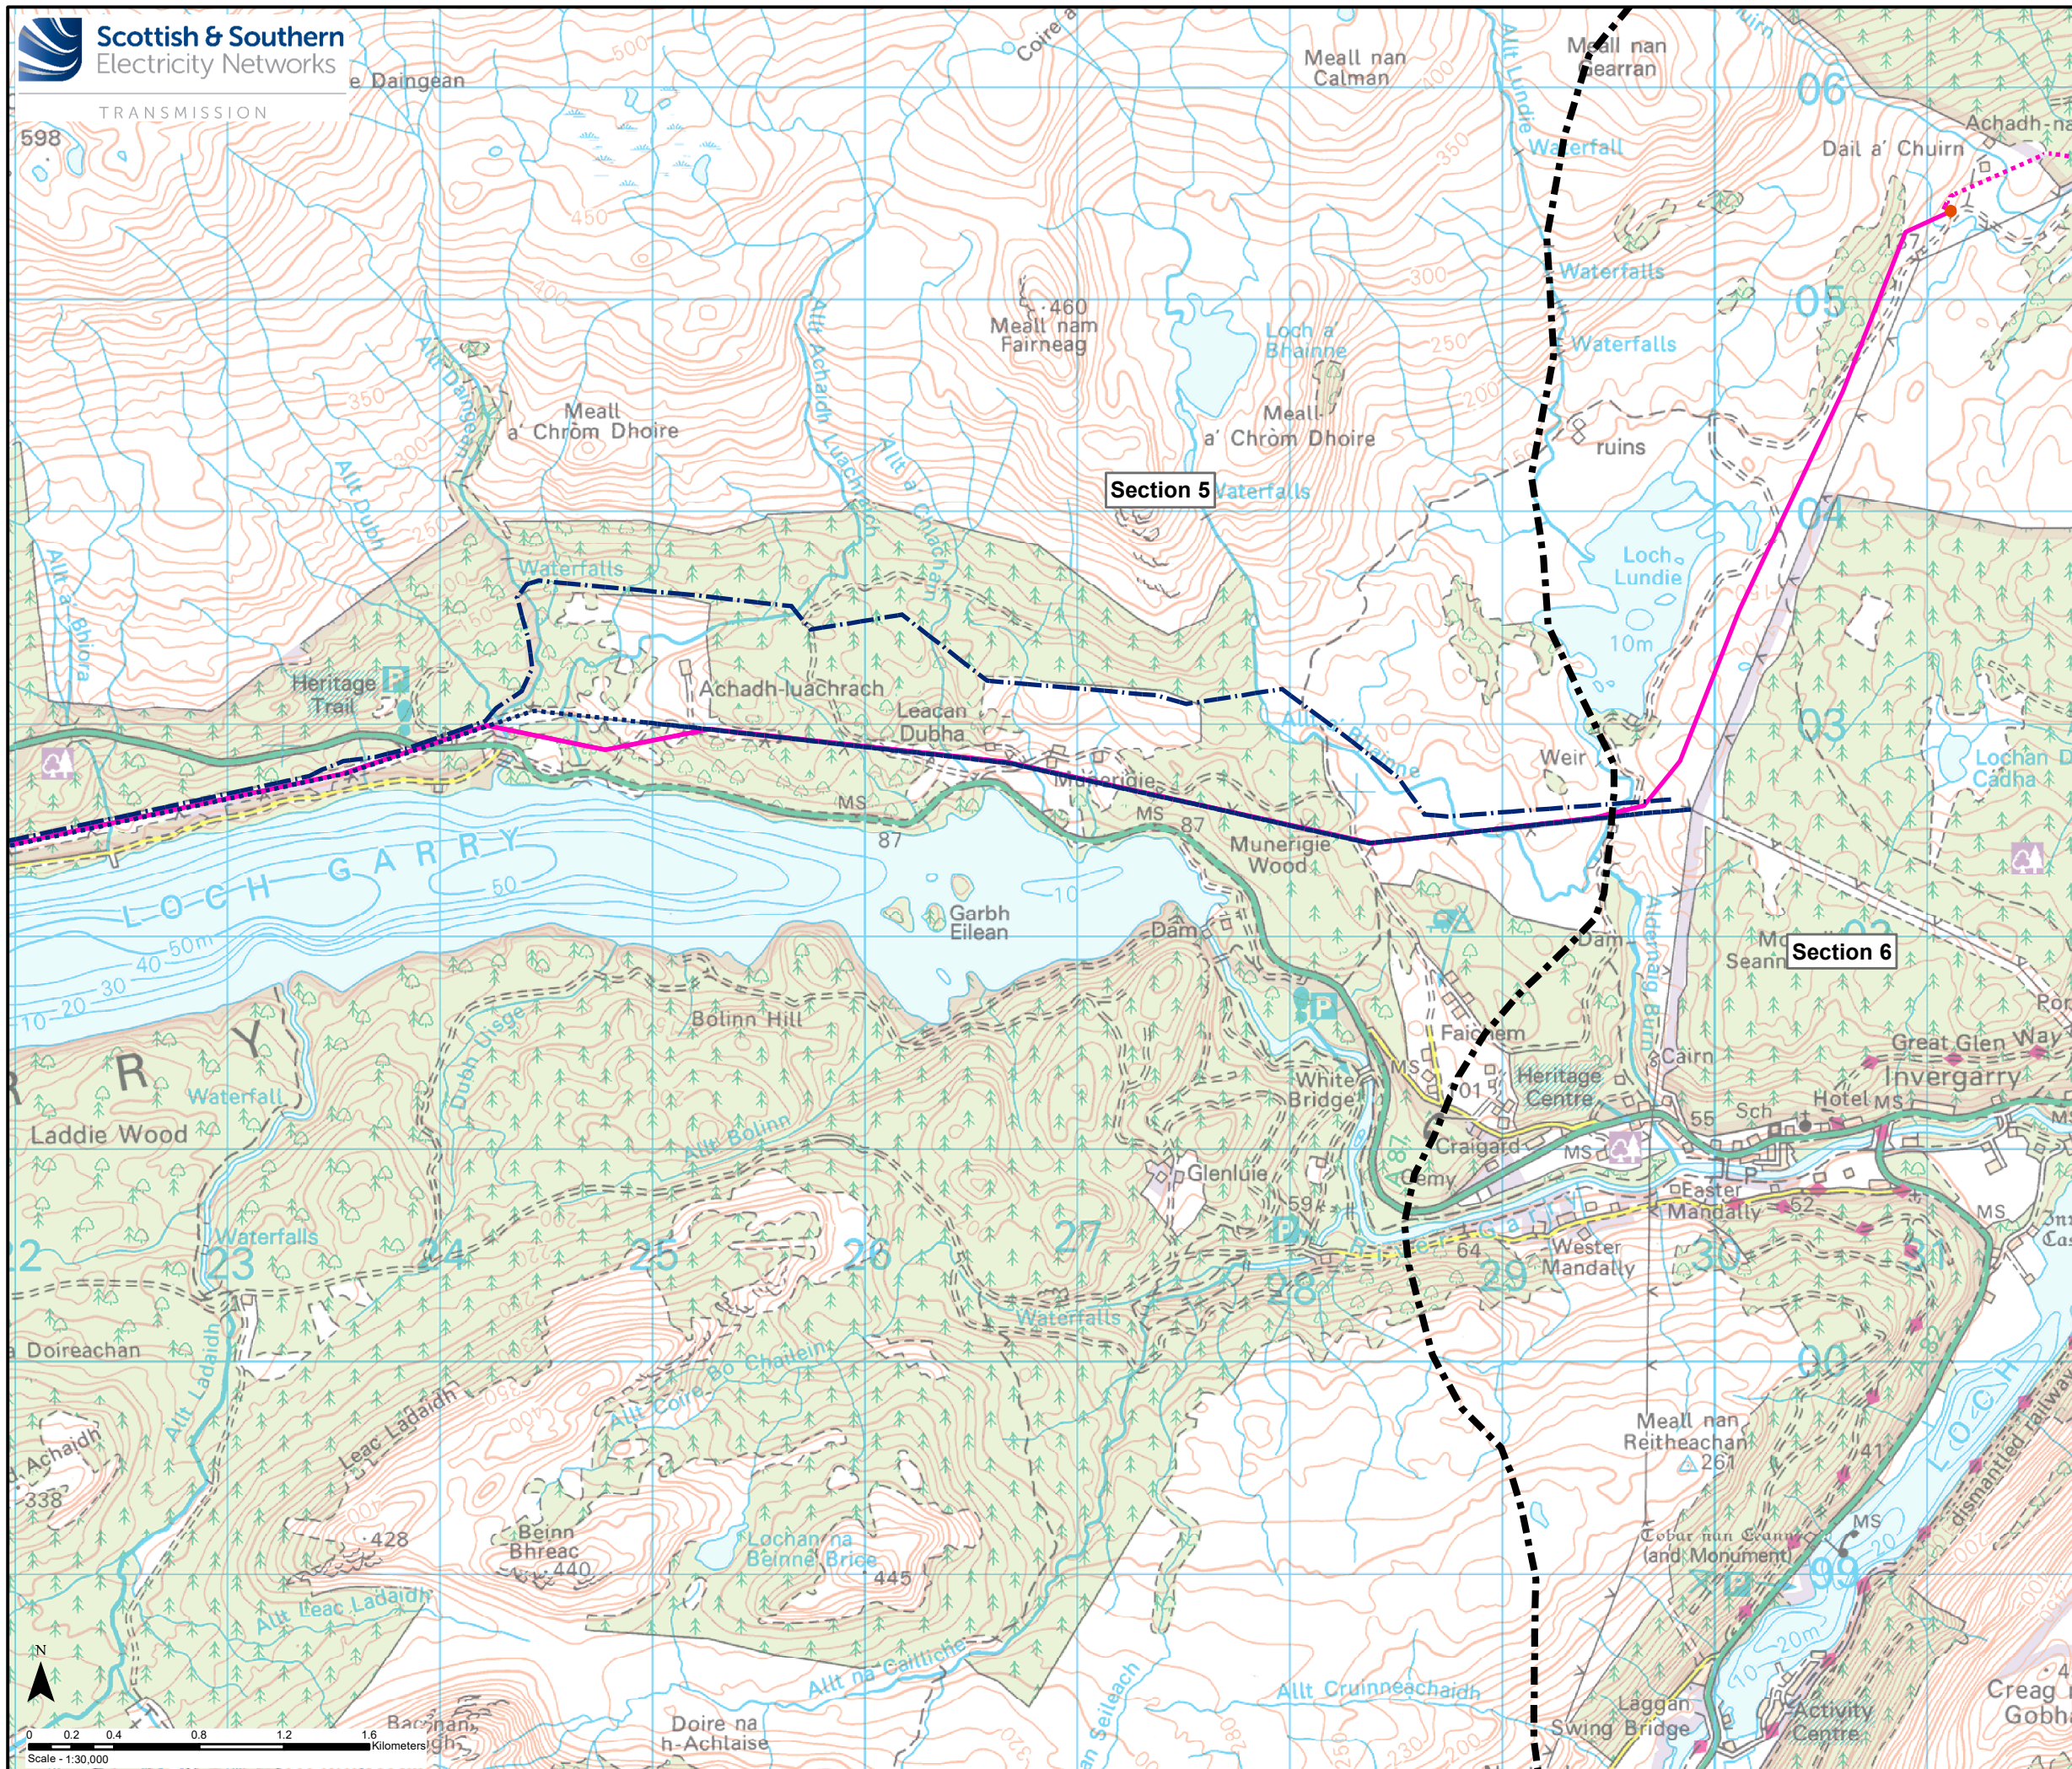

- Key**
- Section Divider
  - ... Existing OHL to be Removed (Steel Lattice 132 kV)
  - - - Existing OHL to be Removed (Woodpole 132 kV)
  - Preferred Alignment

Reproduced by permission of Ordnance Survey on behalf of HMSO.  
Crown copyright and database right 2021 all rights reserved.  
Ordnance Survey Licence number EL273236.

Project No: LT91  
Project: Skye Reinforcement Project  
Consultation Document (Alignment)

Title: Figure 3.5c - Preferred Alignment and  
Design Solution Section 5

Drawn by: SK 20/09/2021

Drawing: 119026-D-CD-3.5c-1.0.0

