


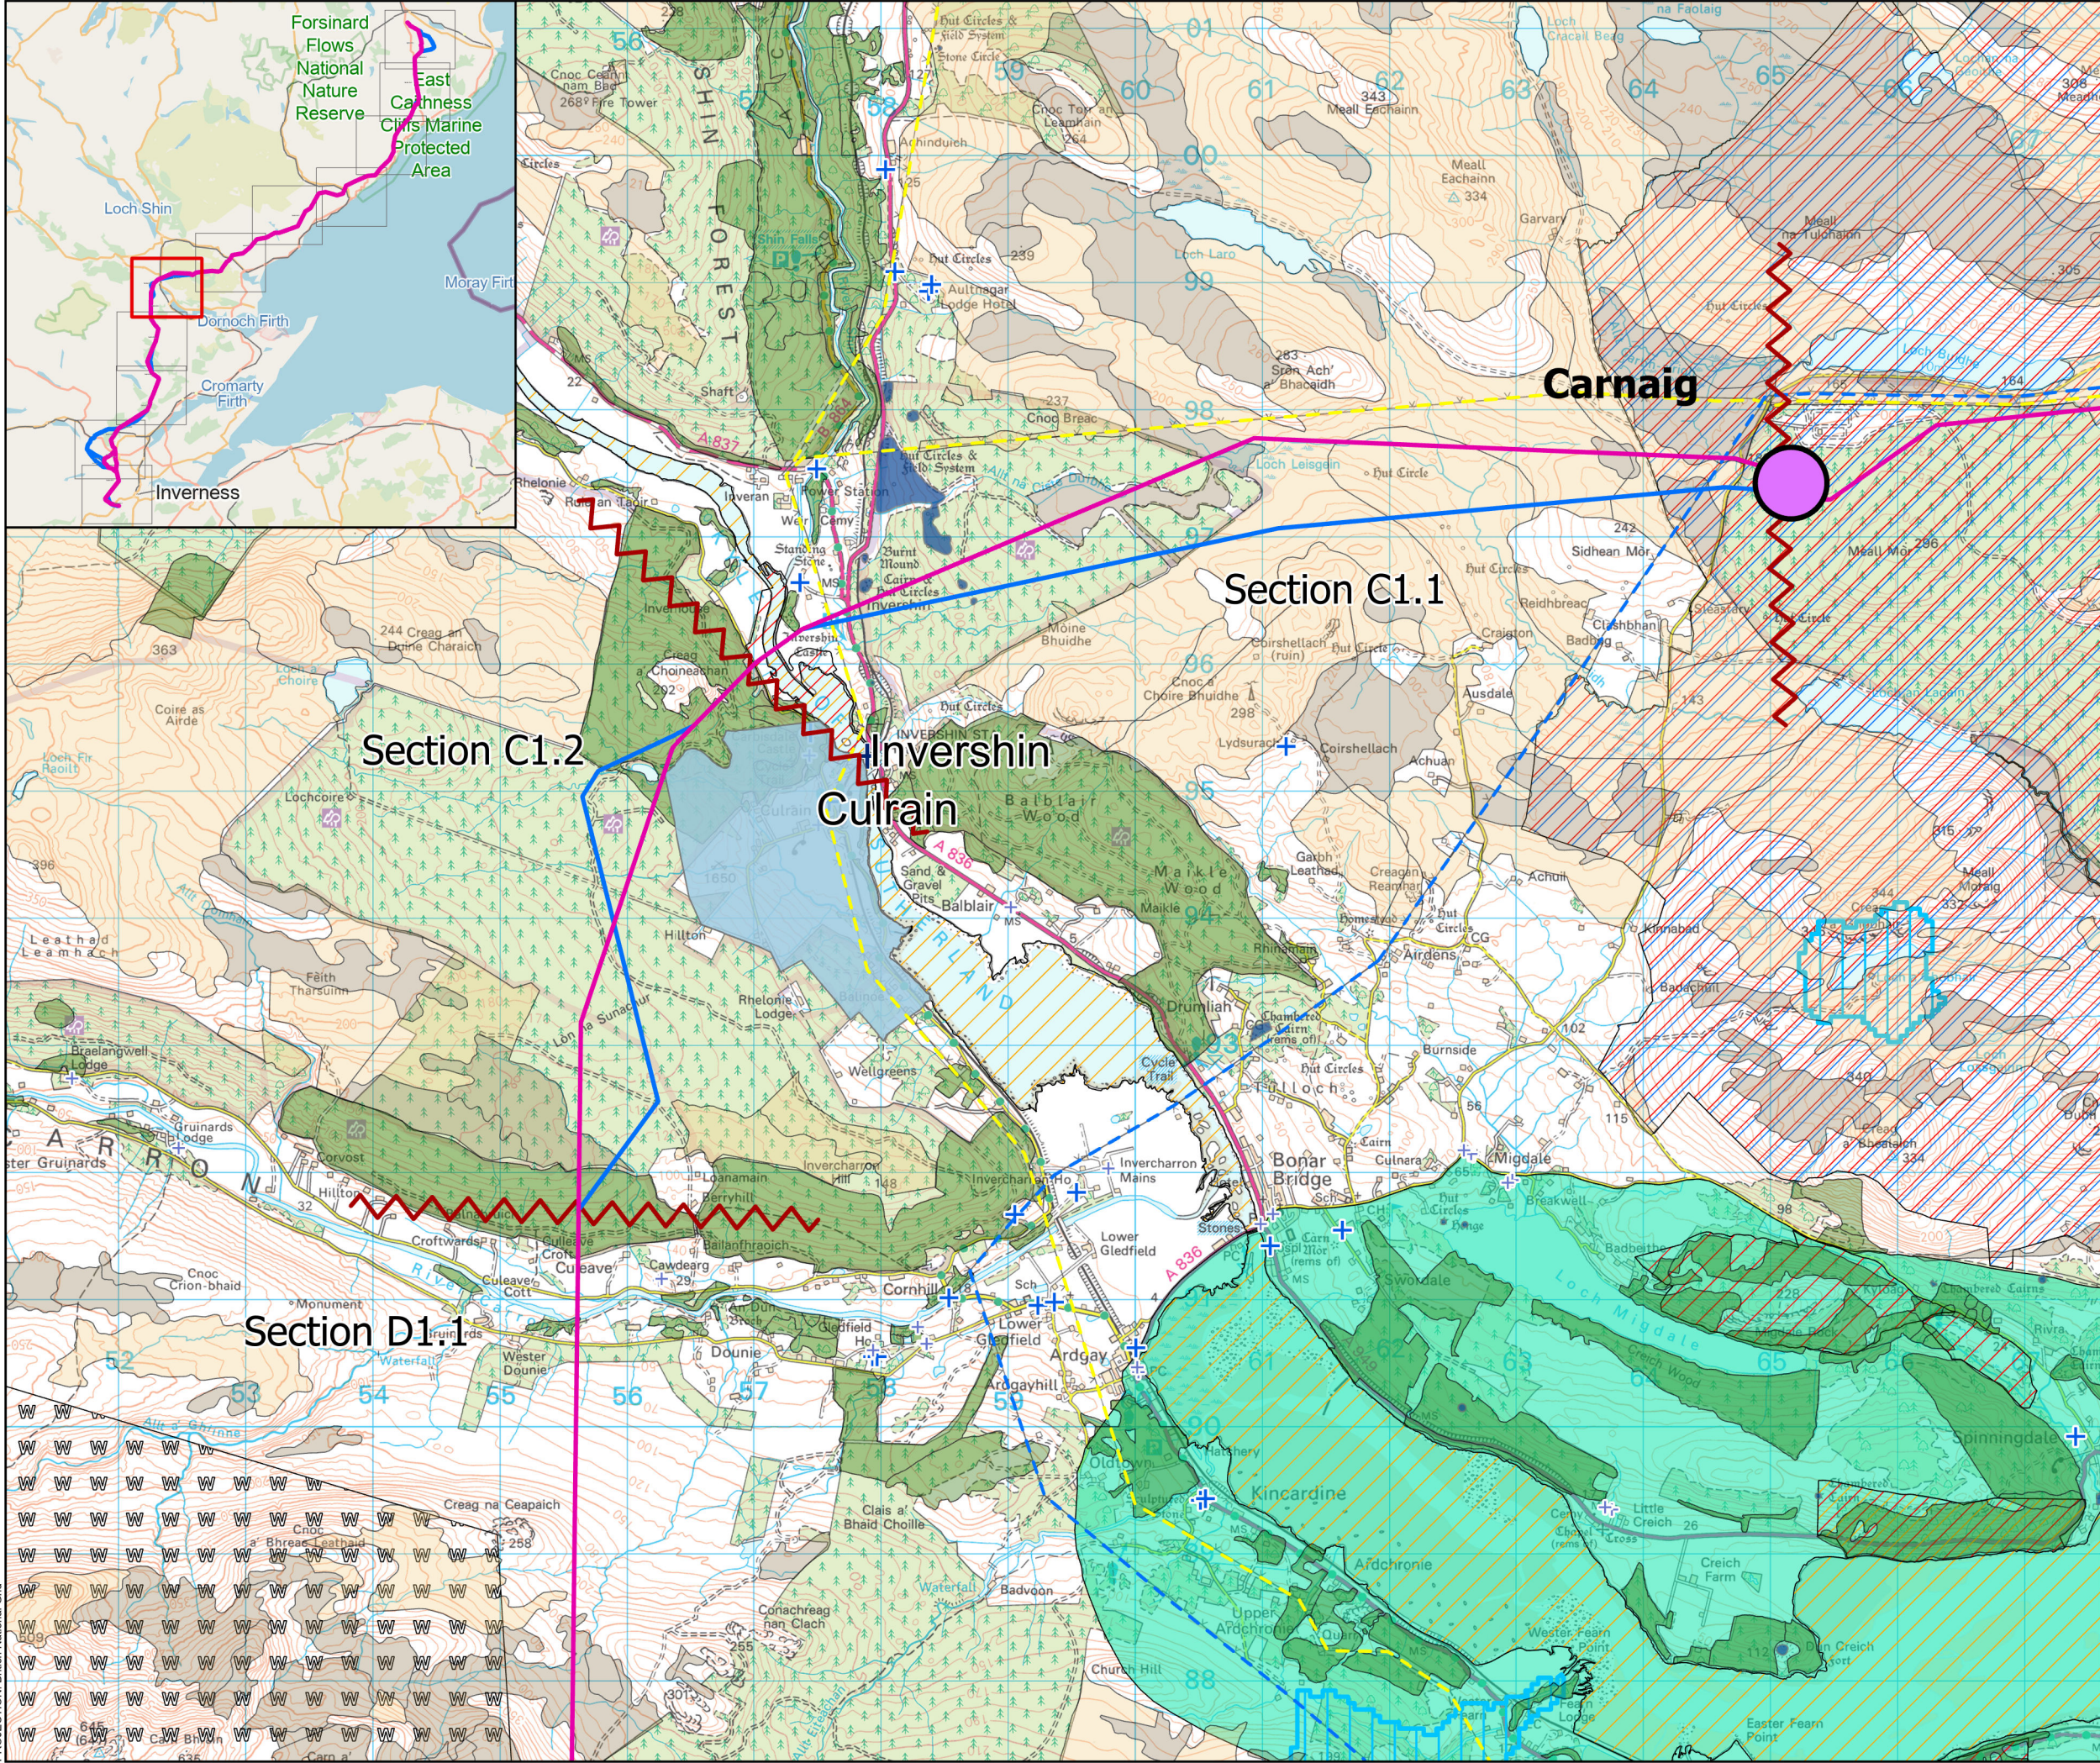

- Indicative Proposed Substation Locations
- Carnaig
- Alignment Options
- Potential
 - Alternative
 - Alignment Section Breaks
- Existing OHL
- Existing 132kV OHL
 - Existing 275kV OHL
- Heritage Constraints
- Scheduled Monument
 - Battlefield Inventory
 - Category A Listed Building
 - Category B Listed Building
 - Category C Listed Building
- Ecological Constraints
- Ancient Woodland Inventory
 - Class 1 Peat
 - Class 2 Peat
 - Drinking Water Protected Area (DWPA) Catchments
 - Site of Special Scientific Interest (SSSI)
 - Special Area of Conservation (SAC)
 - Special Protection Area (SPA)
 - National Scenic Area (NSA)
 - Wild Land

0 0.5 1 1.5 2 2.5

Kilometres

N

SCALE: See Scale Bar	VERSION: A01
SIZE: A3	DRAWN: CR
PROJECT: 0652629	CHECKED: DN
DATE: 21/05/2024	APPROVED: KG

**Spittal to Loch Buidhe to Beauly OHL
Alignment Consultation
Constraints Mapping**

TRANSMISSION