

**Development for which Section 37 consent is sought**

- Tower Location
- Alignment Section E
- Special Arrangement
- Temporary Diversion During Construction of Special Arrangement

**Ancillary Development for which deemed planning permission is sought**

- Temporary Access Track - Trackway Panel
- Temporary Access Track - Cut/Fill
- Temporary Access Track - Floating
- Permanent Access Track - Cut/Fill
- Permanent Access Track - Floating
- Existing Access Tracks - Upgrade Required
- Equipotential Zone (EPZ) (Pulling Position)
- Temporary Tower Compound Area - SOUTH

**Limit of Deviation**

- Limit of Deviation (LoD)


0 0.3 0.5 0.8 1  
Kilometres

N

SCALE: See Scale Bar	VERSION: A01
SIZE: A3	DRAWN: CI
PROJECT: 0652629	CHECKED: BMG
DATE: 12/08/2025	APPROVED: KG

**Figure 3.1 - 28**  
**Spittal - Loch Buidhe - Beauly 400 kV OHL**  
**Connection**  
**Project Description**



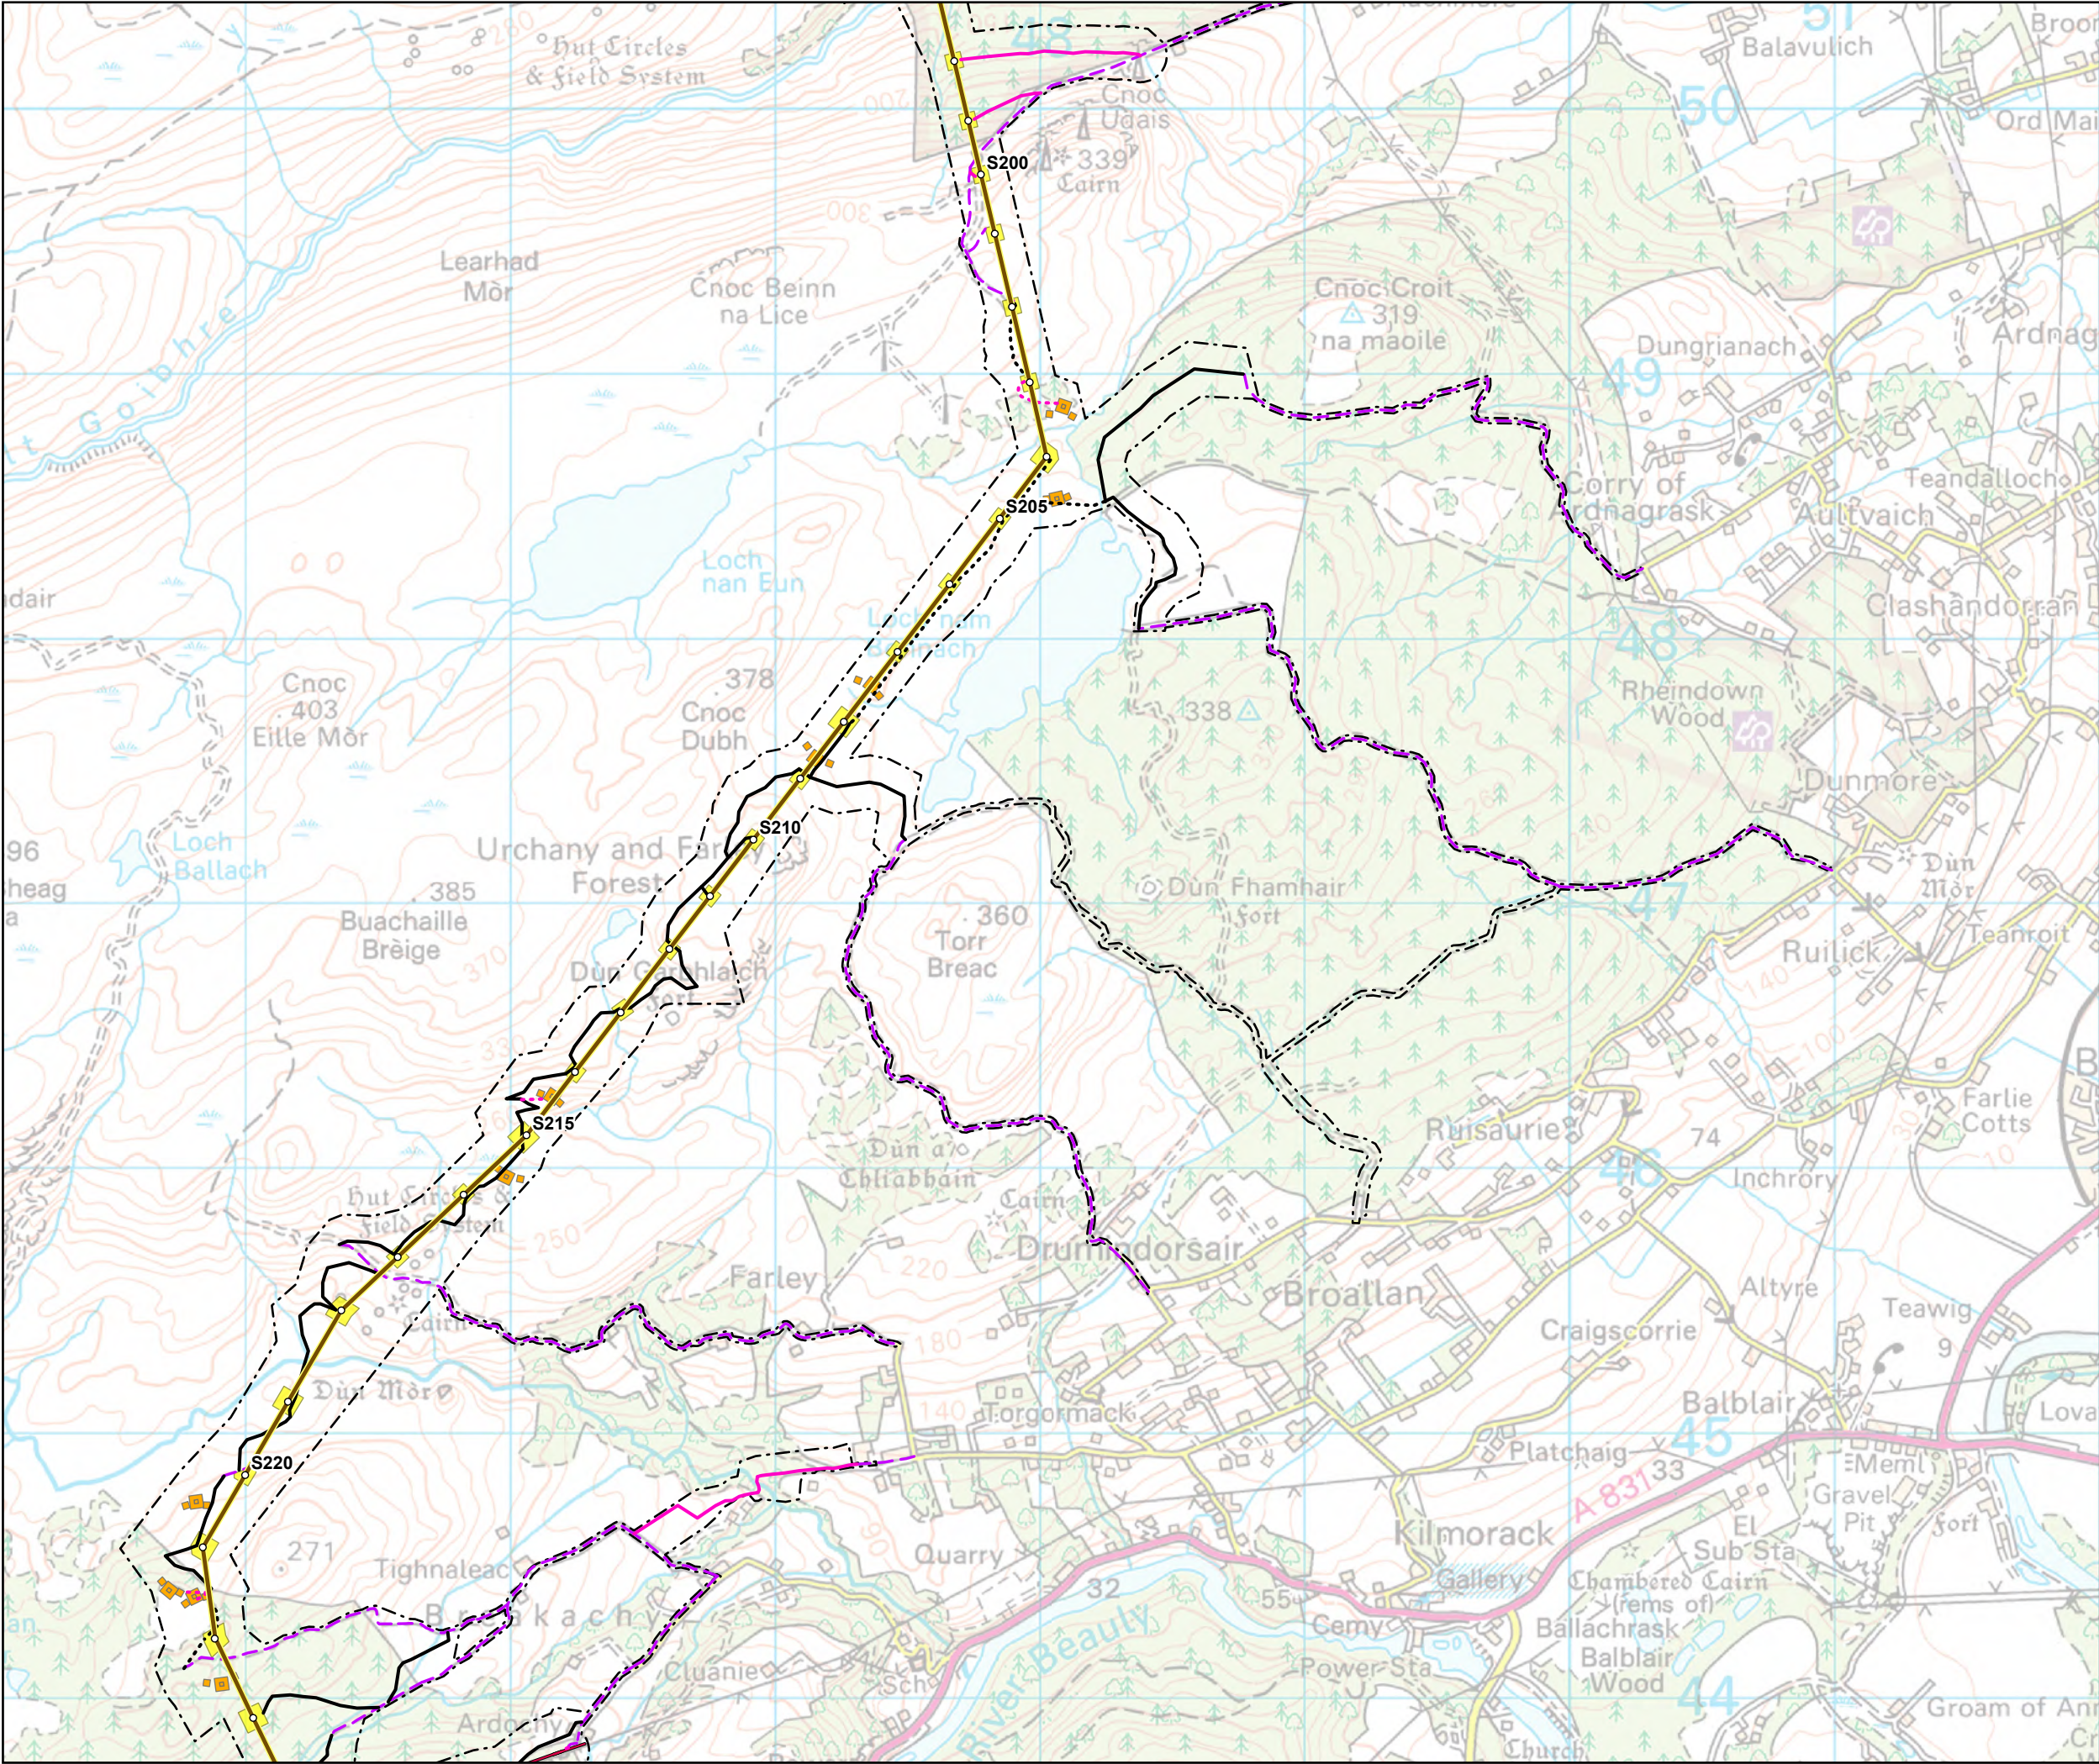

**Development for which Section 37 consent is sought**


- Tower Location
- Alignment Section E
- Special Arrangement

**Ancillary Development for which deemed planning permission is sought**

- Temporary Access Track - Cut/Fill
- Temporary Access Track - Floating
- Permanent Access Track - Cut/Fill
- Permanent Access Track - Floating
- Existing Access Tracks - Upgrade Required
- Equipotential Zone (EPZ) (Pulling Position)
- Temporary Tower Compound Area - SOUTH

**Limit of Deviation**

- Limit of Deviation (LoD)




SCALE: See Scale Bar  
SIZE: A3  
PROJECT: 0652629  
DATE: 11/08/2025

VERSION: A01  
DRAWN: CI  
CHECKED: BMG  
APPROVED: KG

**Figure 3.1 - 29**  
**Spittal - Loch Buidhe - Beaulie 400 kV OHL**  
**Connection**  
**Project Description**





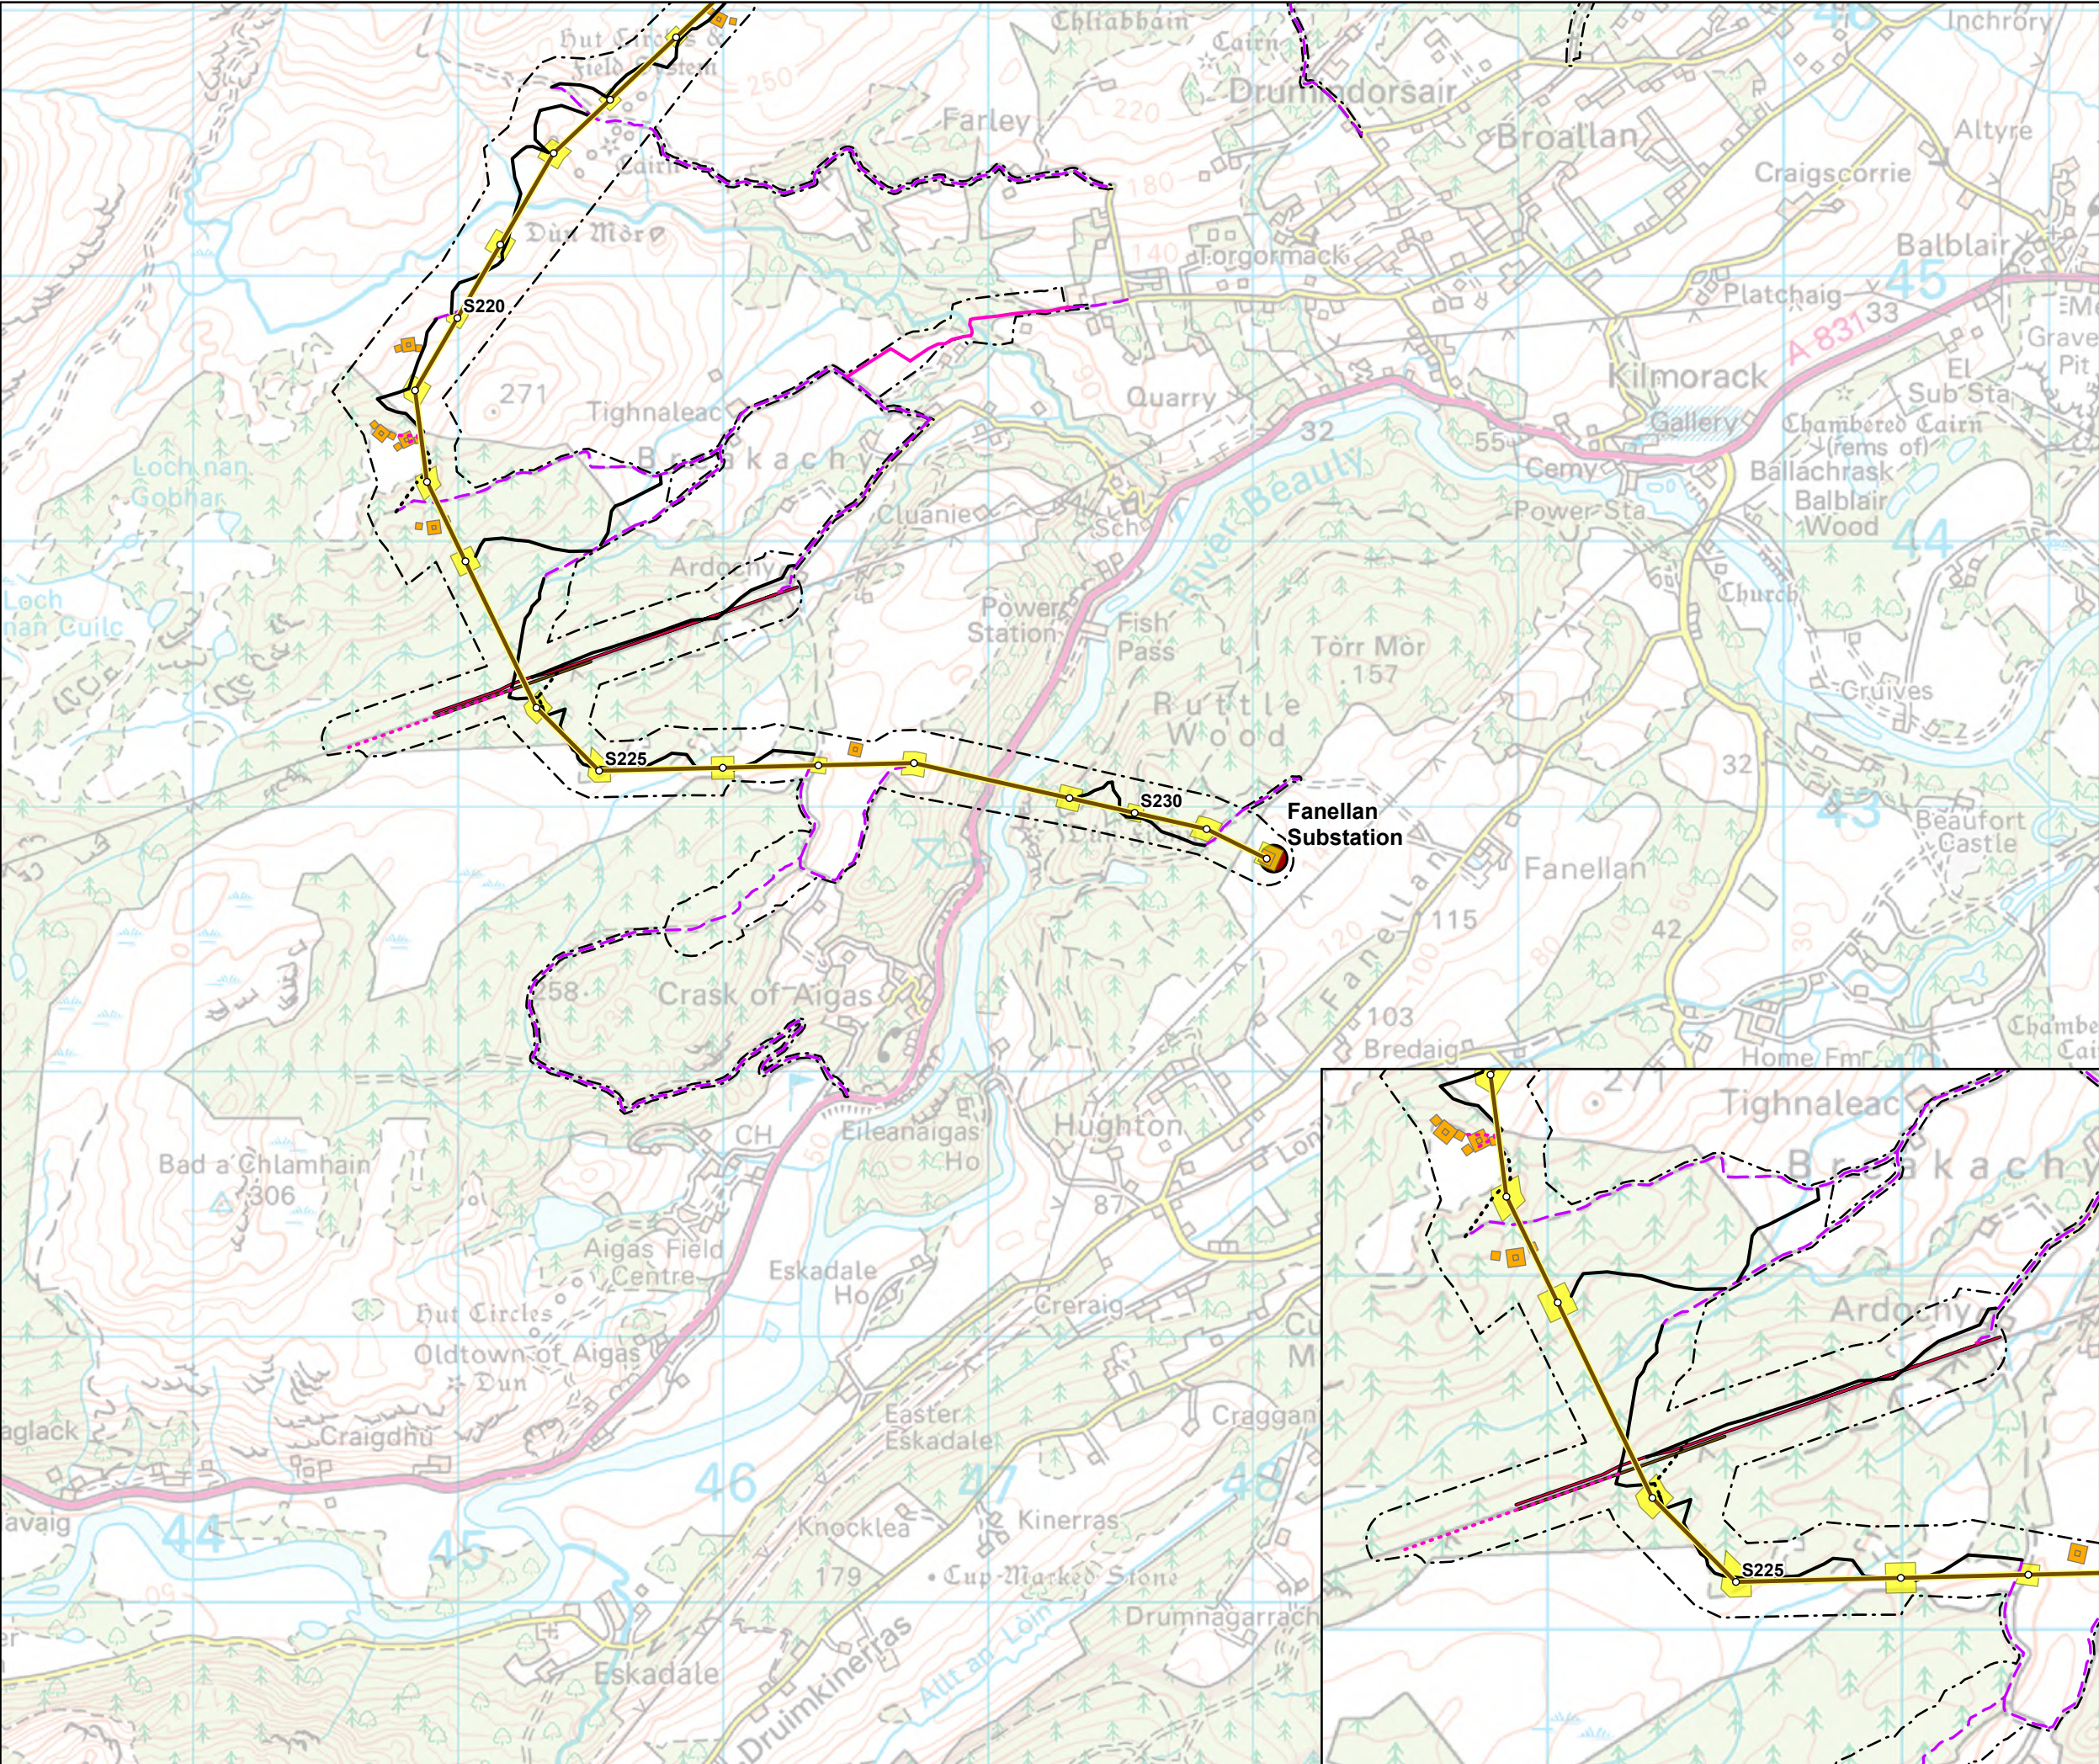

**Development for which Section 37 consent is sought**

- Tower Location
- Alignment Section E
- Special Arrangement
- Temporary Diversion During Construction of Special Arrangement

**Ancillary Development for which deemed planning permission is sought**


- Temporary Access Track - Cut/Fill
- Temporary Access Track - Floating
- Permanent Access Track - Cut/Fill
- Permanent Access Track - Floating
- Existing Access Tracks - Upgrade Required
- Equipotential Zone (EPZ) (Pulling Position)
- Temporary Tower Compound Area - SOUTH

**Other**

- Proposed Substation

**Limit of Deviation**

- Limit of Deviation (LoD)



SCALE: See Scale Bar  
SIZE: A3  
PROJECT: 0652629  
DATE: 12/08/2025

VERSION: A01  
DRAWN: CI  
CHECKED: BMG  
APPROVED: KG

**Figure 3.1 - 30**  
**Spittal - Loch Buidhe - Beaulie 400 kV OHL**  
**Connection**  
**Project Description**

