



Potential and Alternative Alignment Options

- Potential
- Alternative
- Alignment Sub-Section Break
- Existing OHL
 - Existing 132kV OHL
 - Existing 275kV OHL
- Substation



SCALE: See Scale Bar	VERSION: A01
SIZE: A3	DRAWN: CR
PROJECT: 0720281	CHECKED: BM
DATE: 07/08/2025	APPROVED: KG

Figure 4.3 - 9
Spittal - Loch Buidhe - Beauly 400 kV OHL
Connection
Potential and Alternative Alignments

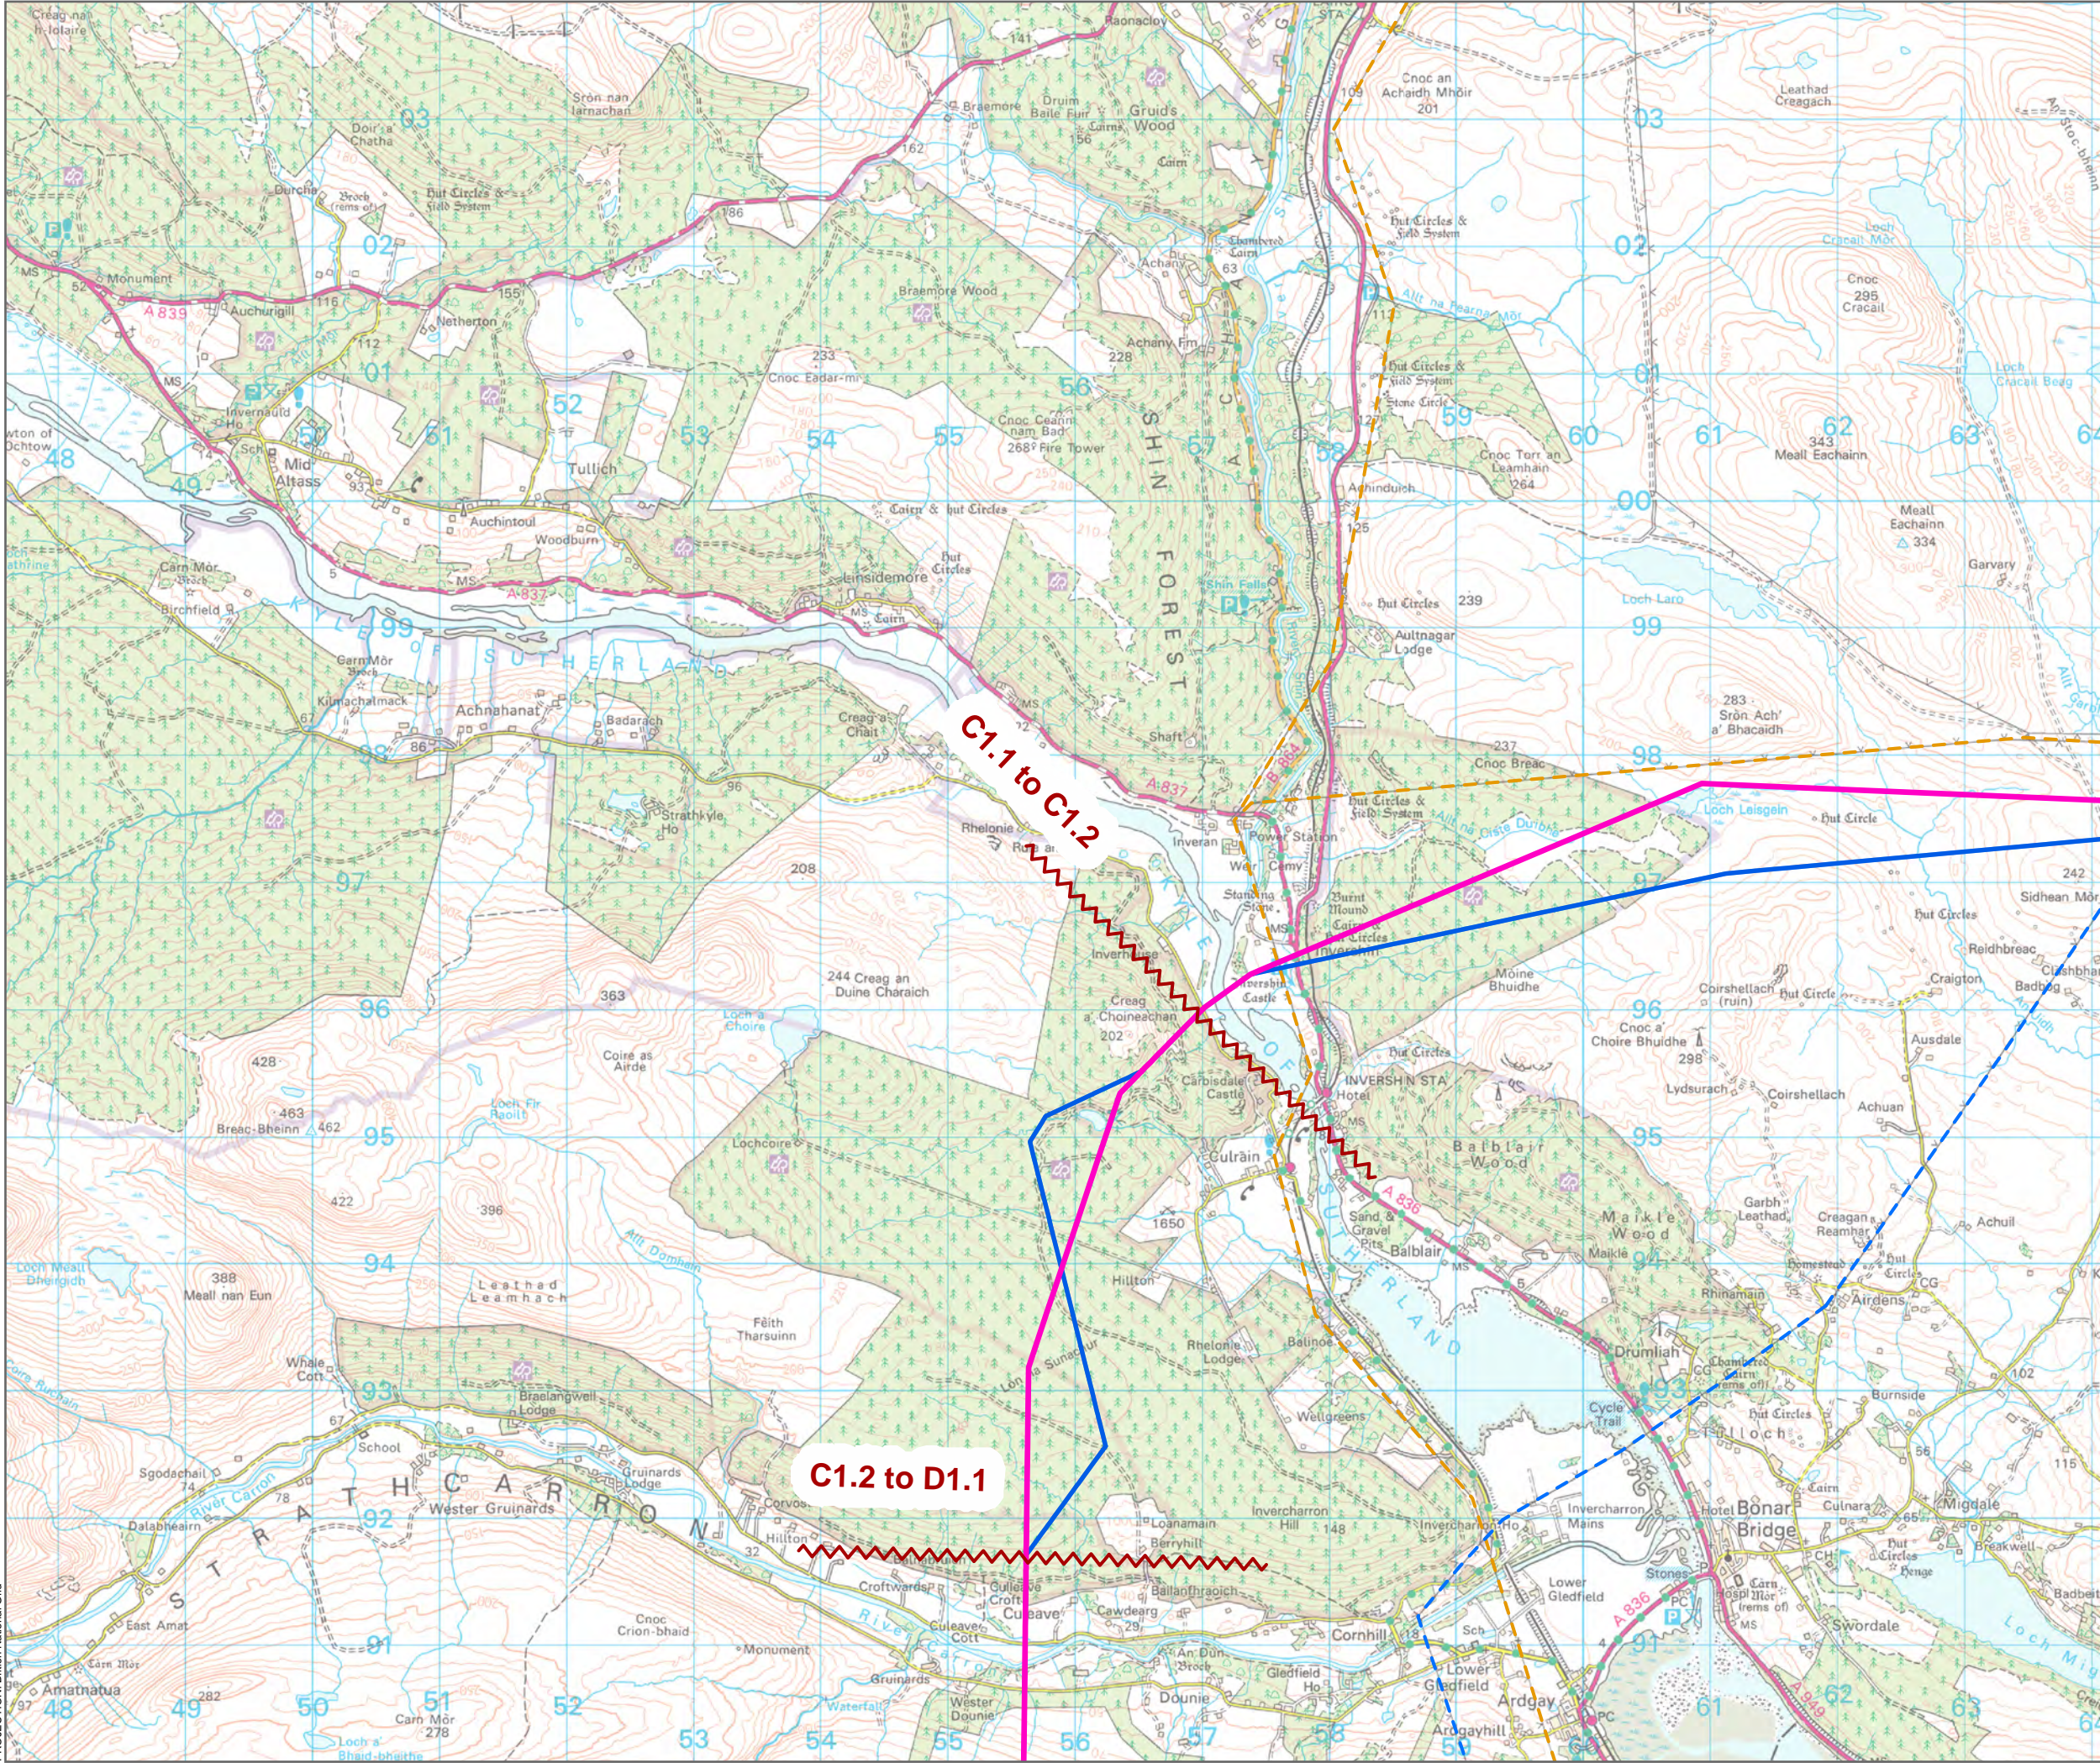

Potential and Alternative Alignment Options

- Potential
- Alternative
- Alignment Sub-Section Break

Existing OHL


- Existing 132kV OHL
- Existing 275kV OHL

0 0.5 1 1.5 2 2.5

Kilometres

SCALE: See Scale Bar	VERSION: A01
SIZE: A3	DRAWN: CR
PROJECT: 0720281	CHECKED: BM
DATE: 07/08/2025	APPROVED: KG

Figure 4.3 - 10
Spittal - Loch Buidhe - Beaulieu 400 kV OHL
Connection
Potential and Alternative Alignments

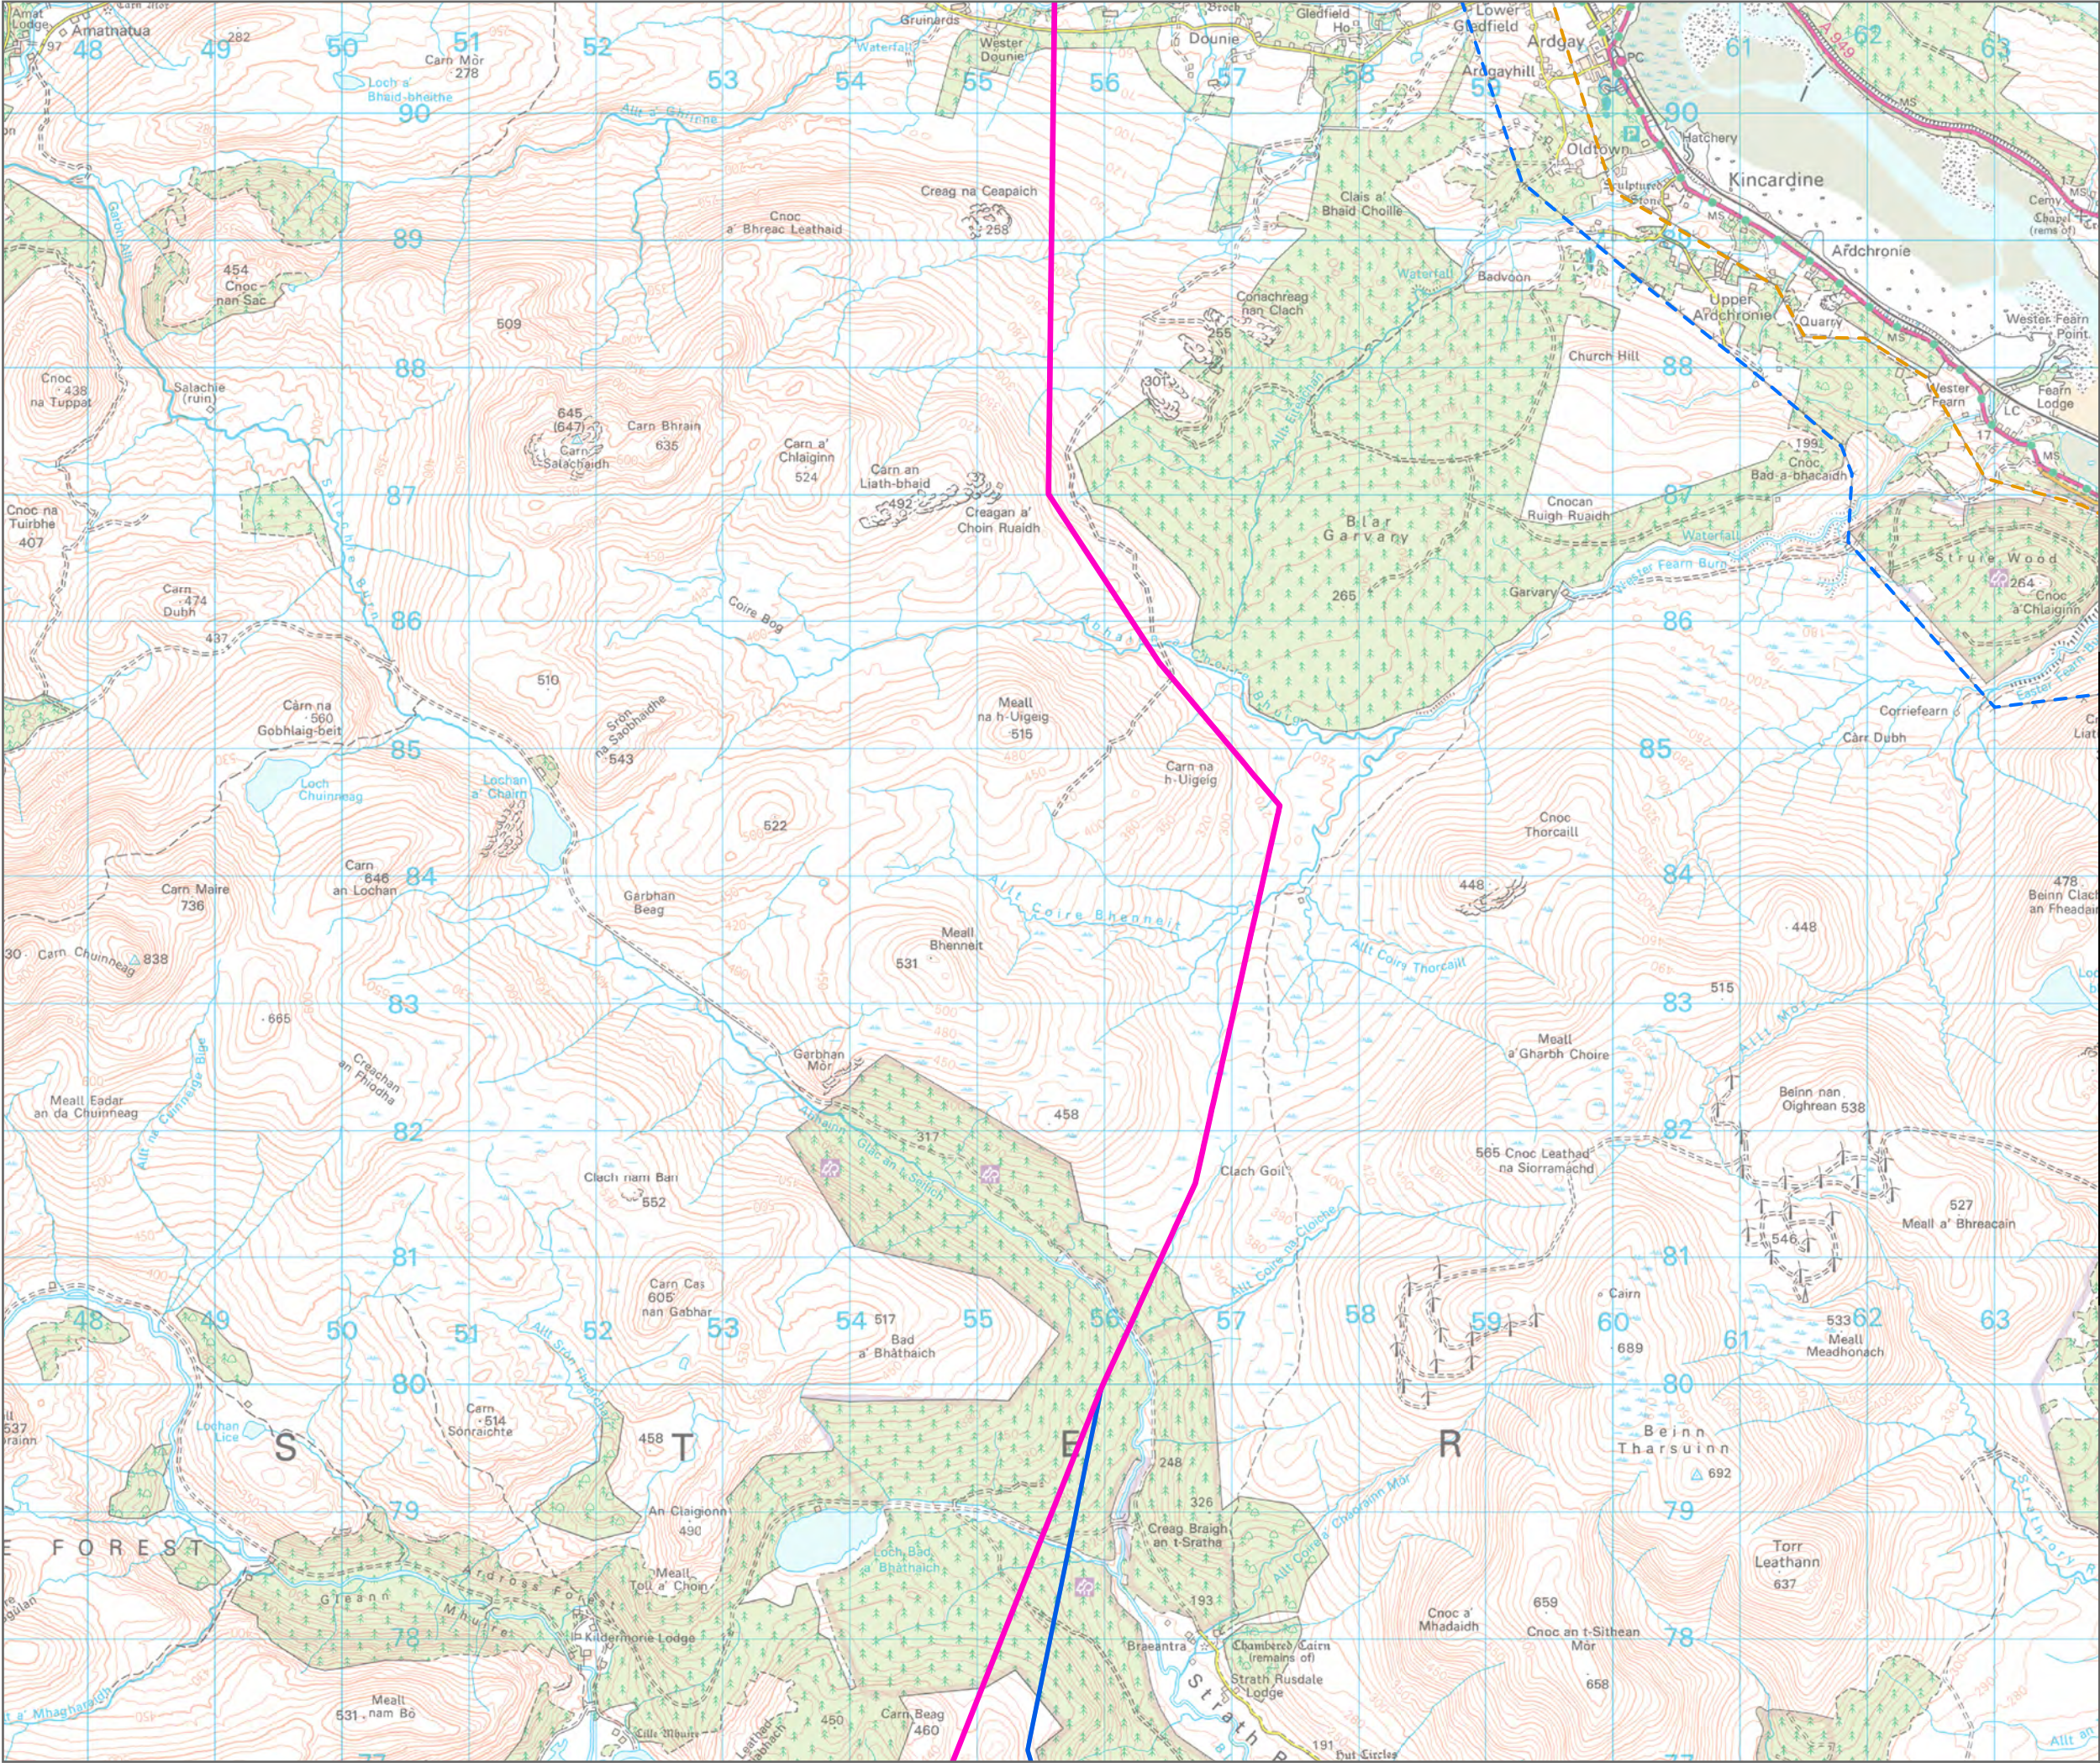

Potential and Alternative Alignment Options

- Potential
- Alternative

Existing OHL

- Existing 132kV OHL
- Existing 275kV OHL


0 0.5 1 1.5 2 2.5

Kilometres

N

SCALE: See Scale Bar	VERSION: A01
SIZE: A3	DRAWN: CR
PROJECT: 0720281	CHECKED: BM
DATE: 07/08/2025	APPROVED: KG

Figure 4.3 - 11
Spittal - Loch Buidhe - Beauly 400 kV OHL
Connection
Potential and Alternative Alignments

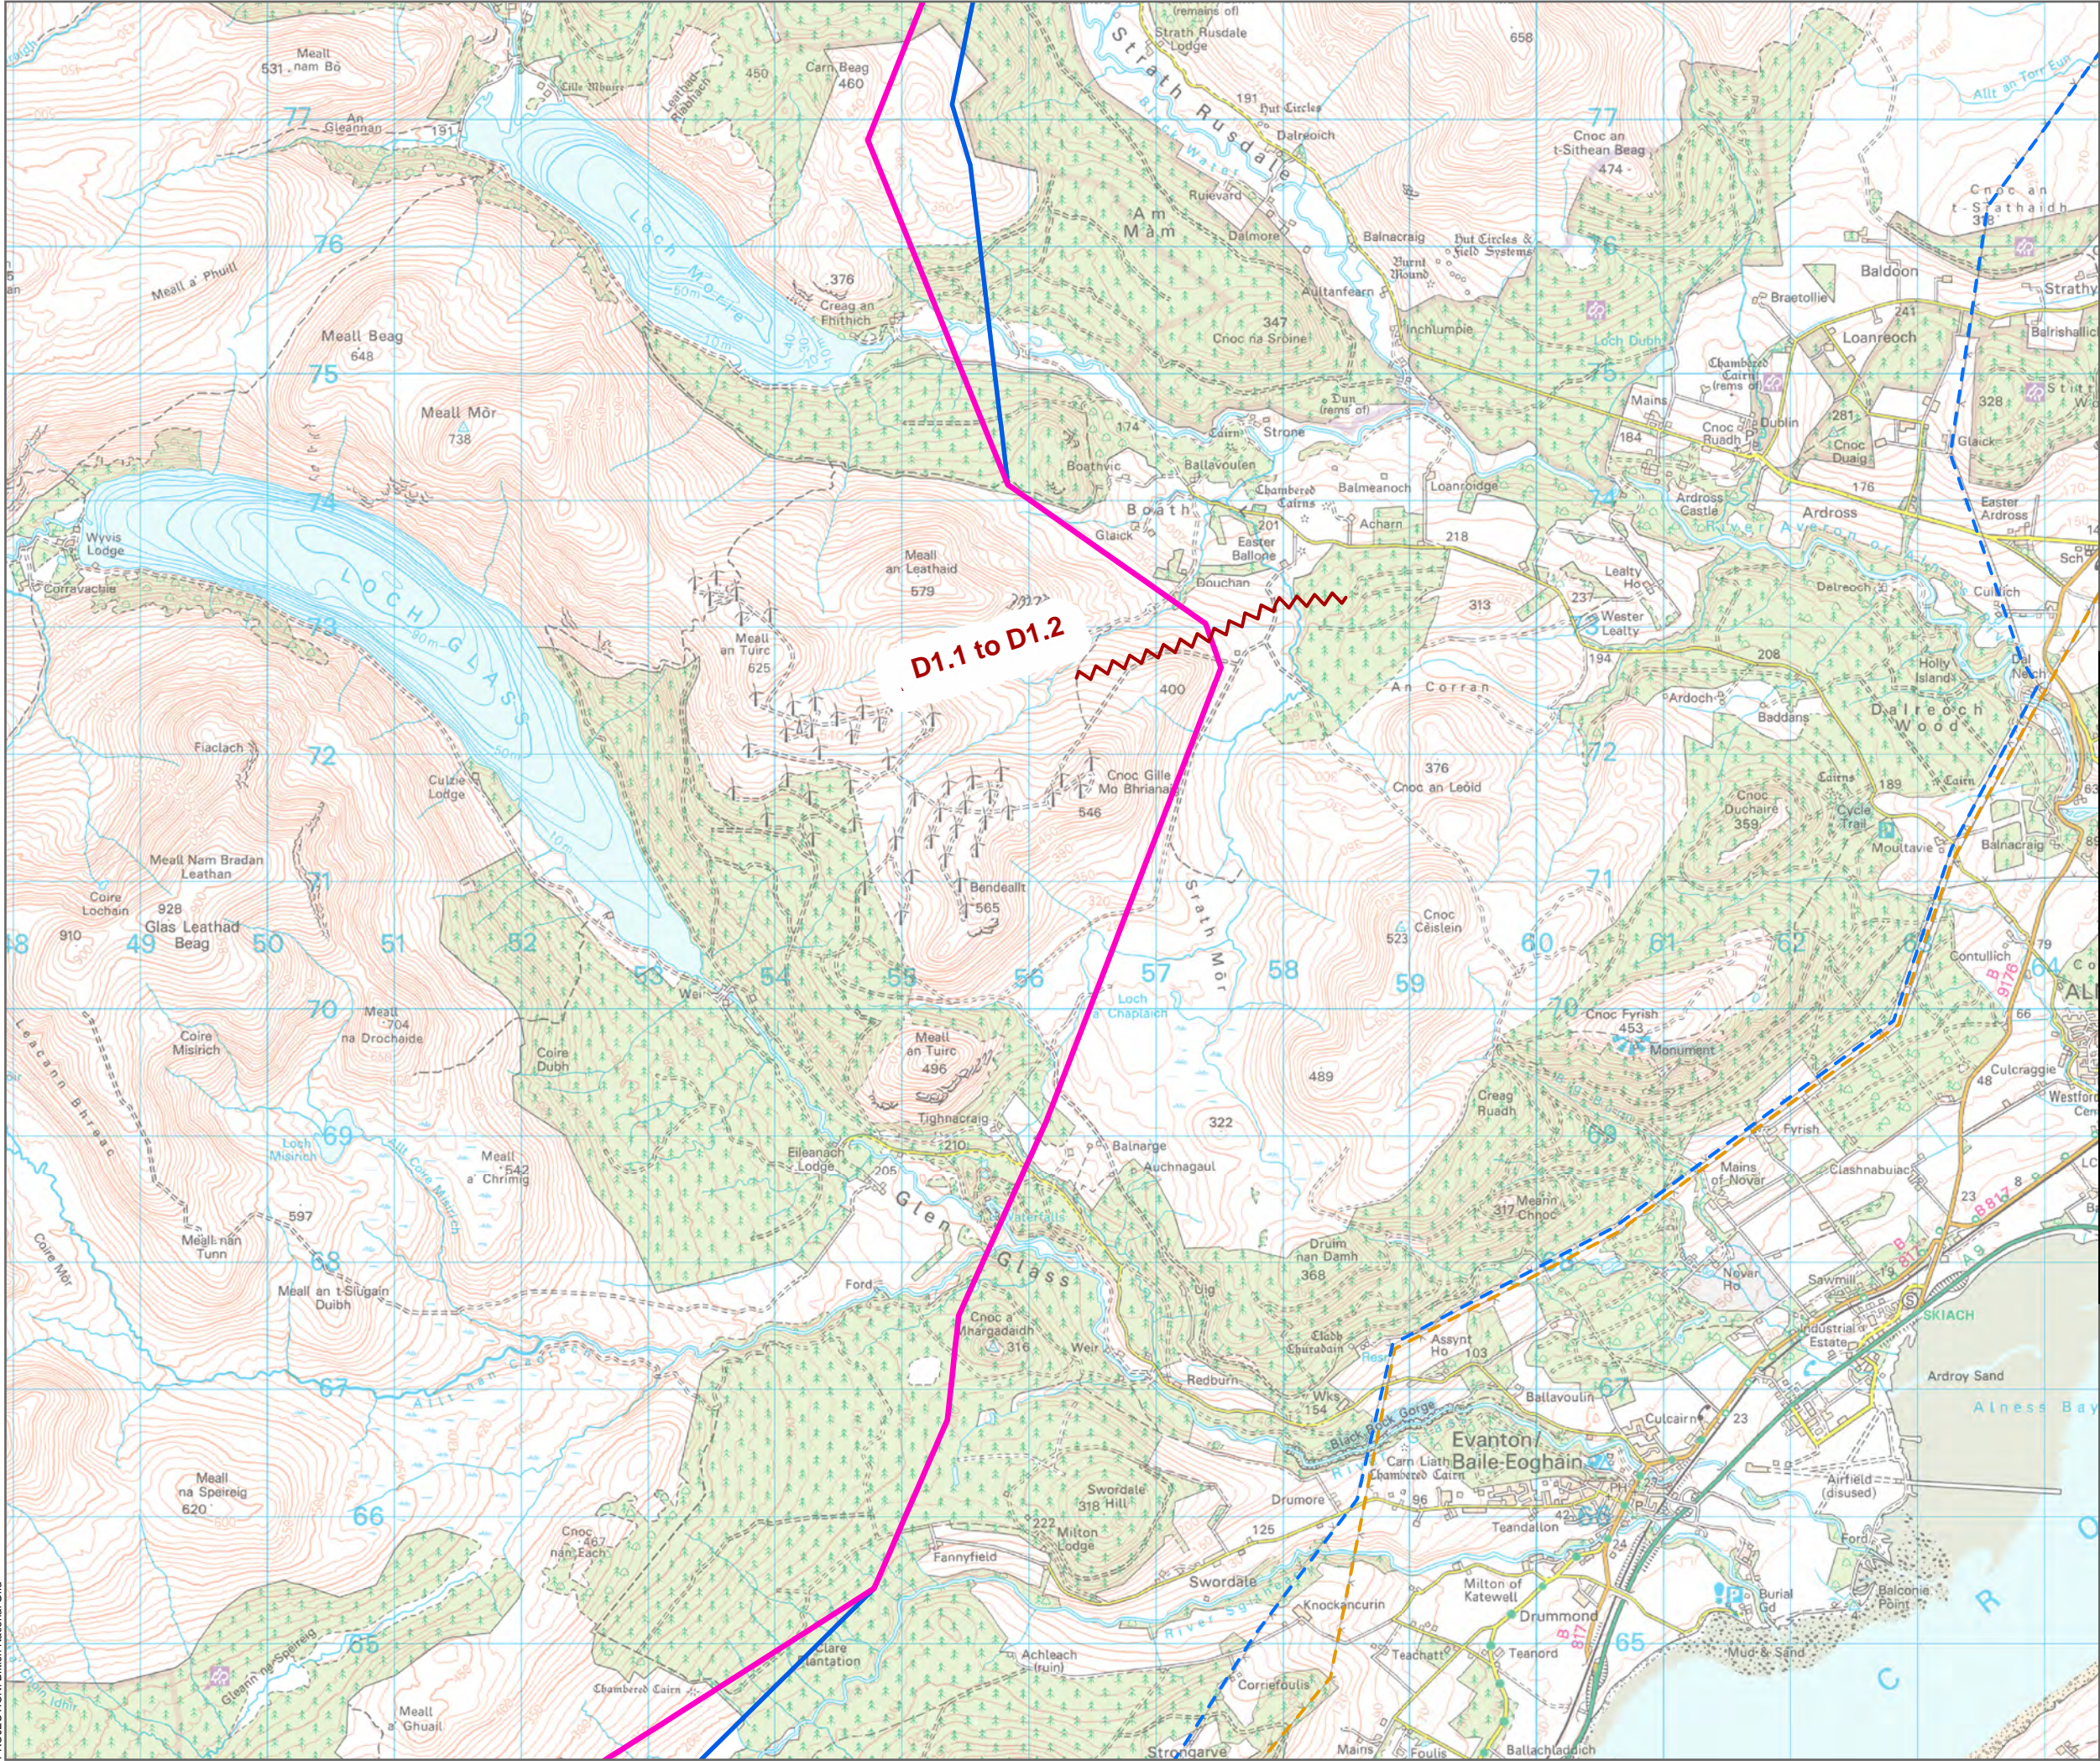

Potential and Alternative Alignment Options

- Potential
- Alternative
- Alignment Sub-Section Break

Existing OHL

- Existing 132kV OHL
- Existing 275kV OHL


0 0.5 1 1.5 2 2.5

Kilometres

N

SCALE: See Scale Bar	VERSION: A01
SIZE: A3	DRAWN: CR
PROJECT: 0720281	CHECKED: BM
DATE: 07/08/2025	APPROVED: KG

Figure 4.3 - 12
Spittal - Loch Buidhe - Beauly 400 kV OHL
Connection
Potential and Alternative Alignments

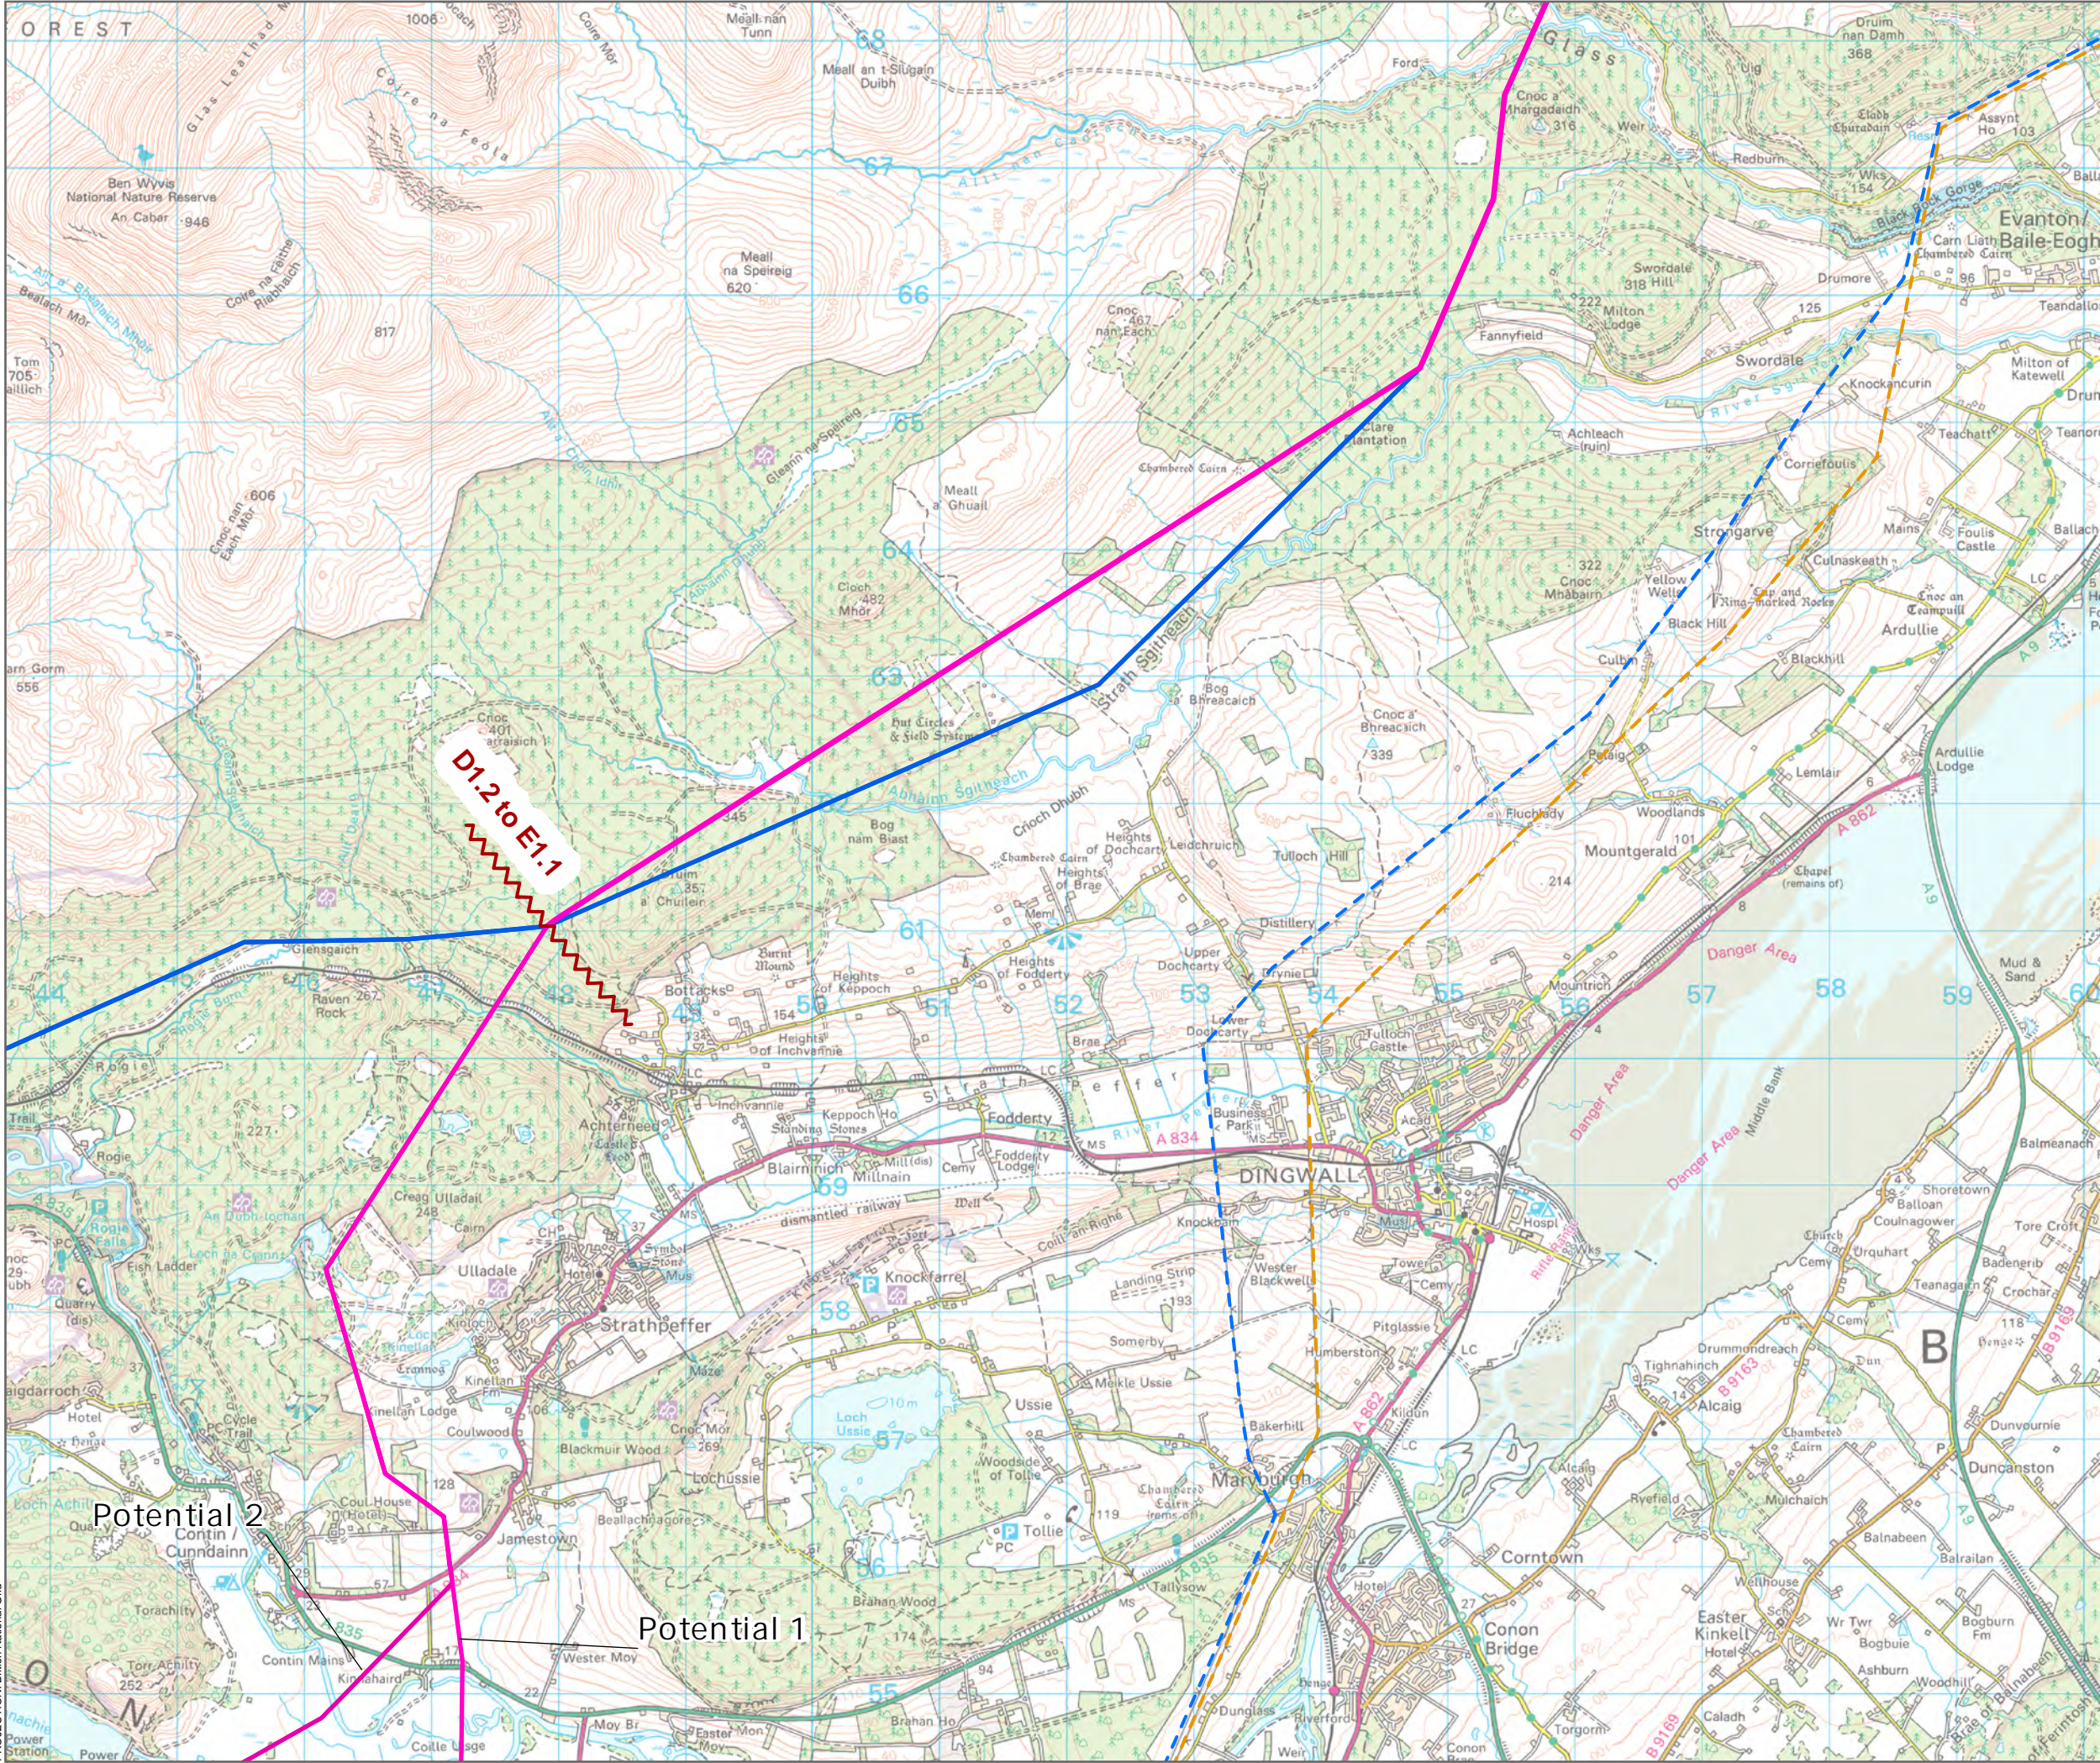

Potential and Alternative Alignment Options

- Potential
- Alternative
- Alignment Sub-Section Break

Existing OHL


- Existing 132kV OHL
- Existing 275kV OHL

0 0.5 1 1.5 2 2.5 Kilometres

N

SCALE: See Scale Bar	VERSION: A01
SIZE: A3	DRAWN: CR
PROJECT: 0720281	CHECKED: BM
DATE: 07/08/2025	APPROVED: KG

Figure 4.3 - 13
Spittal - Loch Buidhe - Beaulieu 400 kV OHL
Connection
Potential and Alternative Alignments

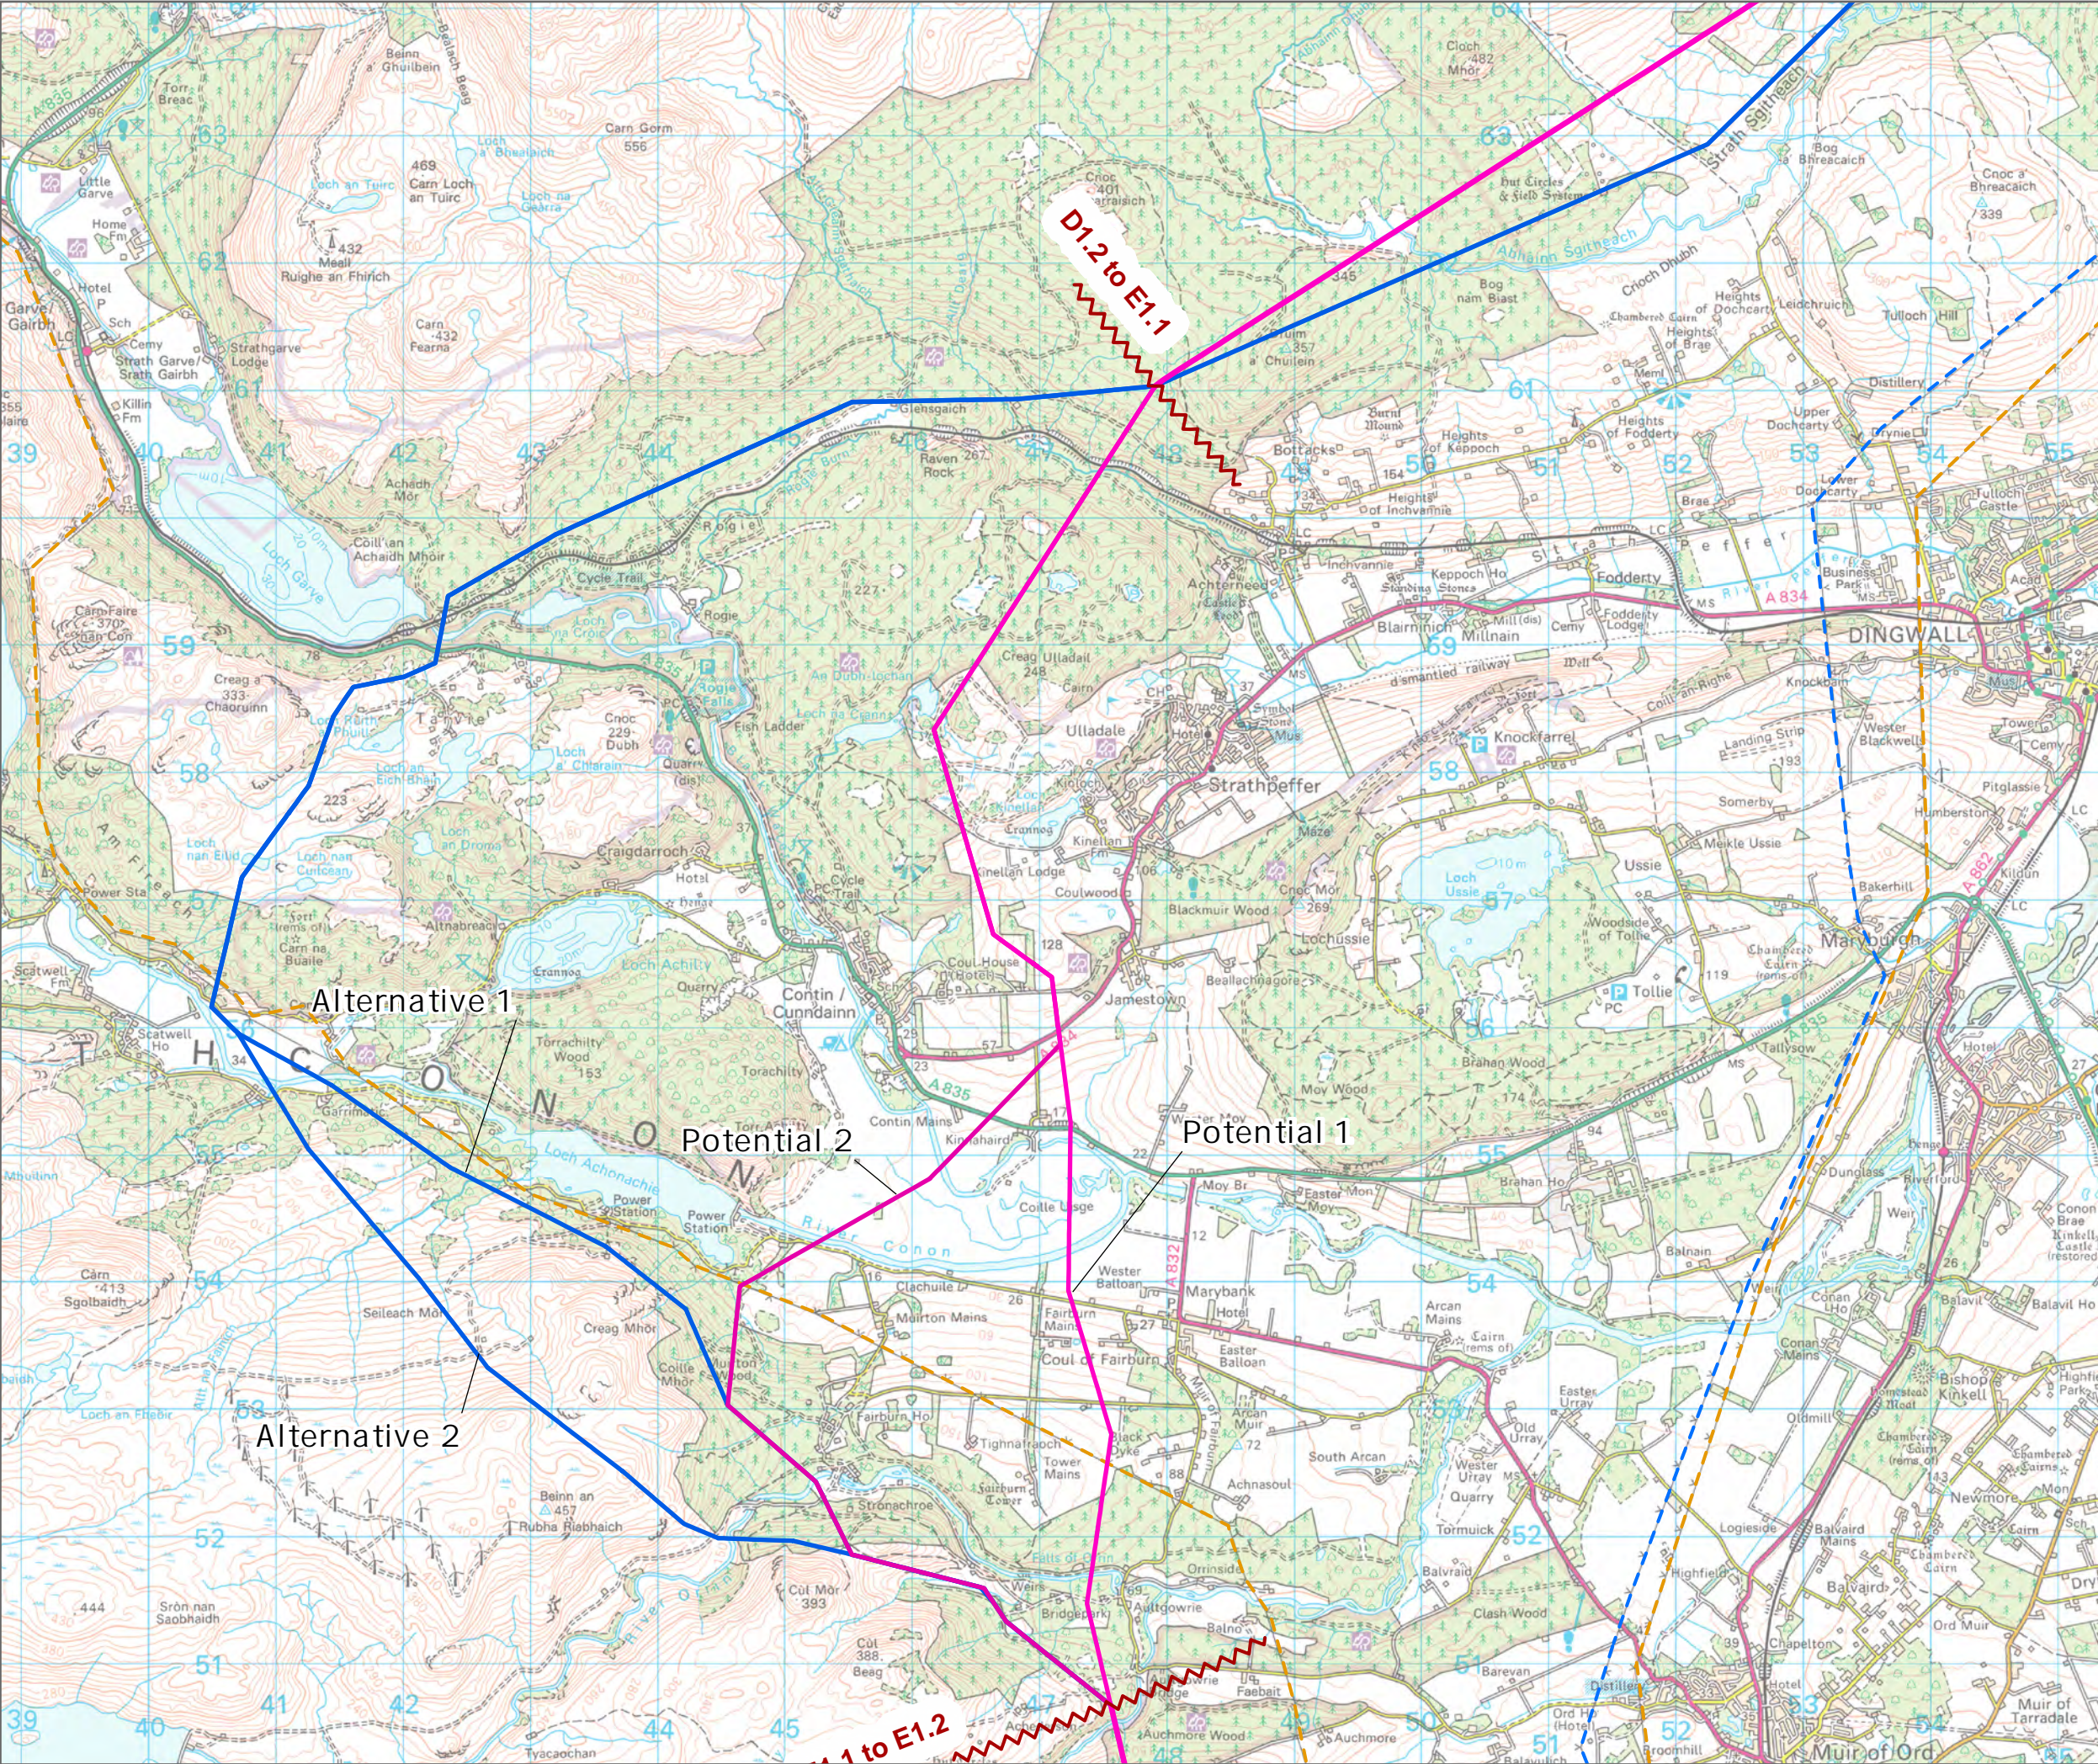

Potential and Alternative Alignment Options

- Potential
- Alternative
- Alignment Sub-Section Break

Existing OHL

- Existing 132kV OHL
- Existing 275kV OHL

Highlands

0 0.5 1 1.5 2 2.5 Kilometres


SCALE: See Scale Bar
SIZE: A3
PROJECT: 0720281
DATE: 07/08/2025

VERSION: A01
DRAWN: CR
CHECKED: BM
APPROVED: KG

Figure 4.3 - 14
Spittal - Loch Buidhe - Beauly 400 kV OHL Connection
Potential and Alternative Alignments

ERM

Scottish & Southern Electricity Networks

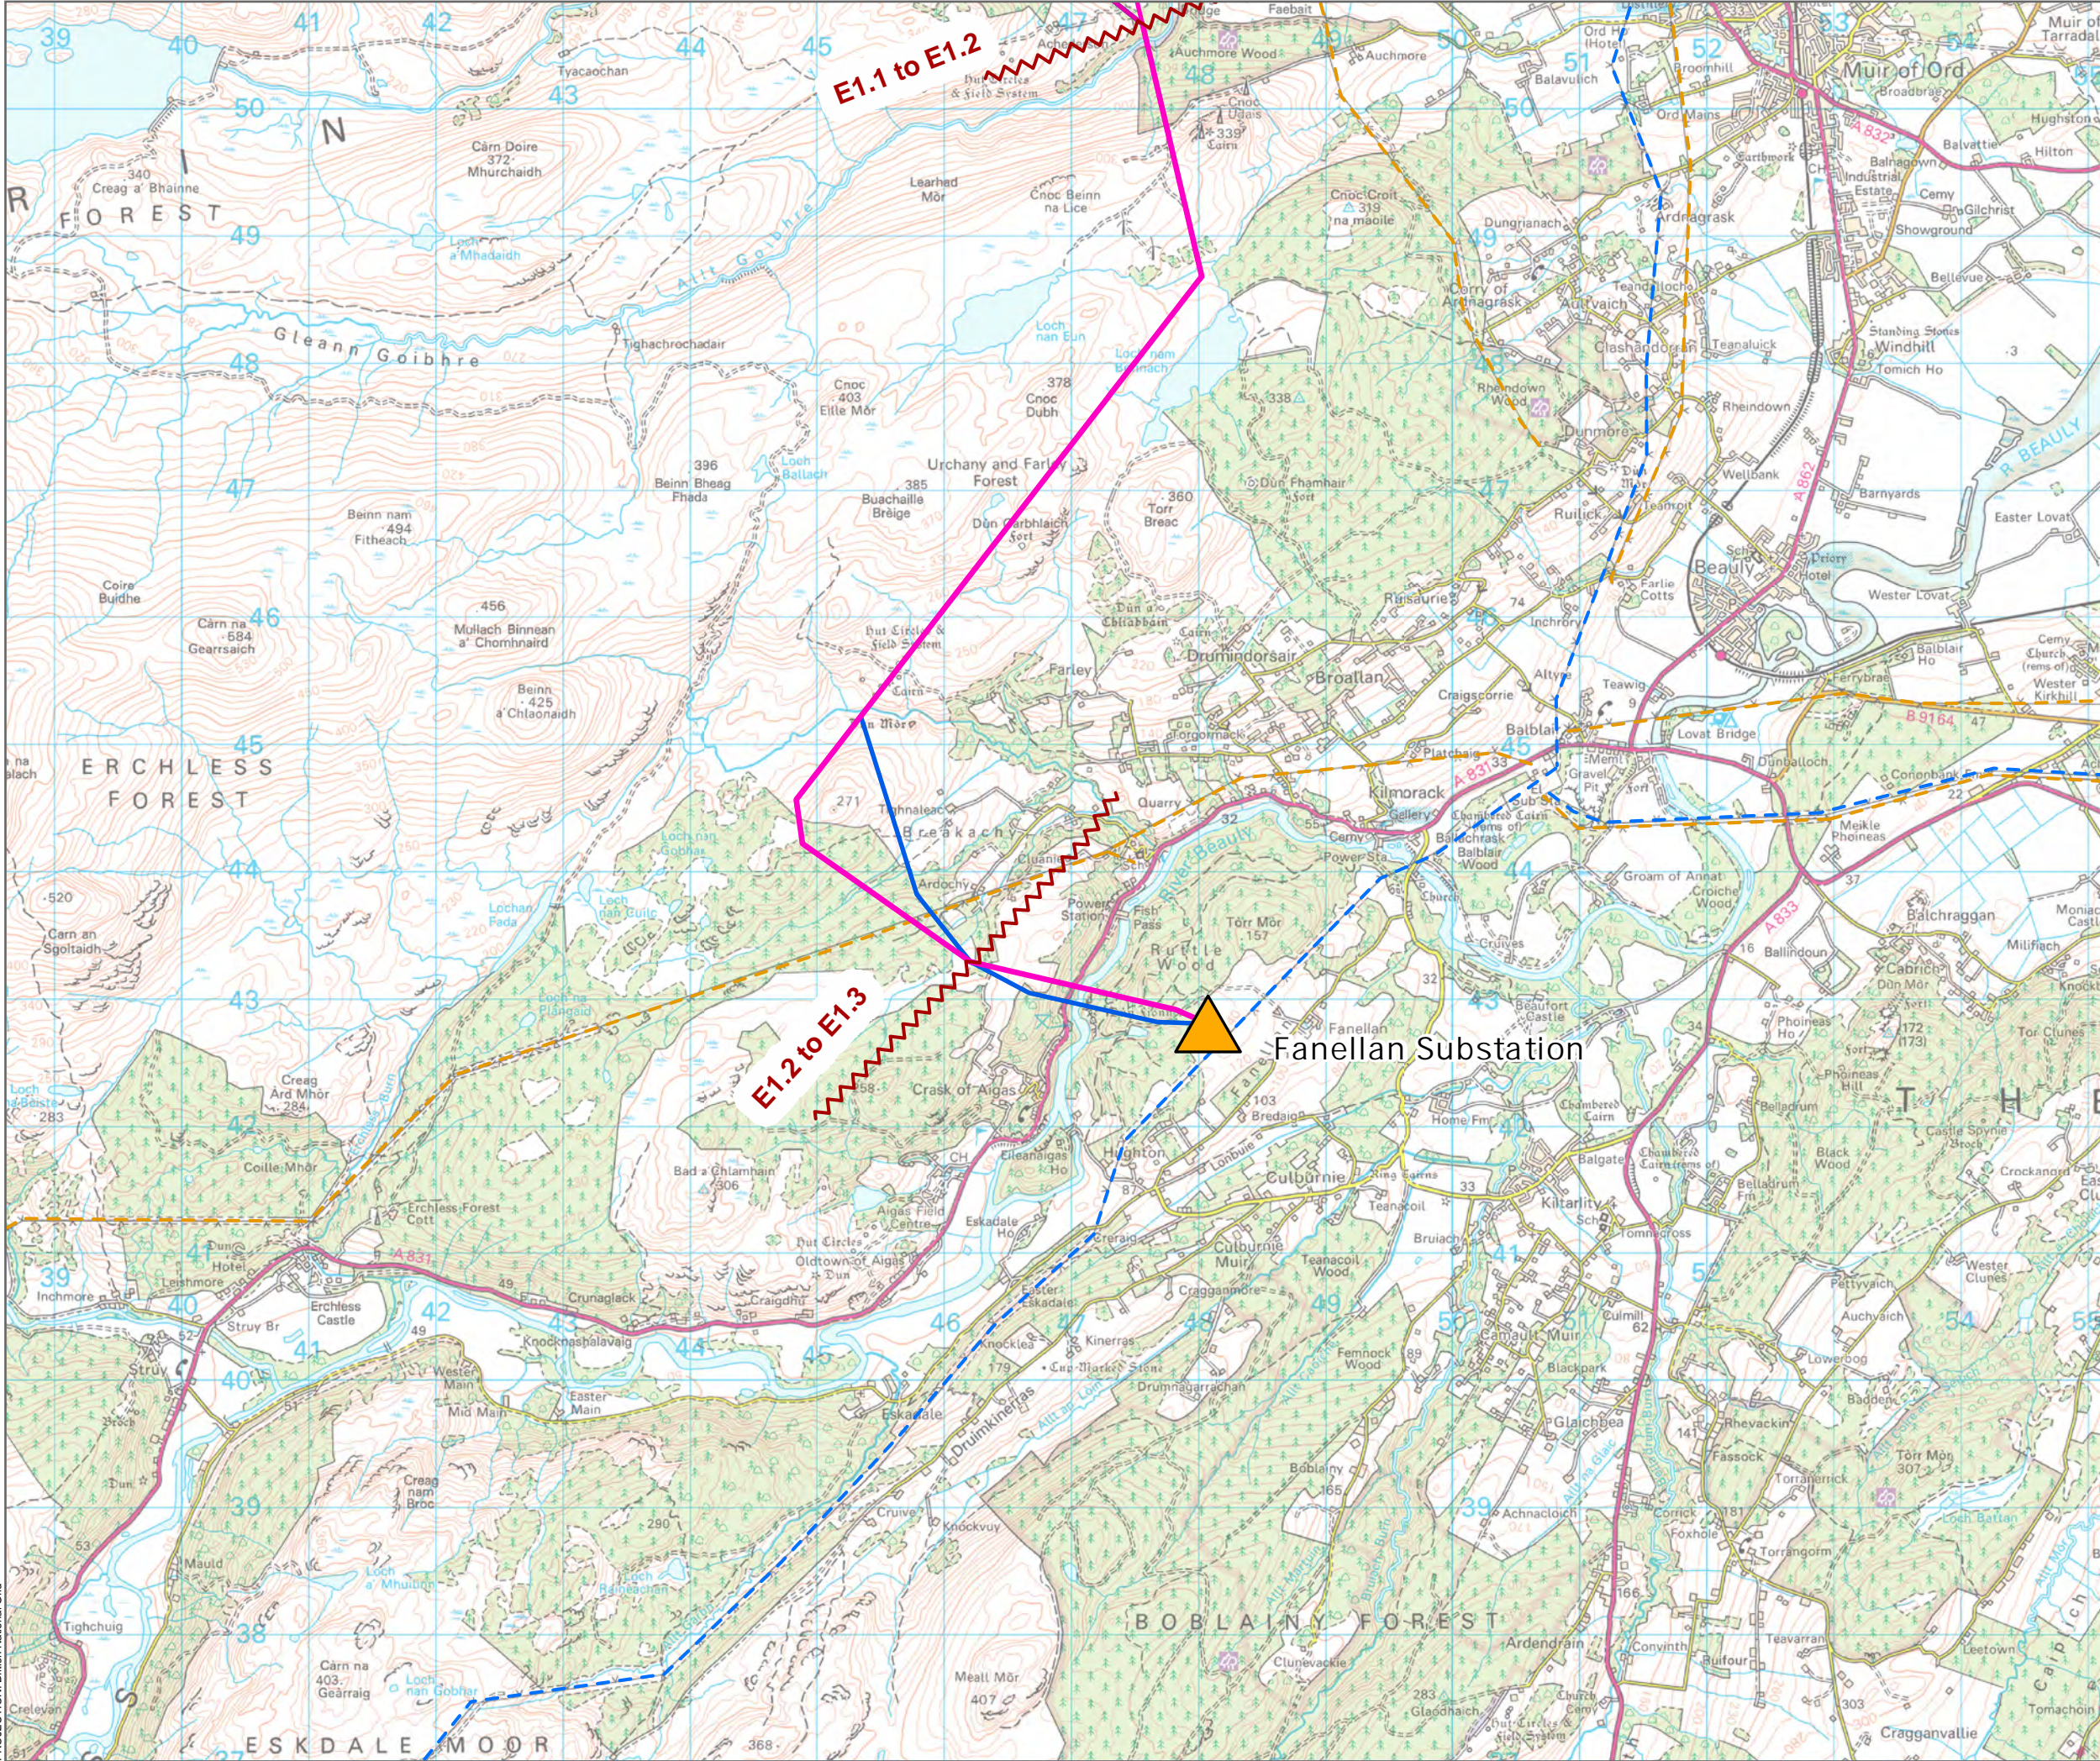

Potential and Alternative Alignment Options

- Potential
- Alternative
- Alignment Sub-Section Break
- Existing OHL
 - Existing 132kV OHL
 - Existing 275kV OHL
- Substation

Figure 4.3 - 15
Spittal - Loch Buidhe - Beaully 400 kV OHL
Connection
Potential and Alternative Alignments

SCALE: See Scale Bar
SIZE: A3
PROJECT: 0720281
DATE: 07/08/2025

VERSION: A01
DRAWN: CR
CHECKED: BM
APPROVED: KG

0 0.5 1 1.5 2 2.5
Kilometres

Highlands

Elgin

A836

A99

A9

A96

ERM

Scottish & Southern
Electricity Networks
TRANSMISSION