



- Tower Location
- Alignment Section A
- Temporary Tower Compound Area
- Equipotential Zone (EPZ) (Pulling Position)
- Temporary Access Track - EPZ
- Temporary Access Track - Cut/Fill
- Temporary Access Track - Floating
- Permanent Access Track - Cut/Fill
- Permanent Access Track - Floating
- Study Area (1 km Buffer)

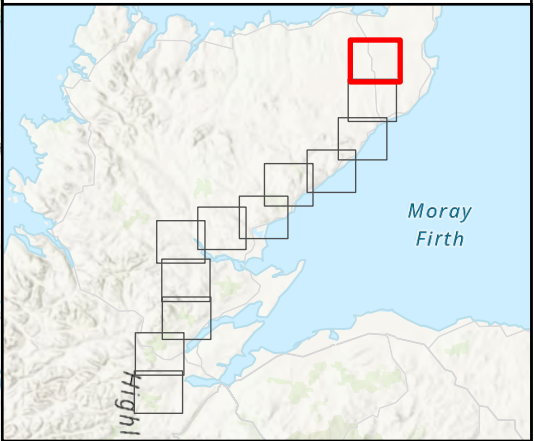


SCALE: See Scale Bar
SIZE: A3
PROJECT: 0720281
DATE: 11/08/2025



VERSION: A04
DRAWN: JG
CHECKED: RD
APPROVED: KG

Figure 10.1 - 1
Spittal - Loch Buidhe - Beauly 400 kV OHL
Connection
Water Environment Study Area



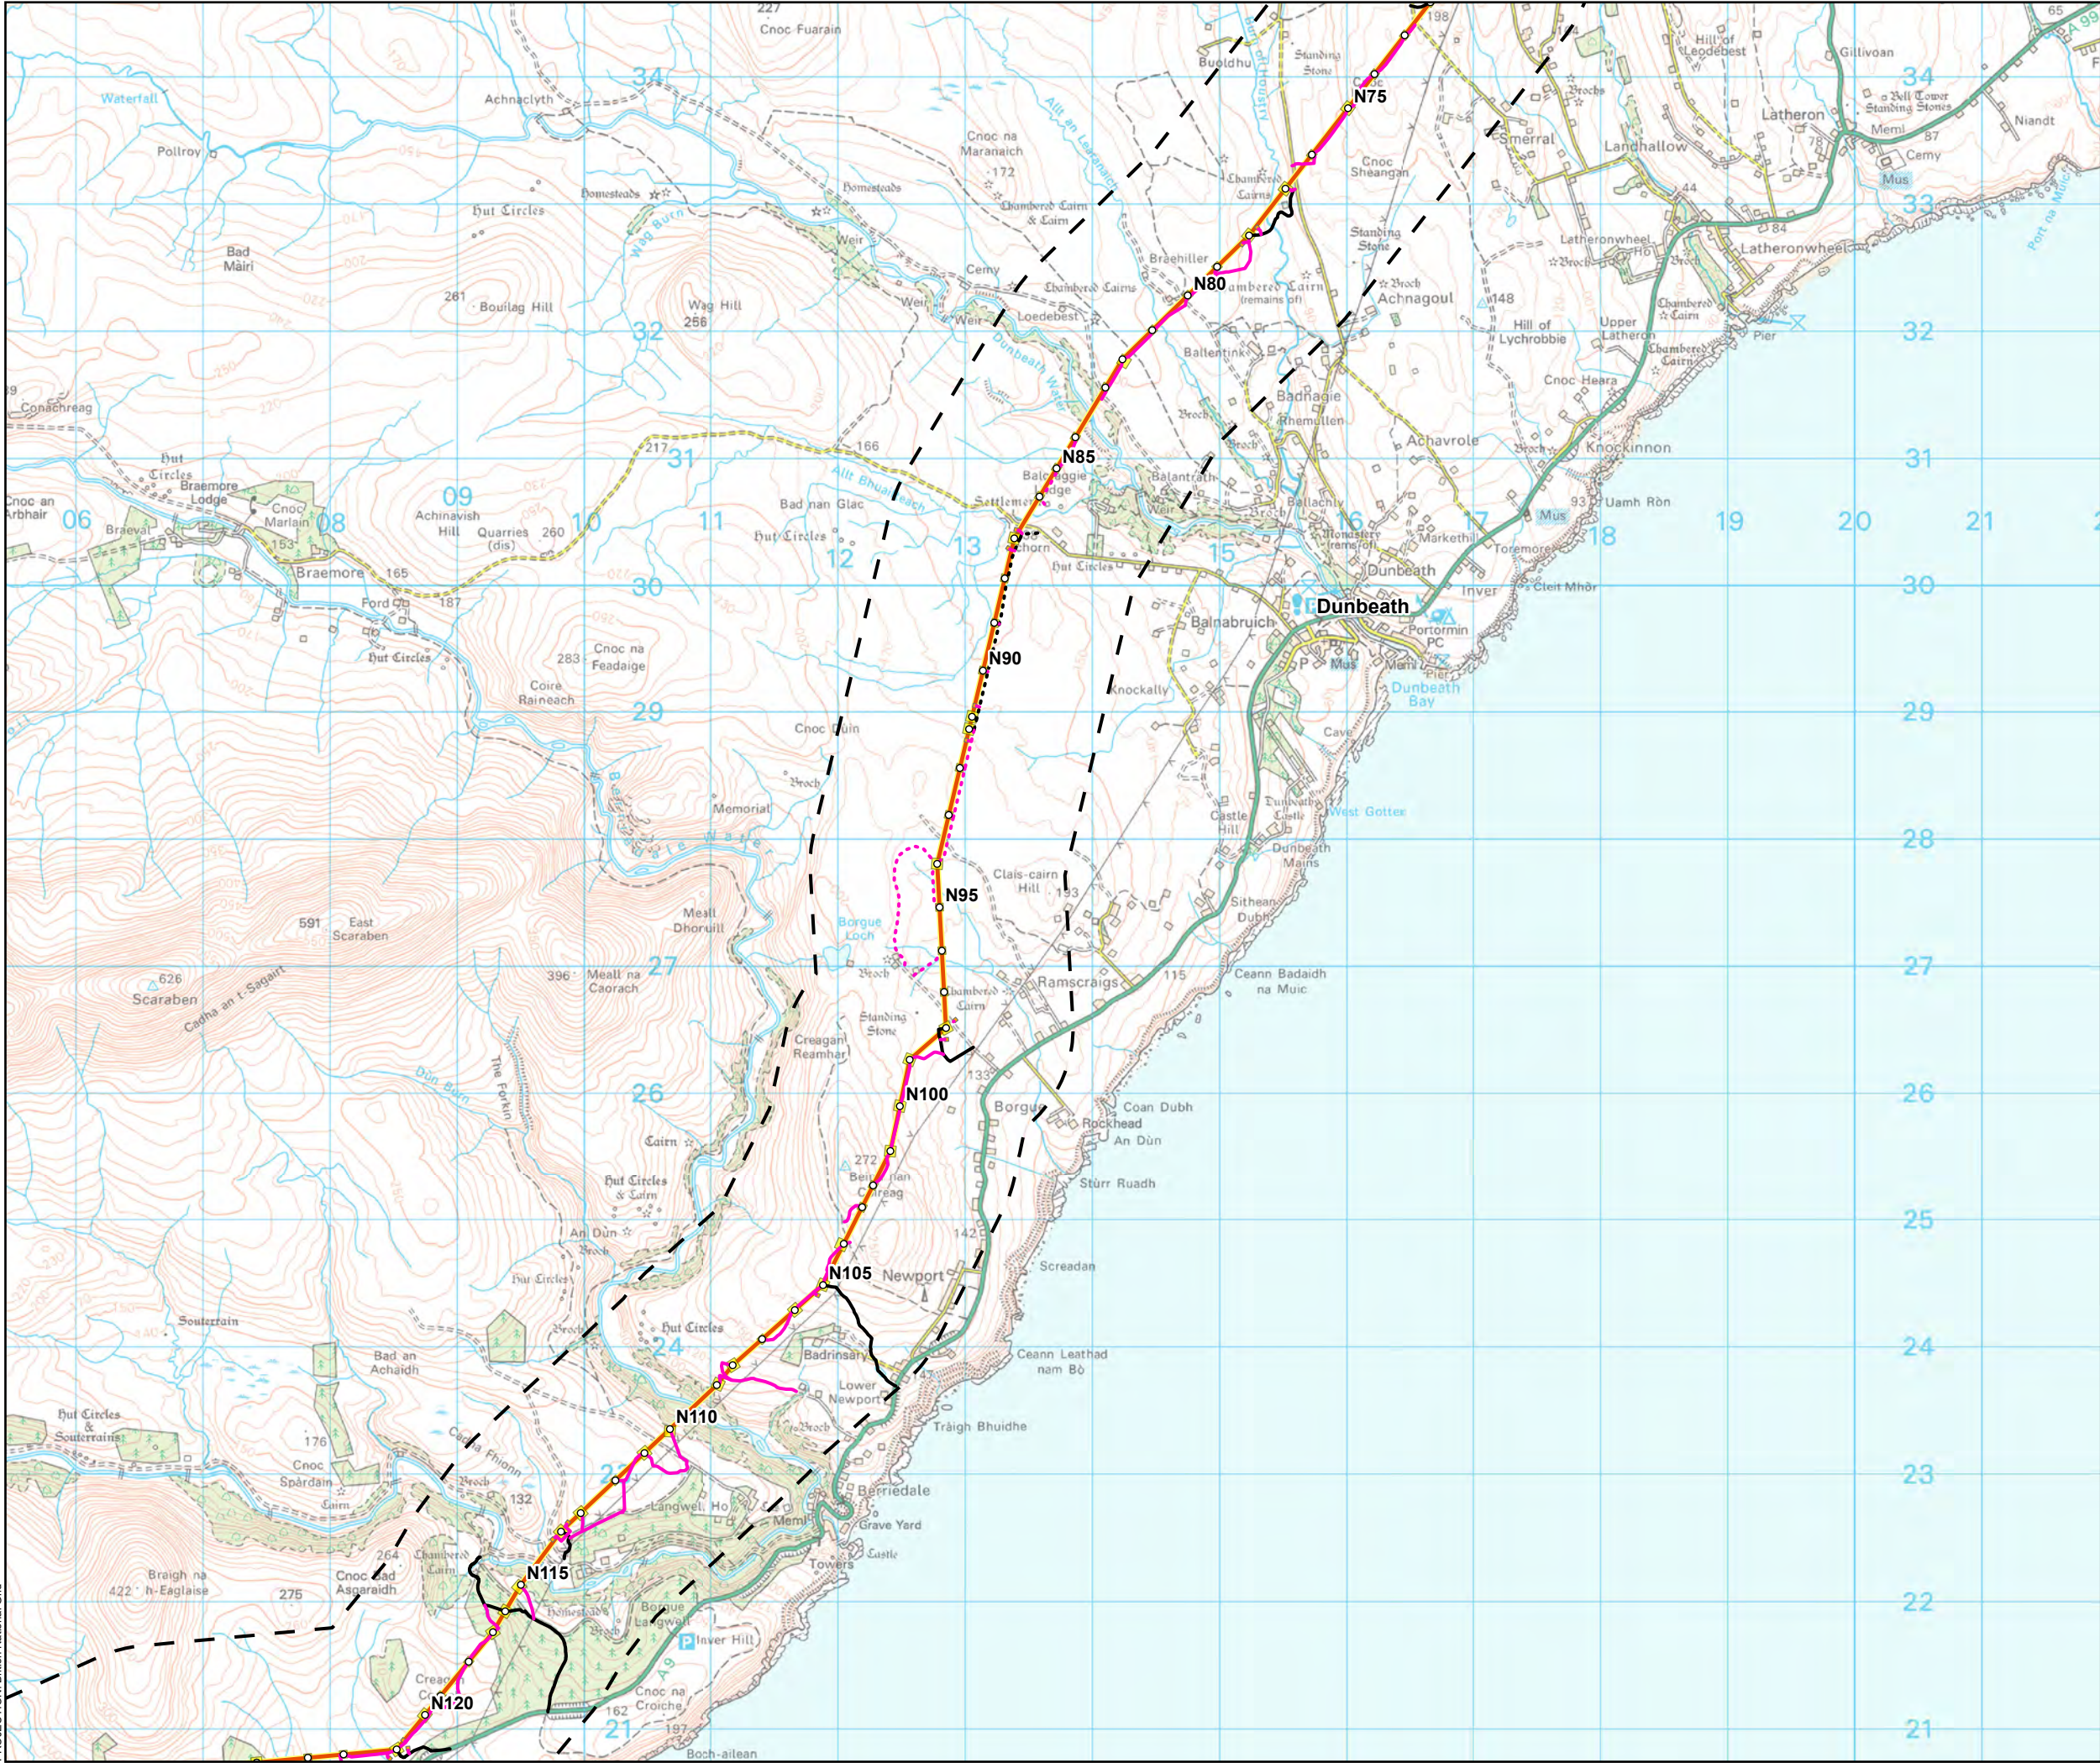


- Tower Location
- Alignment Section A
- Temporary Tower Compound Area
- Equipotential Zone (EPZ) (Pulling Position)
- Temporary Access Track - EPZ
- Temporary Access Track - Cut/Fill
- Temporary Access Track - Floating
- Permanent Access Track - Cut/Fill
- Permanent Access Track - Floating
- Study Area (1 km Buffer)

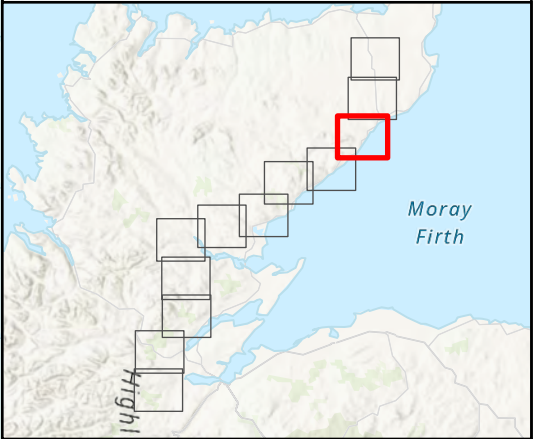



SCALE: See Scale Bar	VERSION: A04
SIZE: A3	DRAWN: JG
PROJECT: 0720281	CHECKED: RD
DATE: 11/08/2025	APPROVED: KG

Figure 10.1 - 3
Spittal - Loch Buidhe - Beauly 400 kV OHL
Connection
Water Environment Study Area



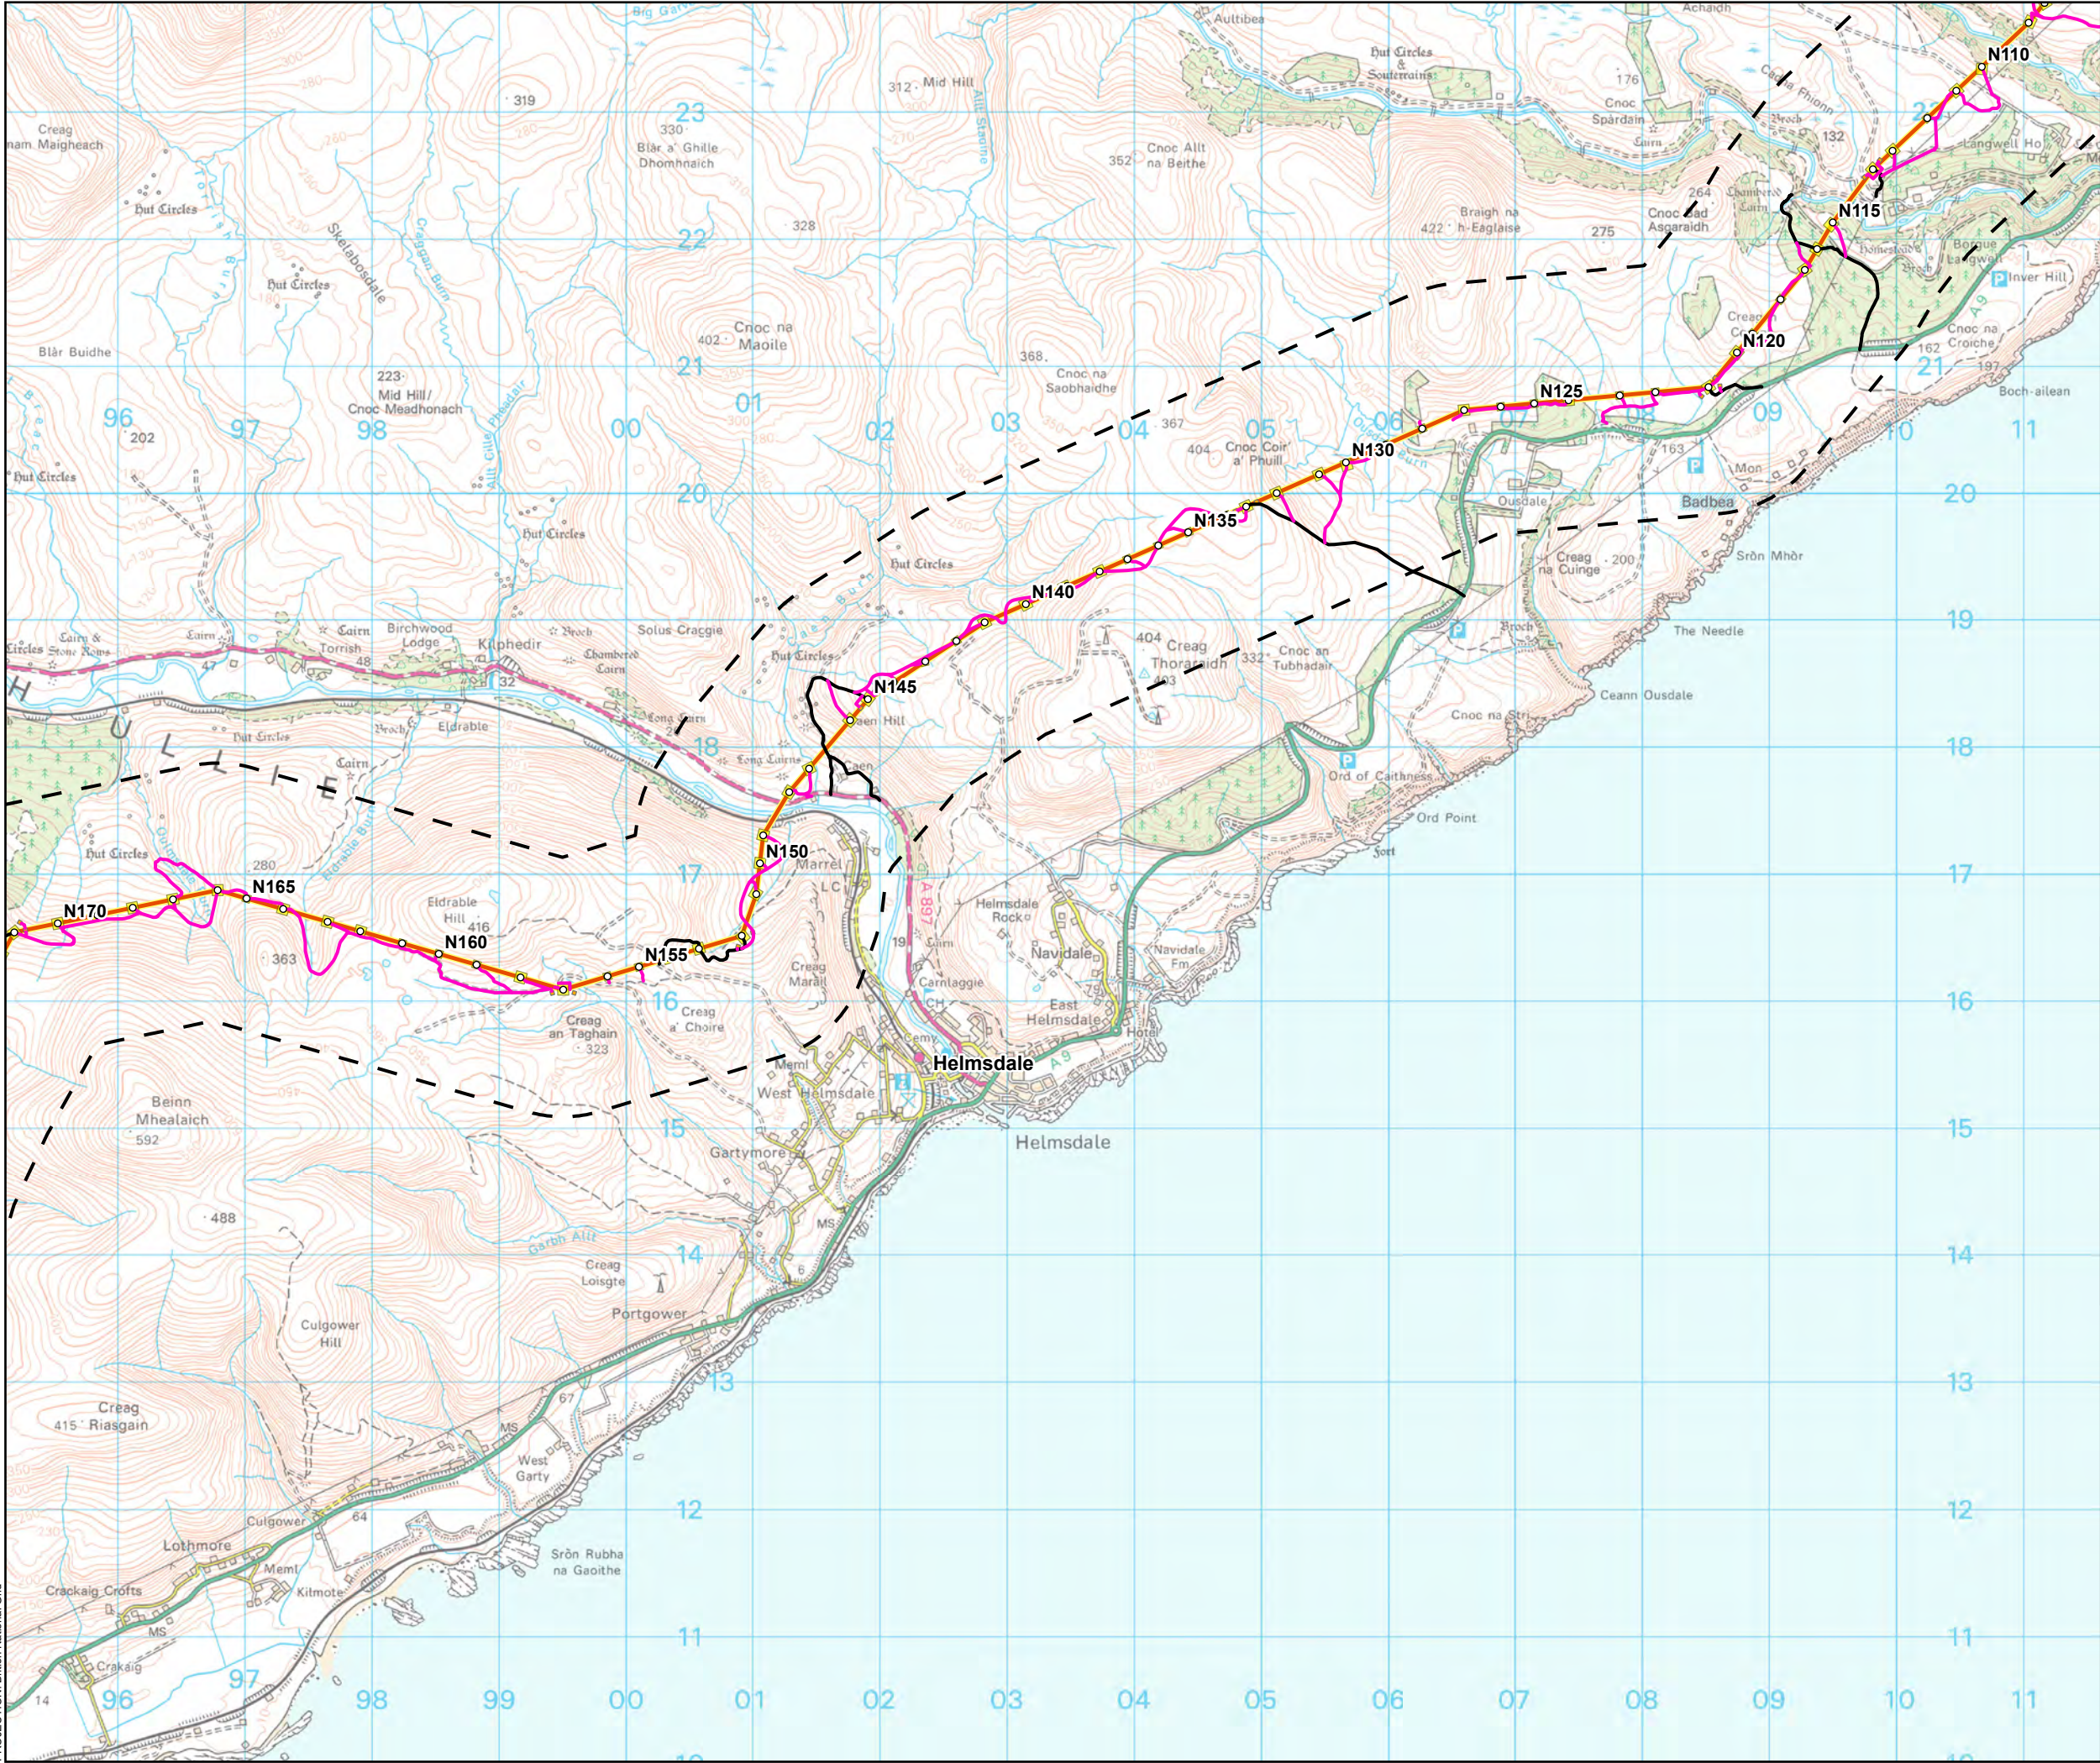


- Tower Location
- Alignment Section A
- Temporary Tower Compound Area
- Equipotential Zone (EPZ) (Pulling Position)
- Temporary Access Track - EPZ
- Temporary Access Track - Cut/Fill
- Permanent Access Track - Cut/Fill
- Study Area (1 km Buffer)

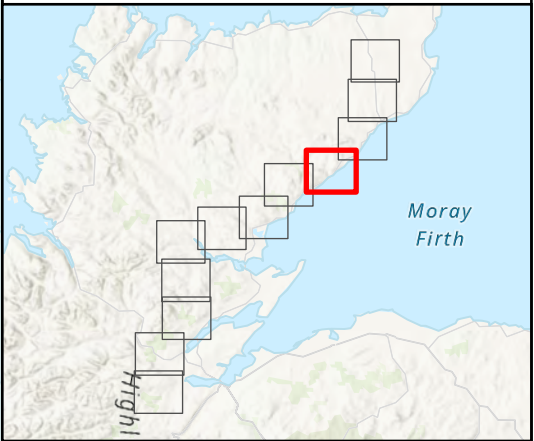



SCALE: See Scale Bar	VERSION: A04
SIZE: A3	DRAWN: JG
PROJECT: 0720281	CHECKED: RD
DATE: 11/08/2025	APPROVED: KG

Figure 10.1 - 4
Spittal - Loch Buidhe - Beaully 400 kV OHL
Connection
Water Environment Study Area



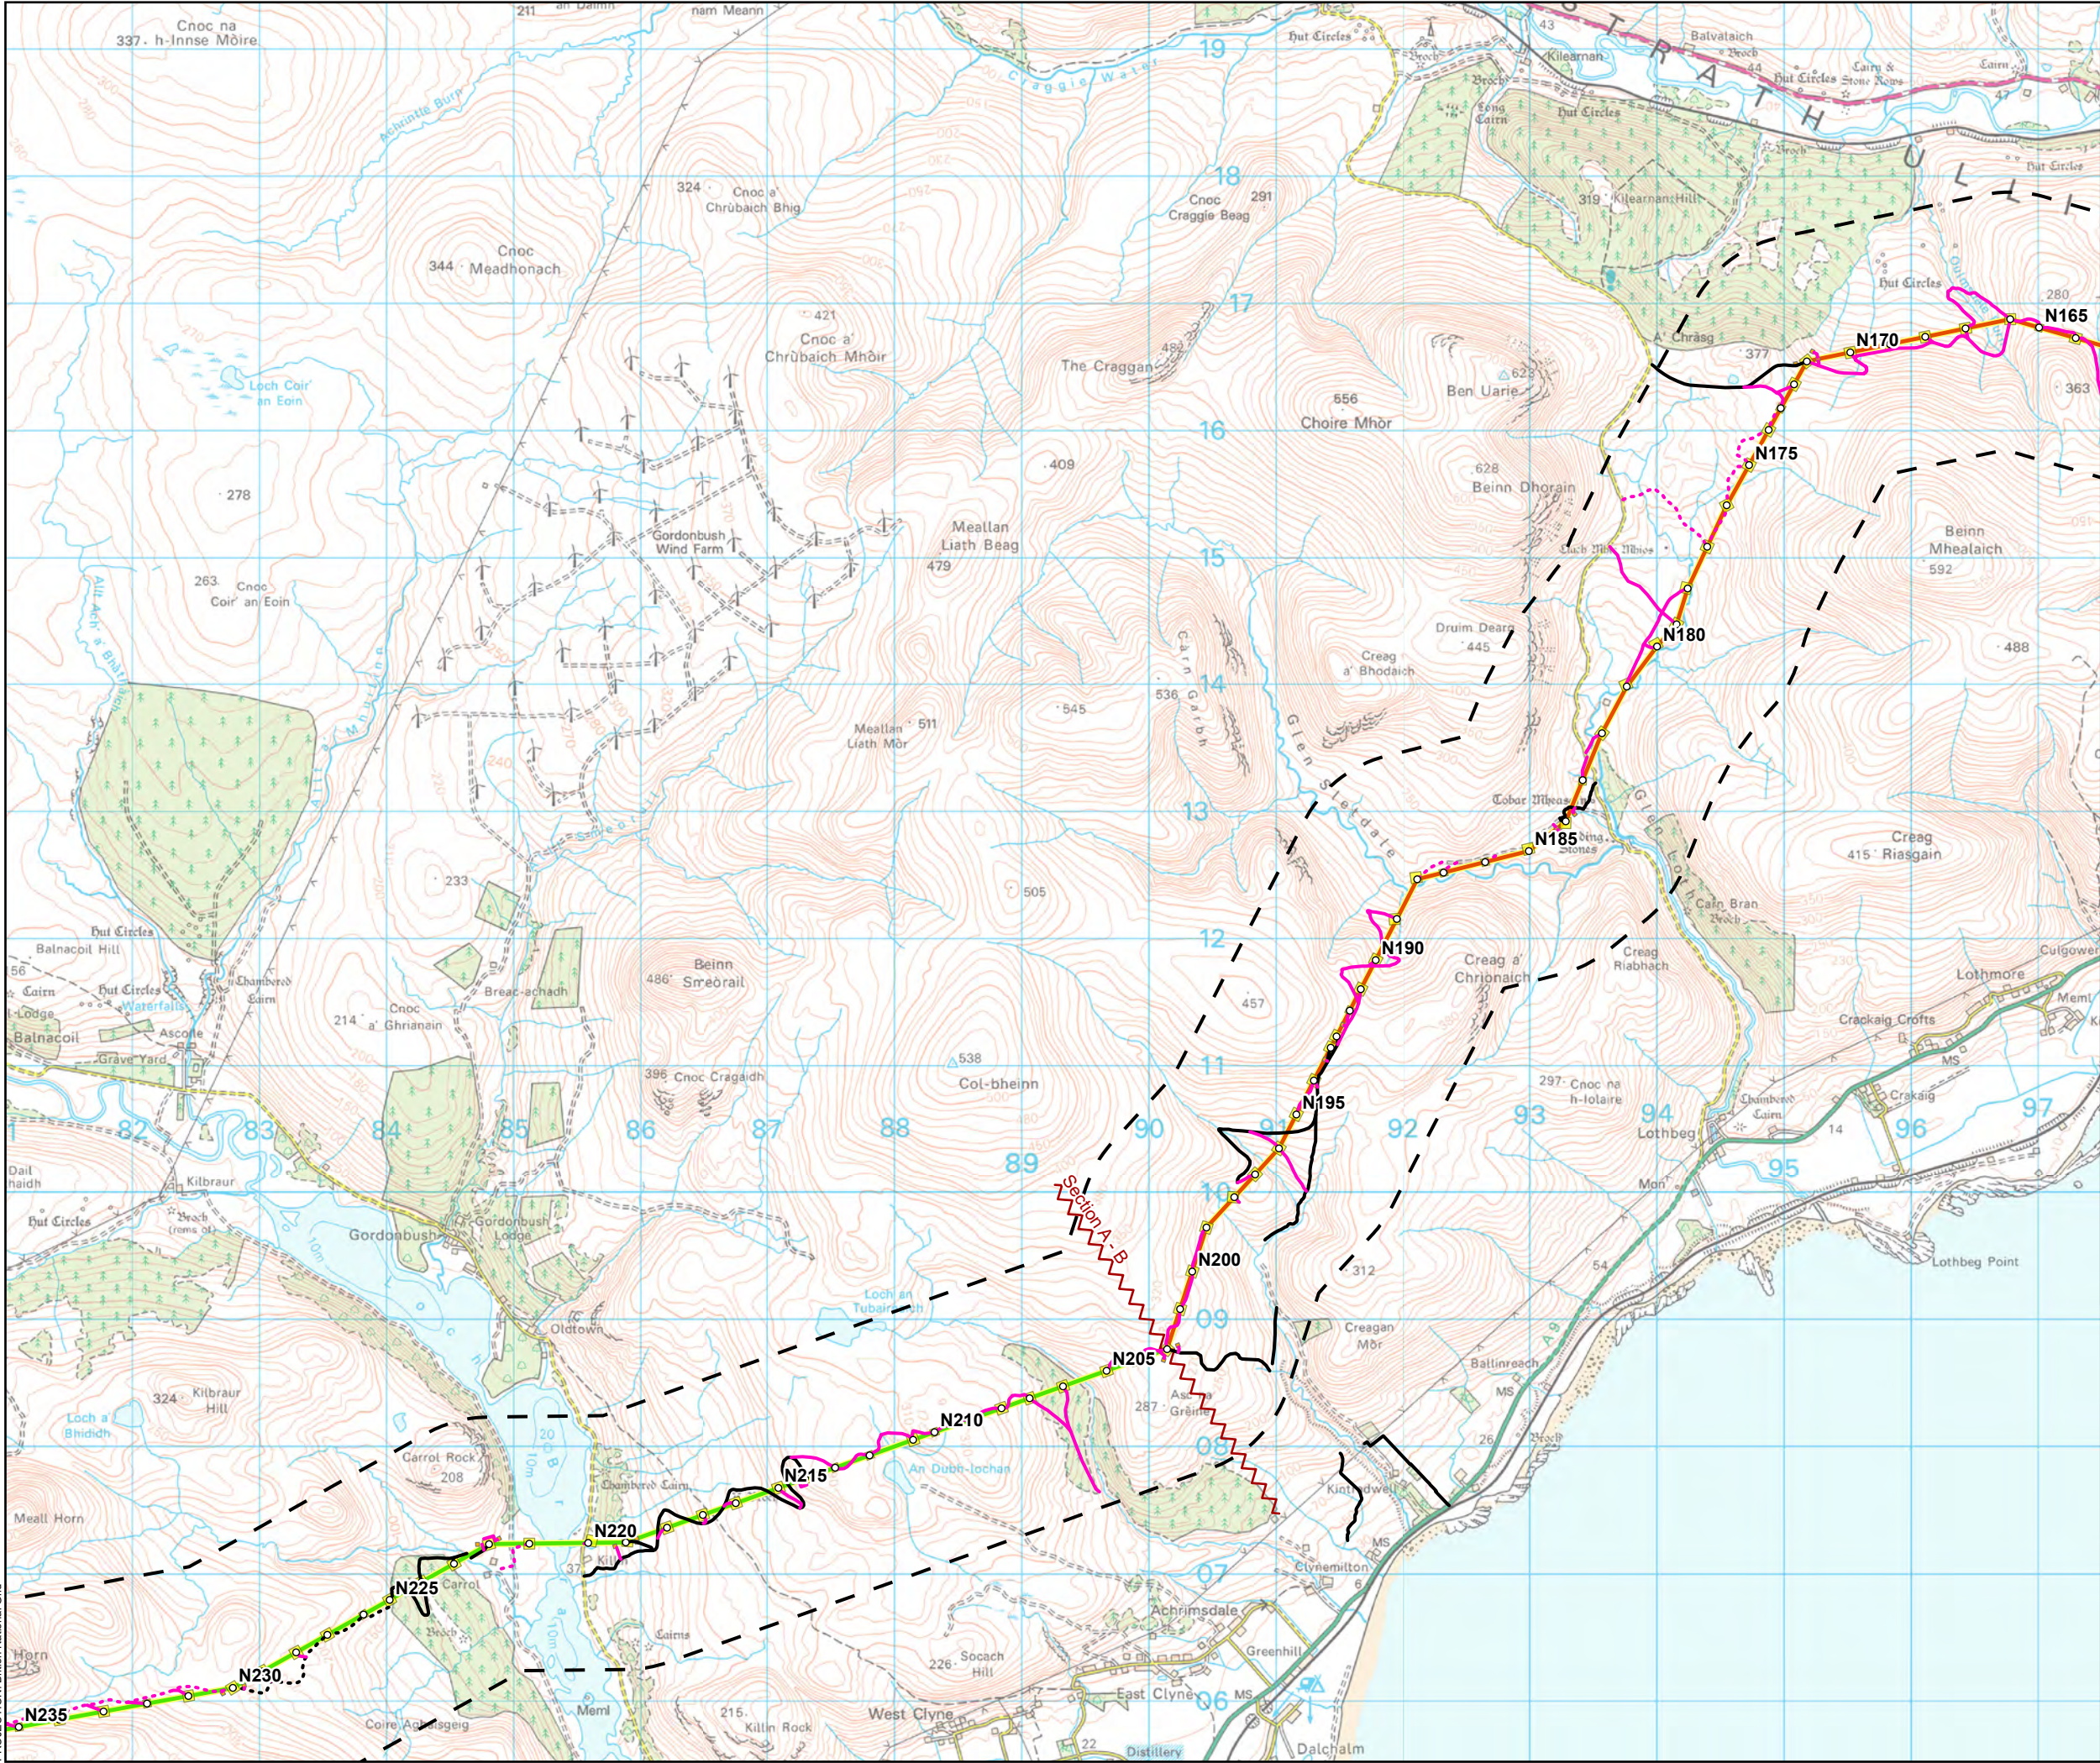


- Tower Location
- Alignment Section A
- Alignment Section B
- Temporary Tower Compound Area
- Equipotential Zone (EPZ) (Pulling Position)
- Temporary Access Track - EPZ
- Temporary Access Track - Cut/Fill
- Temporary Access Track - Floating
- Permanent Access Track - Cut/Fill
- Permanent Access Track - Floating
- Alignment Section Break
- Study Area (1 km Buffer)

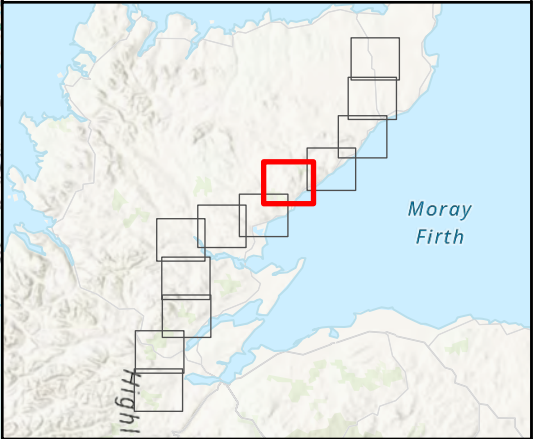



SCALE: See Scale Bar	VERSION: A04
SIZE: A3	DRAWN: JG
PROJECT: 0720281	CHECKED: RD
DATE: 11/08/2025	APPROVED: KG

Figure 10.1 - 5
Spittal - Loch Buidhe - Beaulieu 400 kV OHL
Connection
Water Environment Study Area



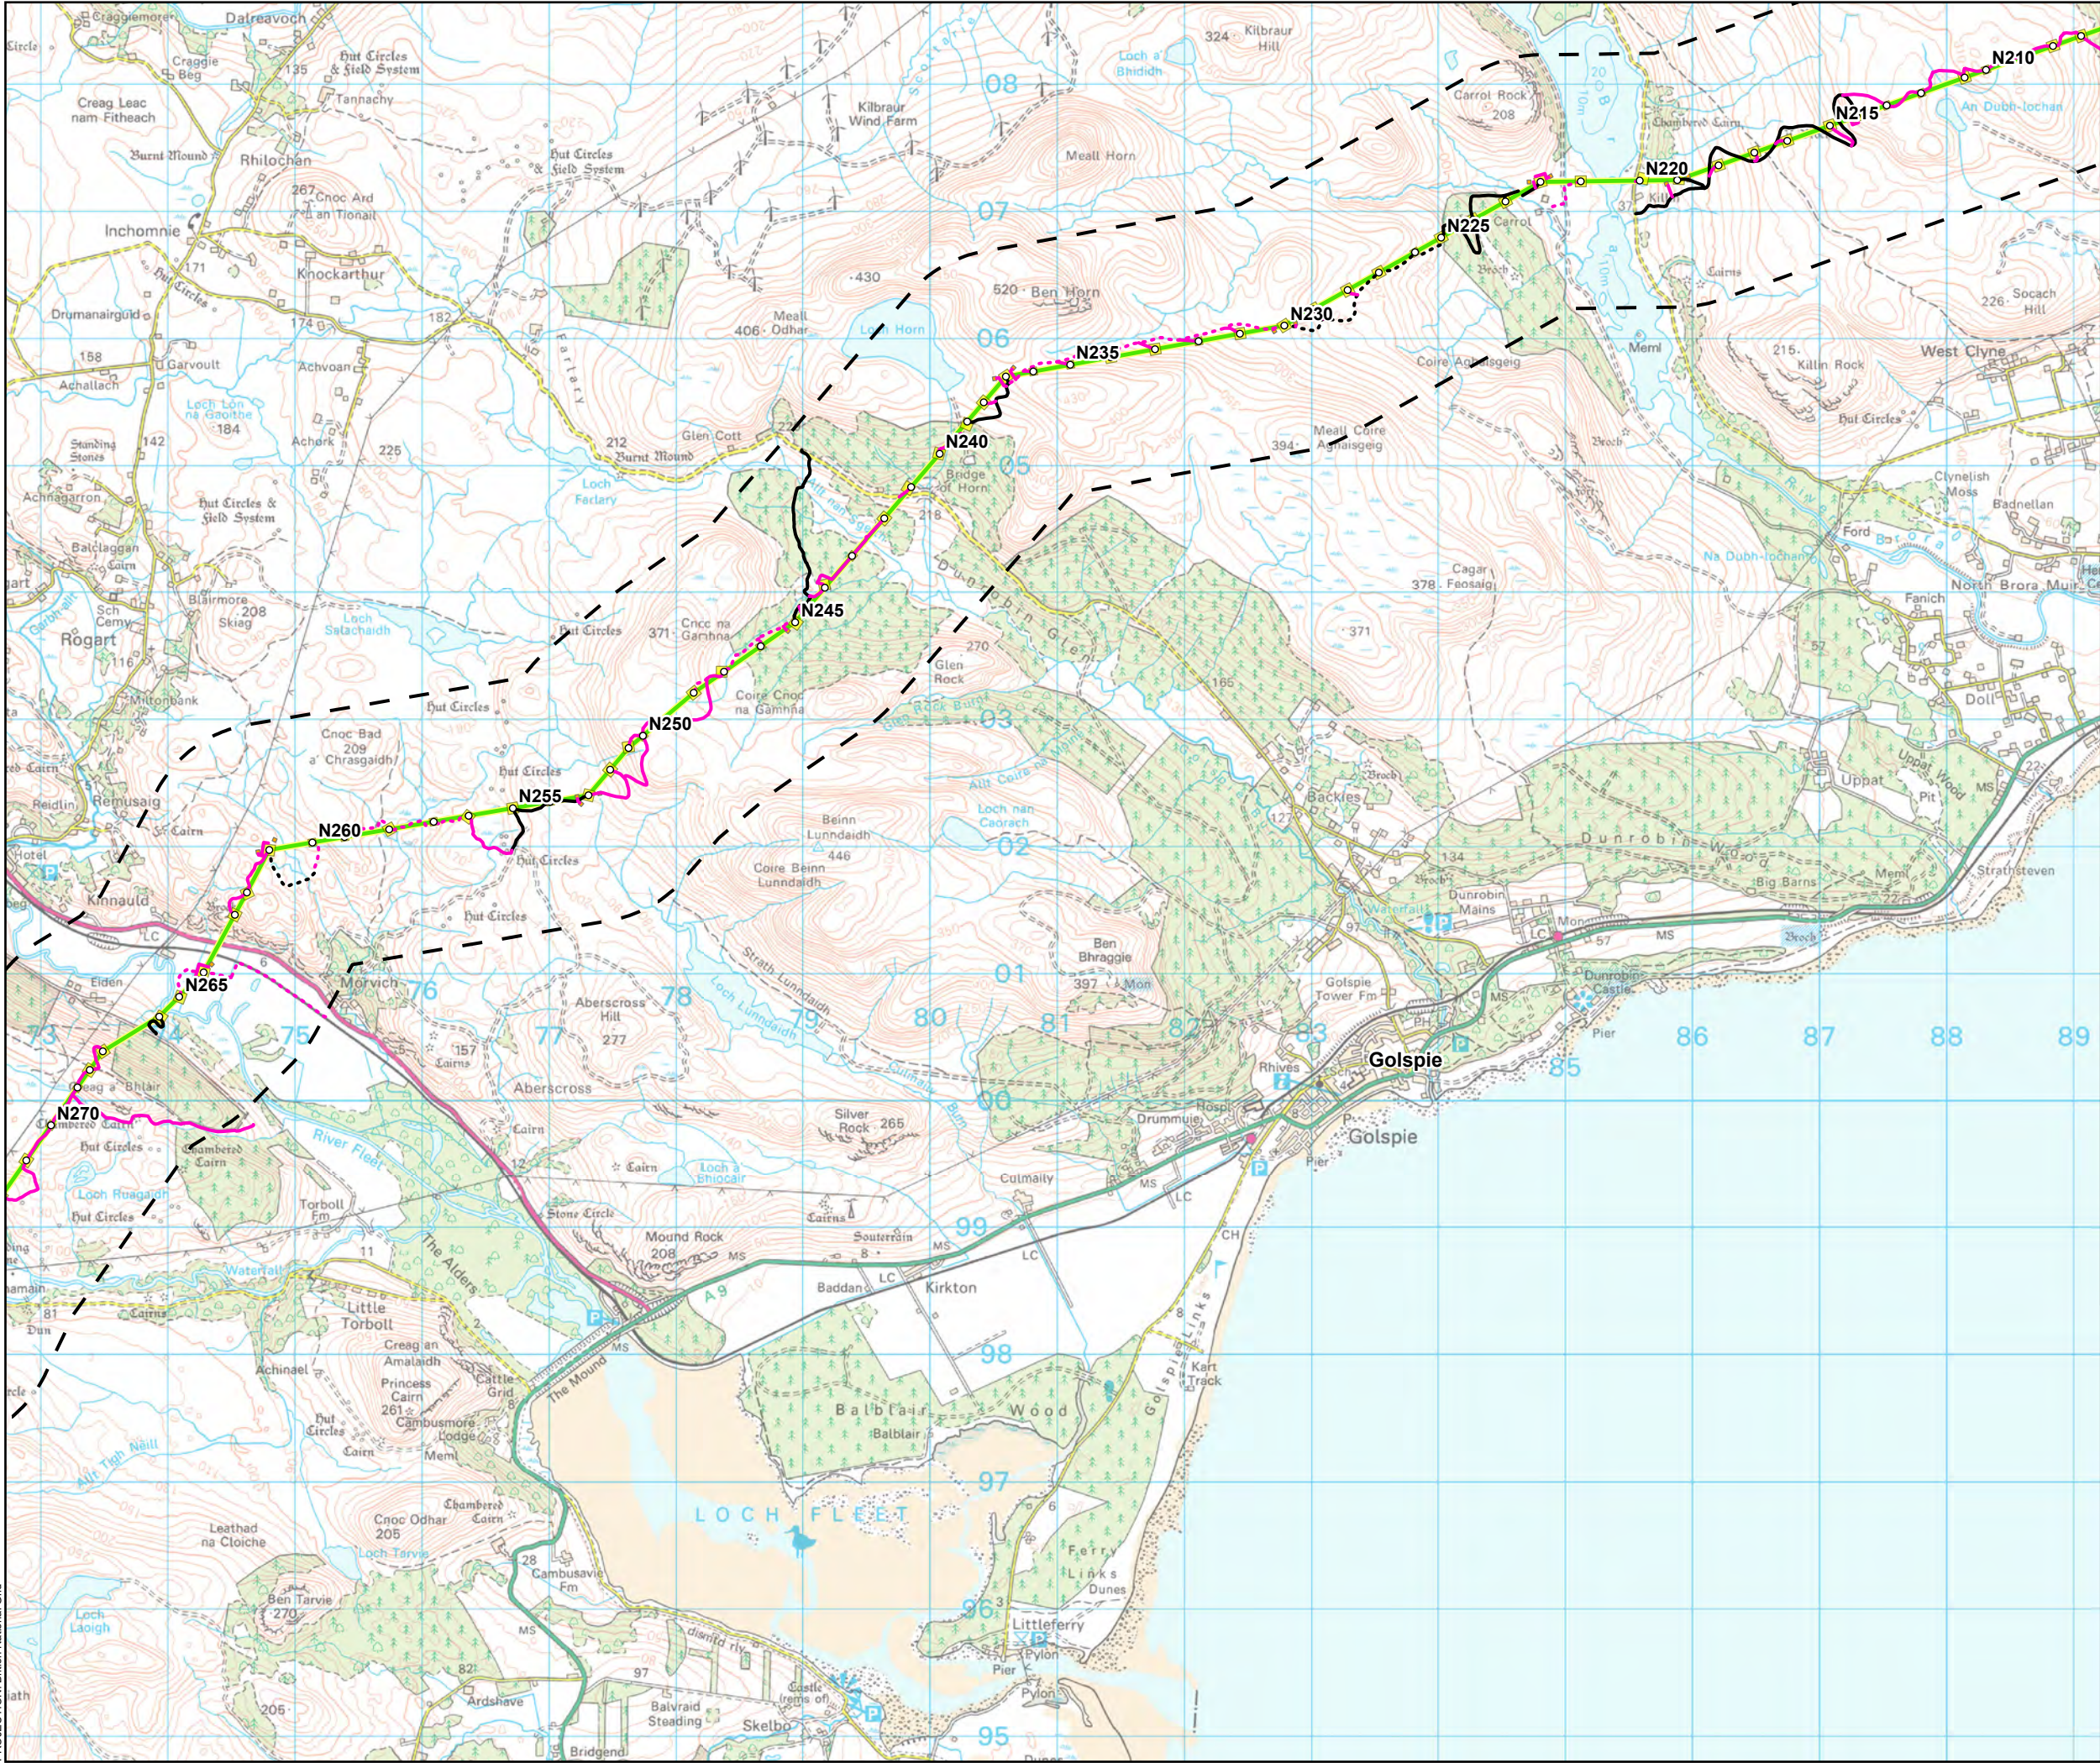


- Tower Location
- Alignment Section B
- Temporary Tower Compound Area
- Equipotential Zone (EPZ) (Pulling Position)
- Temporary Access Track - EPZ
- Temporary Access Track - Cut/Fill
- Temporary Access Track - Floating
- Permanent Access Track - Cut/Fill
- Permanent Access Track - Floating
- Study Area (1 km Buffer)

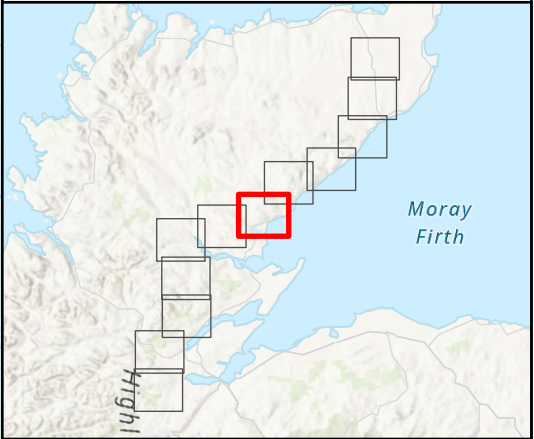



SCALE: See Scale Bar	VERSION: A04
SIZE: A3	DRAWN: JG
PROJECT: 0720281	CHECKED: RD
DATE: 11/08/2025	APPROVED: KG

Figure 10.1 - 6
Spittal - Loch Buidhe - Beaulieu 400 kV OHL
Connection
Water Environment Study Area



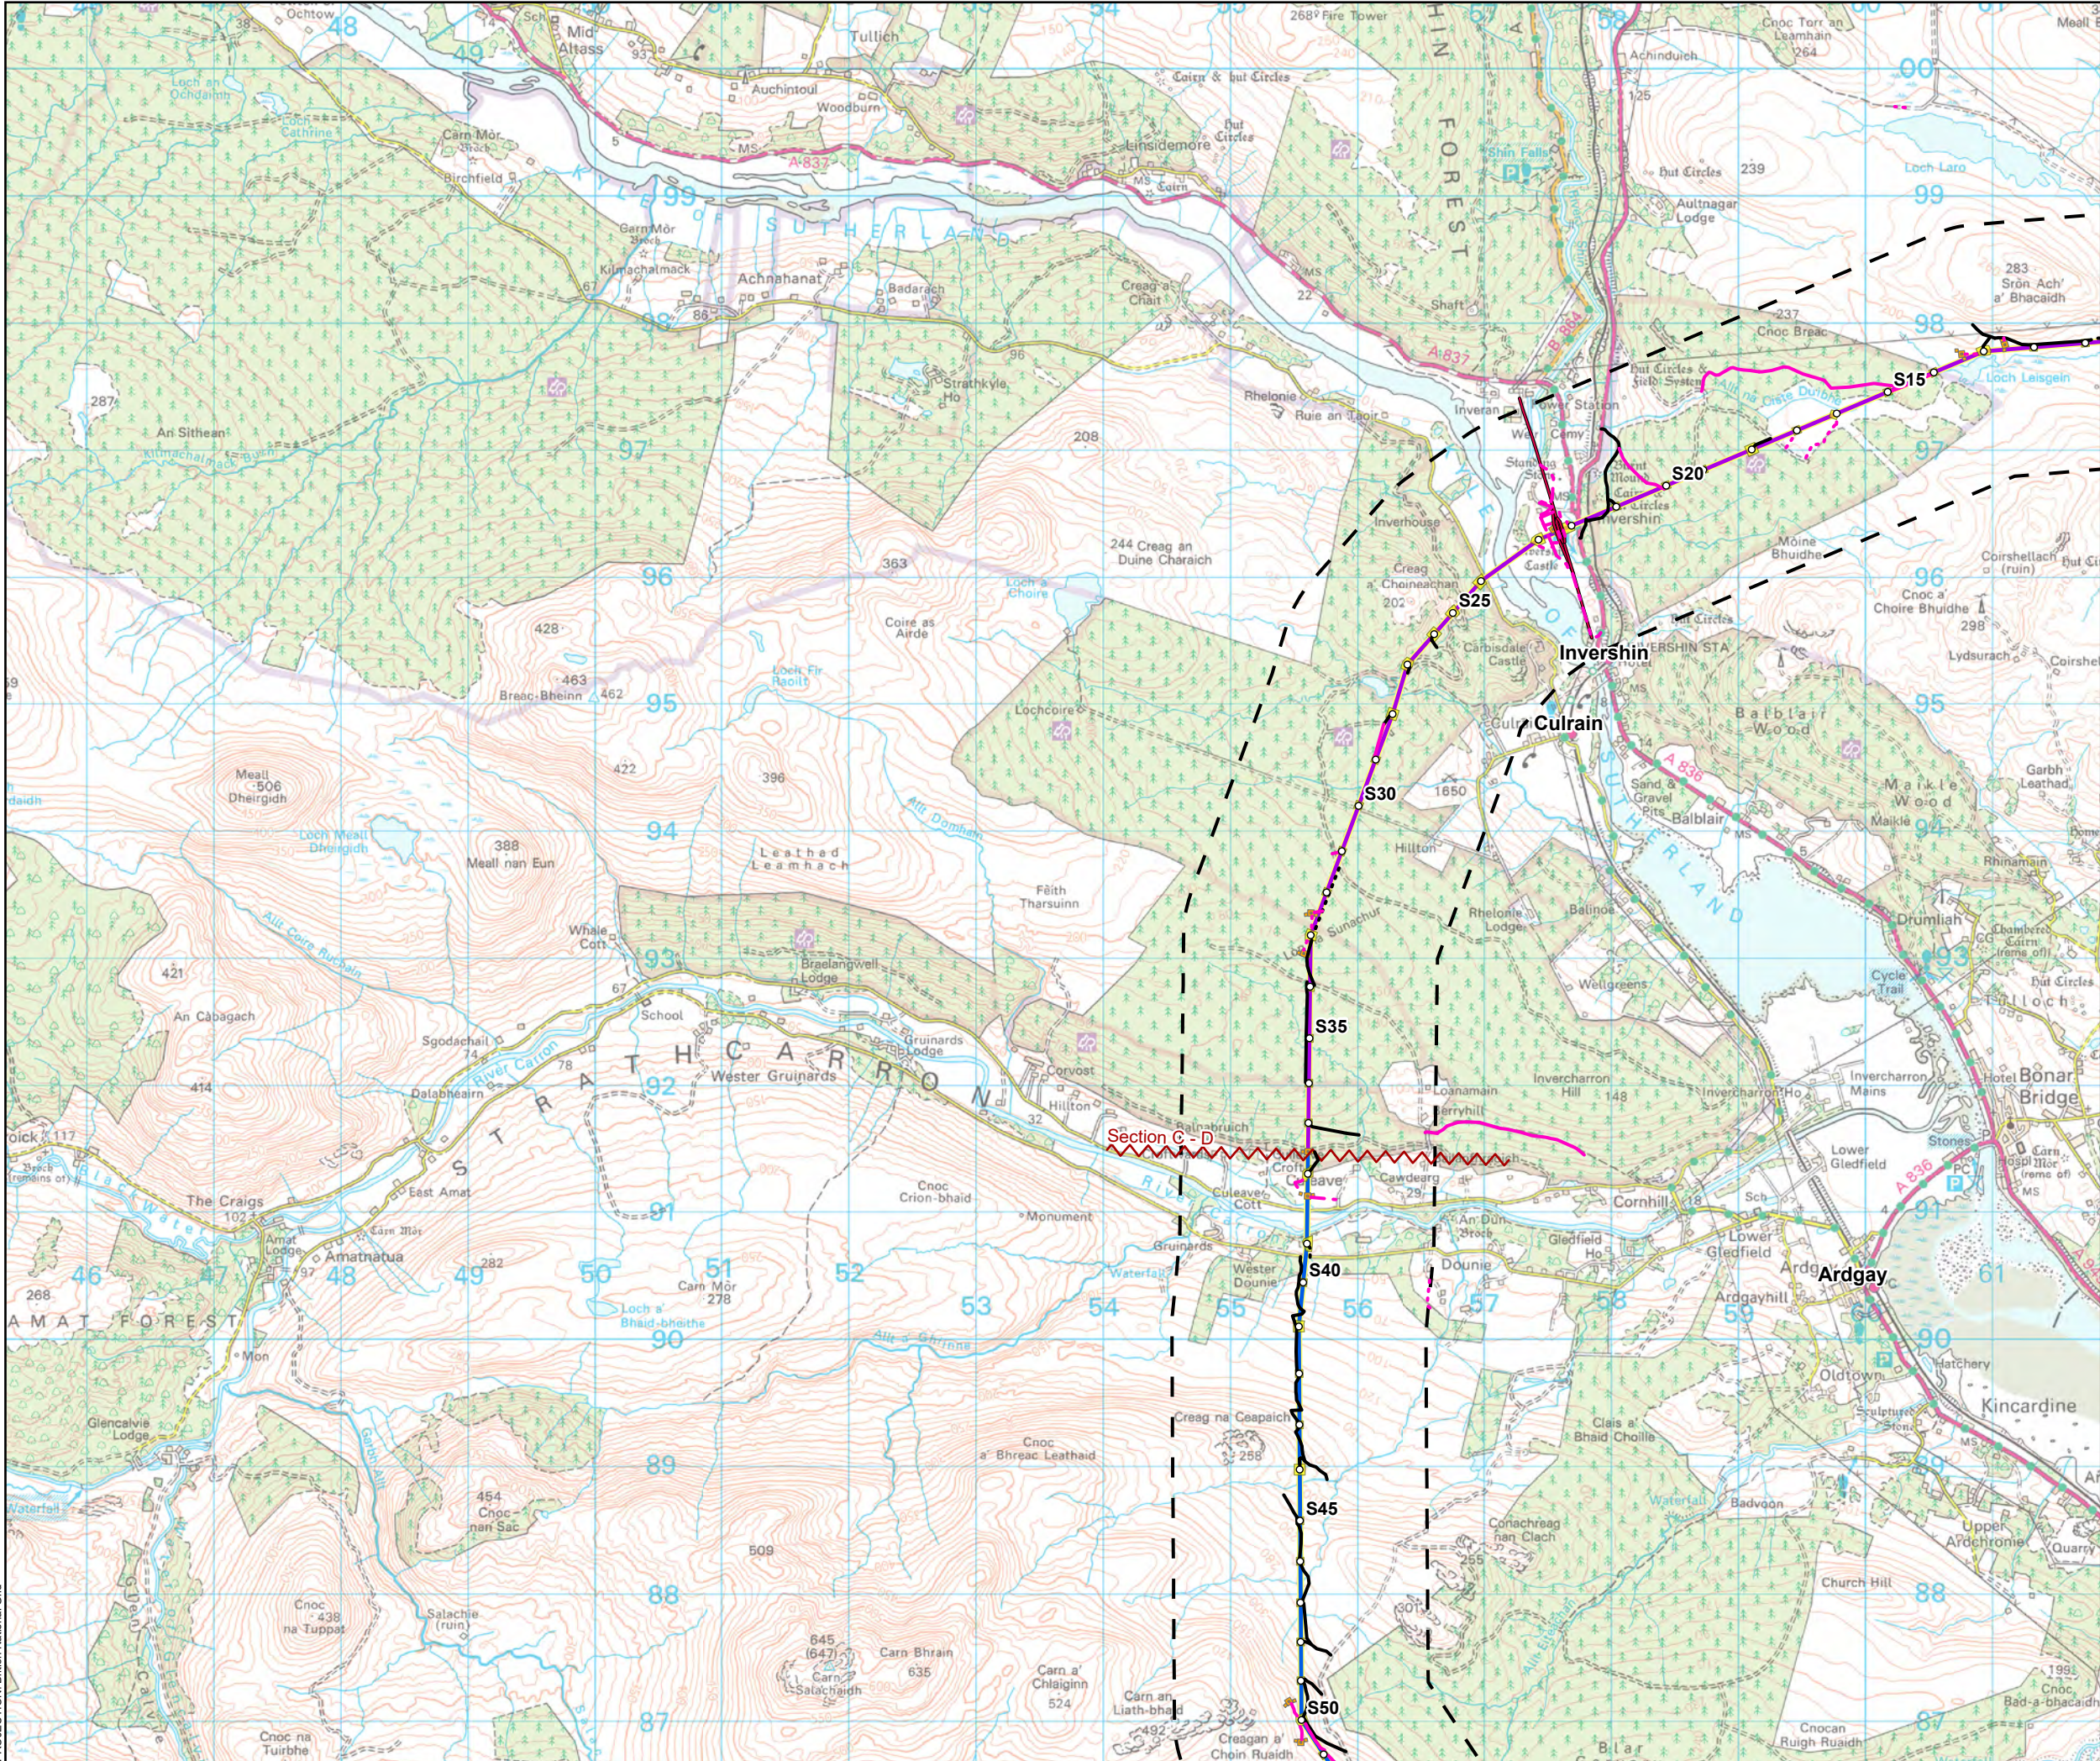


- Tower Location
- Alignment Section C
- Alignment Section D
- Special Arrangement
- Temporary Tower Compound Area
- Equipotential Zone (EPZ) (Pulling Position)
- Temporary Access Track - Trackway Panel
- Temporary Access Track - Cut/Fill
- Temporary Access Track - Floating
- Permanent Access Track - Cut/Fill
- Permanent Access Track - Floating
- Alignment Section Break
- Study Area (1 km Buffer)

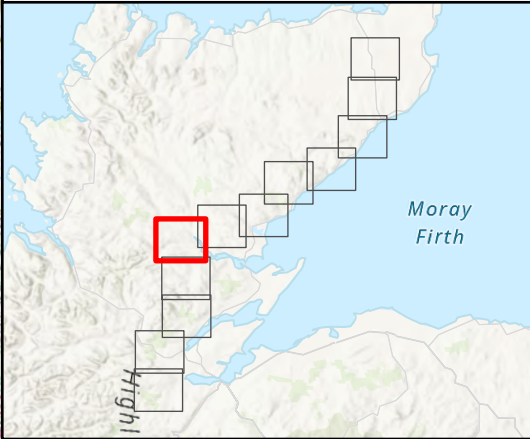



SCALE: See Scale Bar	VERSION: A04
SIZE: A3	DRAWN: JG
PROJECT: 0720281	CHECKED: RD
DATE: 11/08/2025	APPROVED: KG

Figure 10.1 - 8
Spittal - Loch Buidhe - Beaulieu 400 kV OHL
Connection
Water Environment Study Area



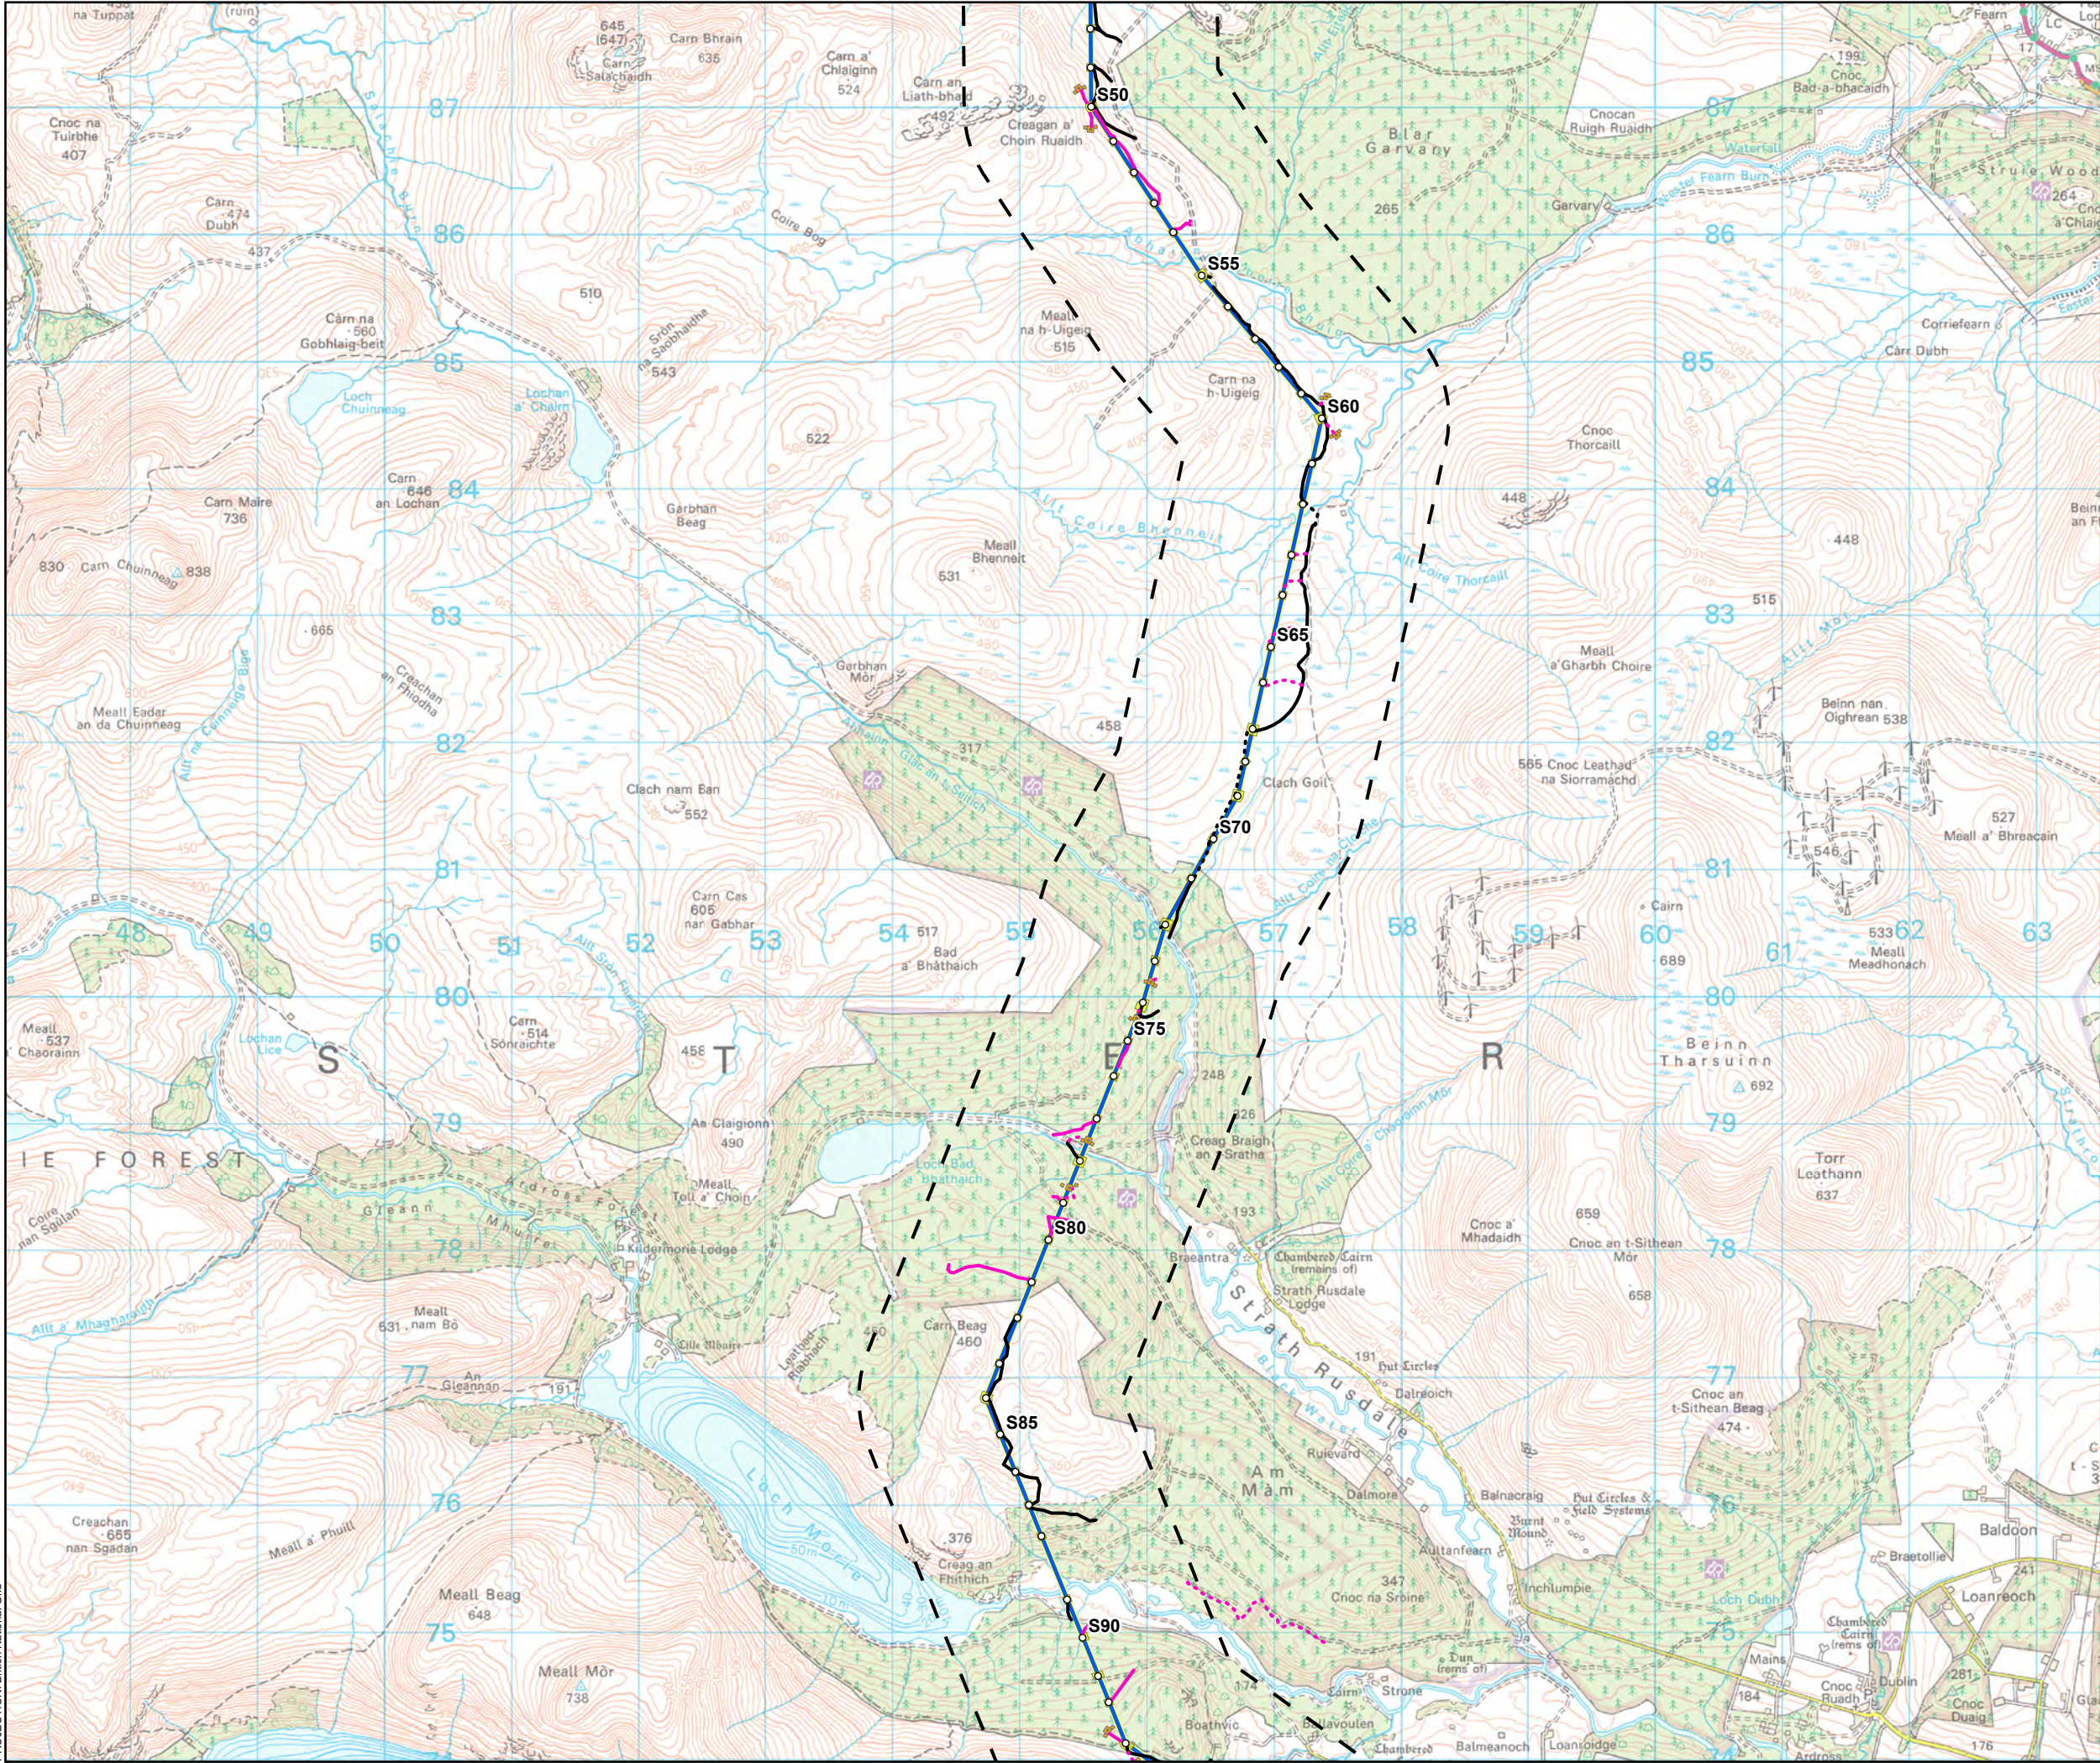


- Tower Location
- Alignment Section D
- Temporary Tower Compound Area
- Equipotential Zone (EPZ) (Pulling Position)
- Temporary Access Track - Cut/Fill
- Temporary Access Track - Floating
- Permanent Access Track - Cut/Fill
- Permanent Access Track - Floating
- Study Area (1 km Buffer)

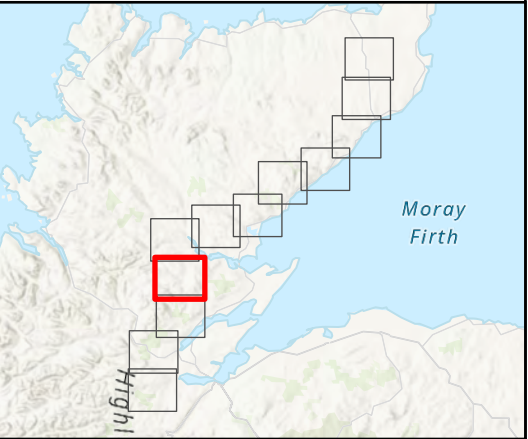



SCALE: See Scale Bar	VERSION: A04
SIZE: A3	DRAWN: JG
PROJECT: 0720281	CHECKED: RD
DATE: 11/08/2025	APPROVED: KG

Figure 10.1 - 9
Spittal - Loch Buidhe - Beaulieu 400 kV OHL
Connection
Water Environment Study Area



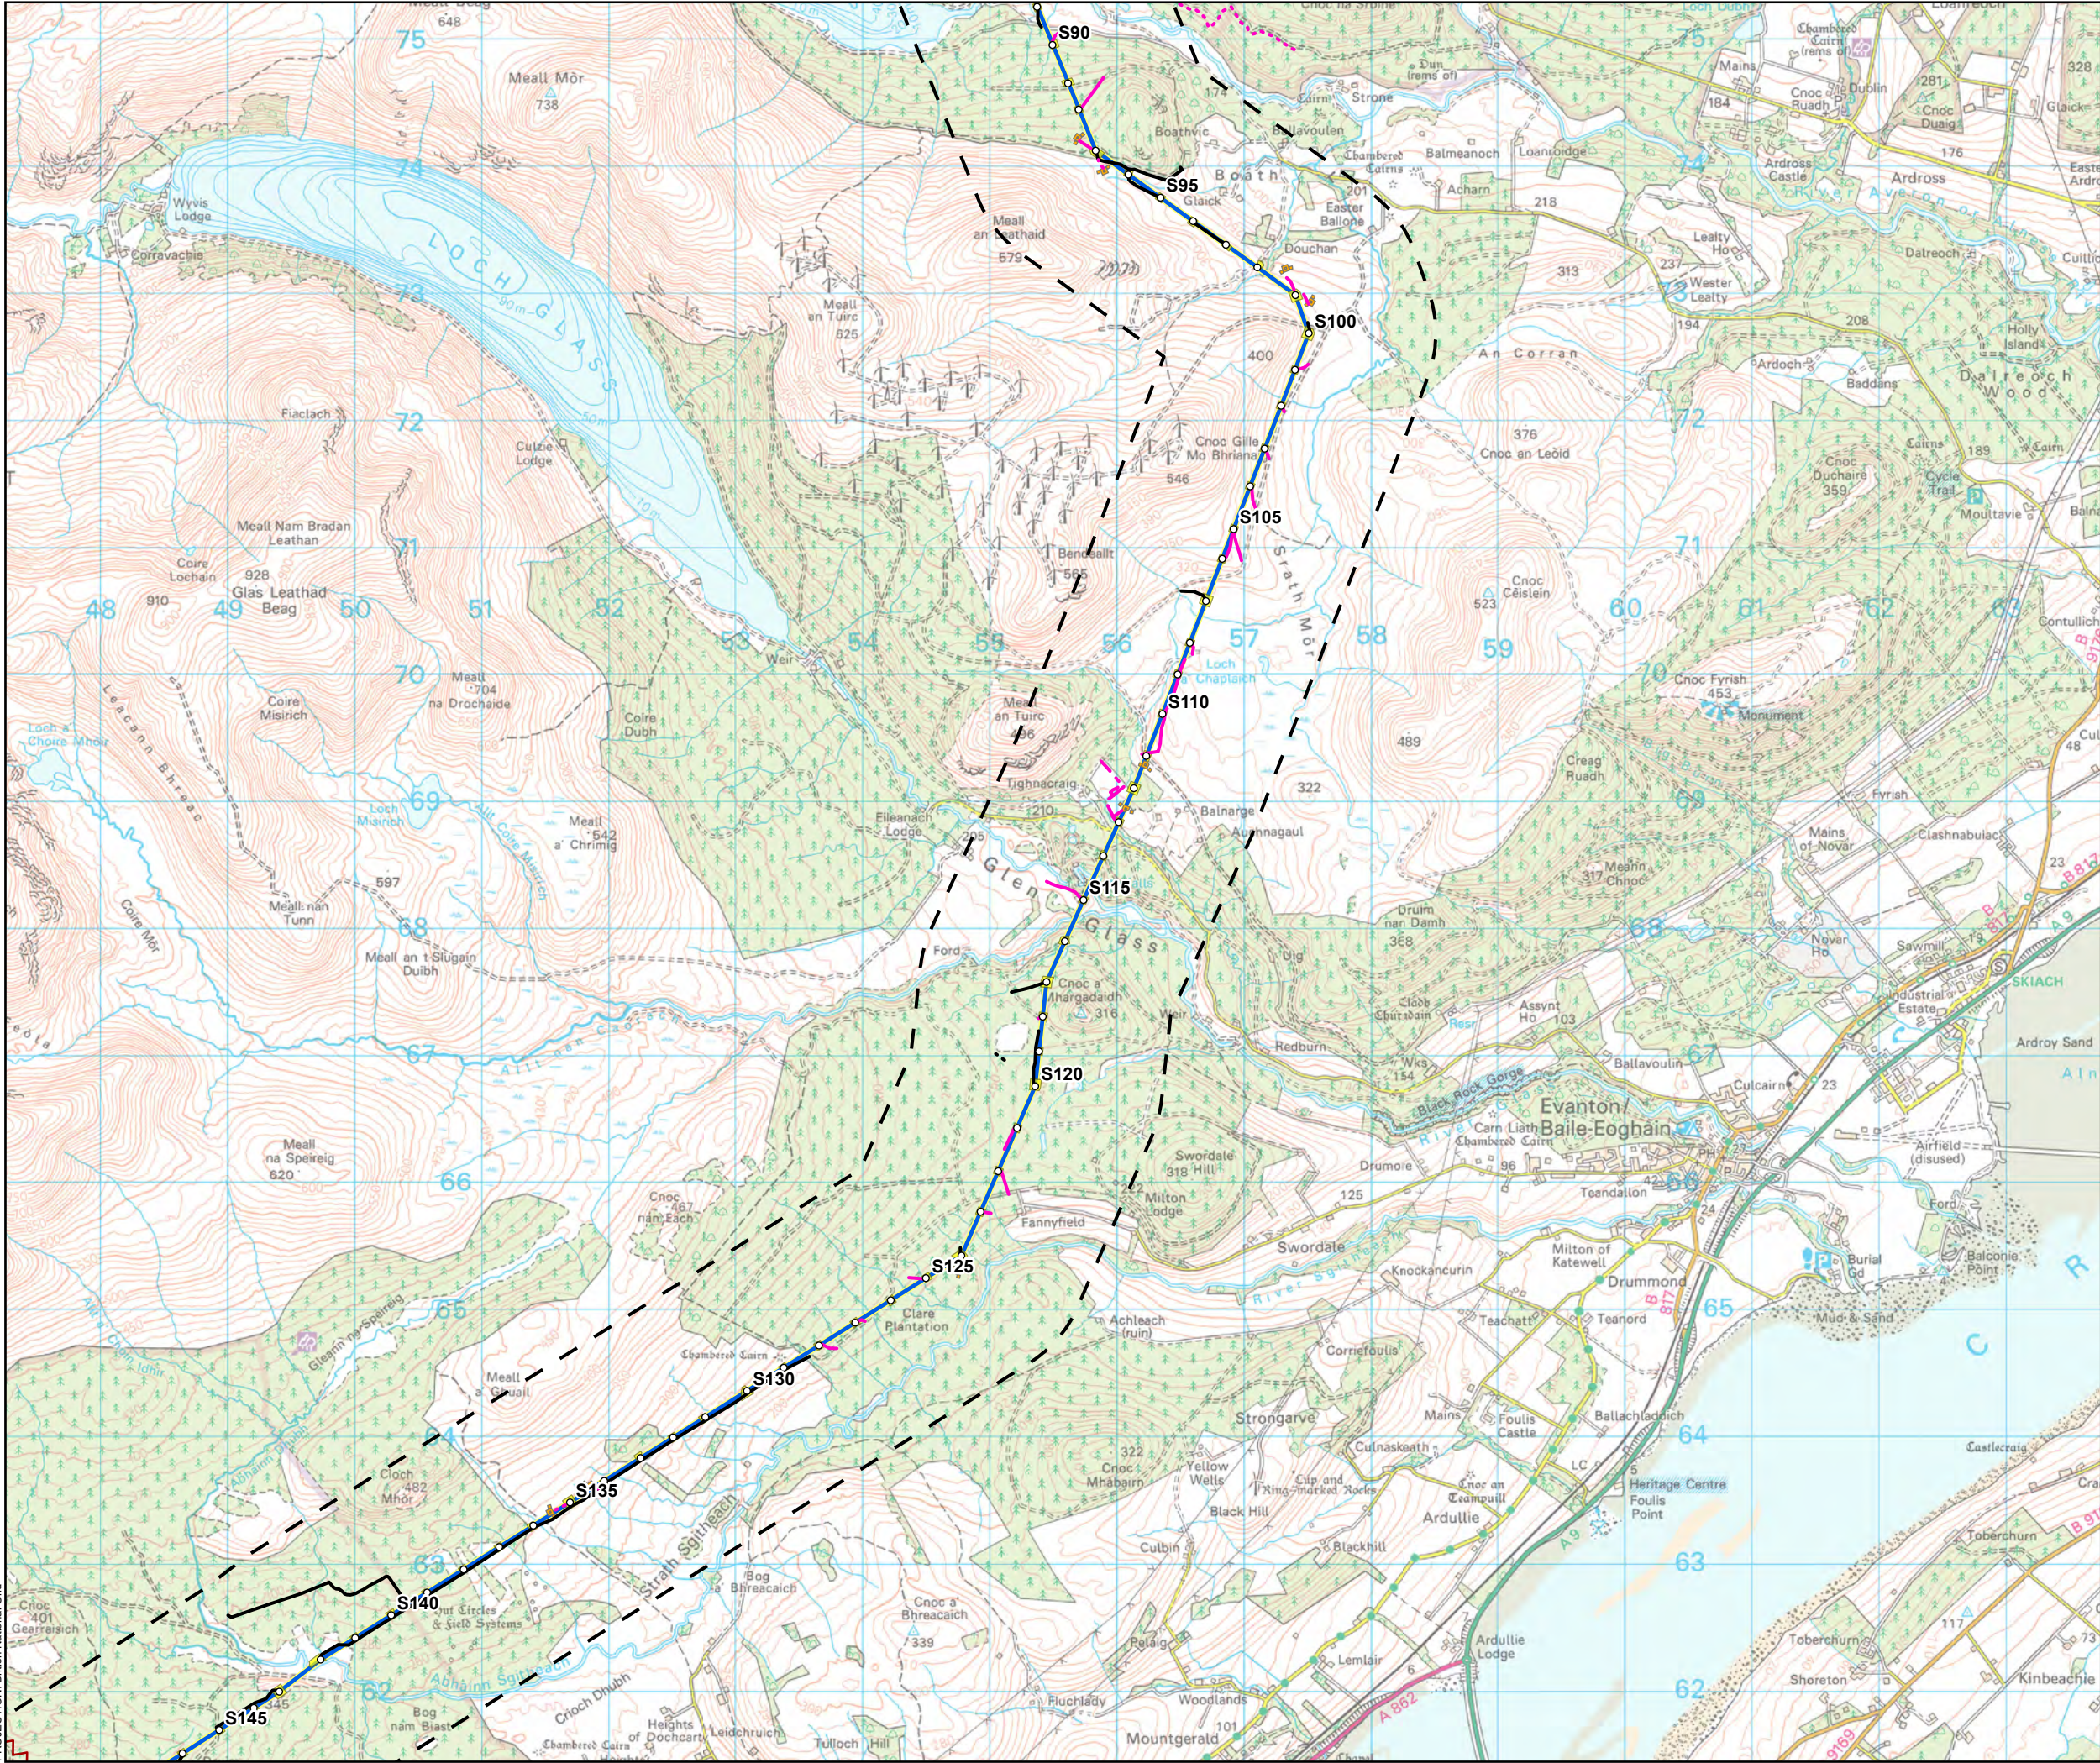

- Tower Location
- Alignment Section D
- Temporary Tower Compound Area
- Equipotential Zone (EPZ) (Pulling Position)
- Temporary Access Track - Trackway Panel
- Temporary Access Track - Cut/Fill
- Temporary Access Track - Floating
- Permanent Access Track - Cut/Fill
- Permanent Access Track - Floating
- Alignment Section Break
- Study Area (1 km Buffer)

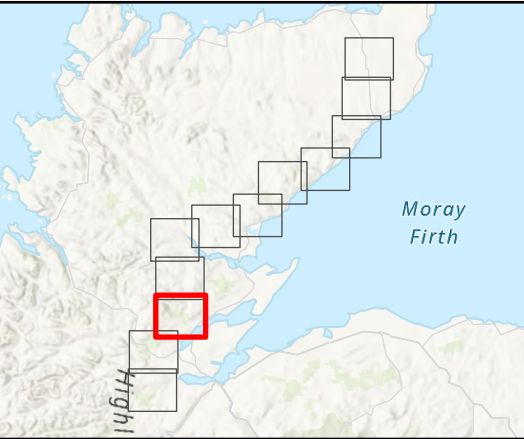

SCALE: See Scale Bar	VERSION: A04
SIZE: A3	DRAWN: JG
PROJECT: 0720281	CHECKED: RD
DATE: 11/08/2025	APPROVED: KG

Figure 10.1 - 10
Spittal - Loch Buidhe - Beauly 400 kV OHL
Connection
Water Environment Study Area