


- Tower Location
- Alignment Section D
- Temporary Tower Compound Area
- Equipotential Zone (EPZ) (Pulling Position)
- - - Temporary Access Track - Trackway Panel
- Temporary Access Track - Cut/Fill
- ⋯ Temporary Access Track - Floating
- Permanent Access Track - Cut/Fill
- ⋯ Permanent Access Track - Floating
- Alignment Section Break
- Study Area (1 km Buffer)
- Stream Network within Study Area (1 km Buffer)
- Surface Watercourse (OS MasterMap)
- Surface Waterbody (OS MasterMap)
- Groundwater Dependency Based On NVC Classification
- High
- Moderate

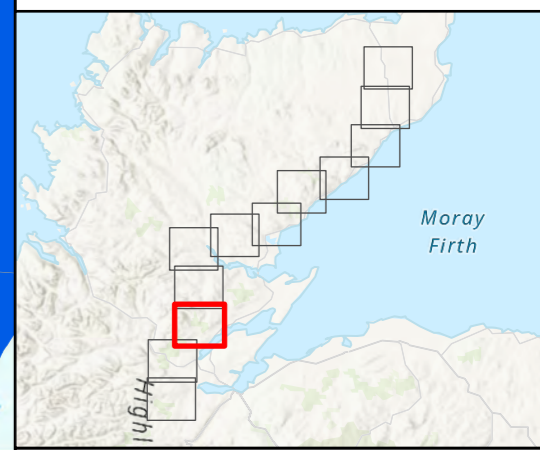


SCALE: See Scale Bar	VERSION: A04
SIZE: A3	DRAWN: JG
PROJECT: 0720281	CHECKED: RD
DATE: 11/08/2025	APPROVED: KG

Figure 10.7 - 10
Spittal - Loch Buidhe - Beaulieu 400 kV OHL
Connection
Groundwater Dependent Terrestrial
Ecosystems



ERM

Scottish & Southern
Electricity Networks
TRANSMISSION

PROJECTION: British National Grid

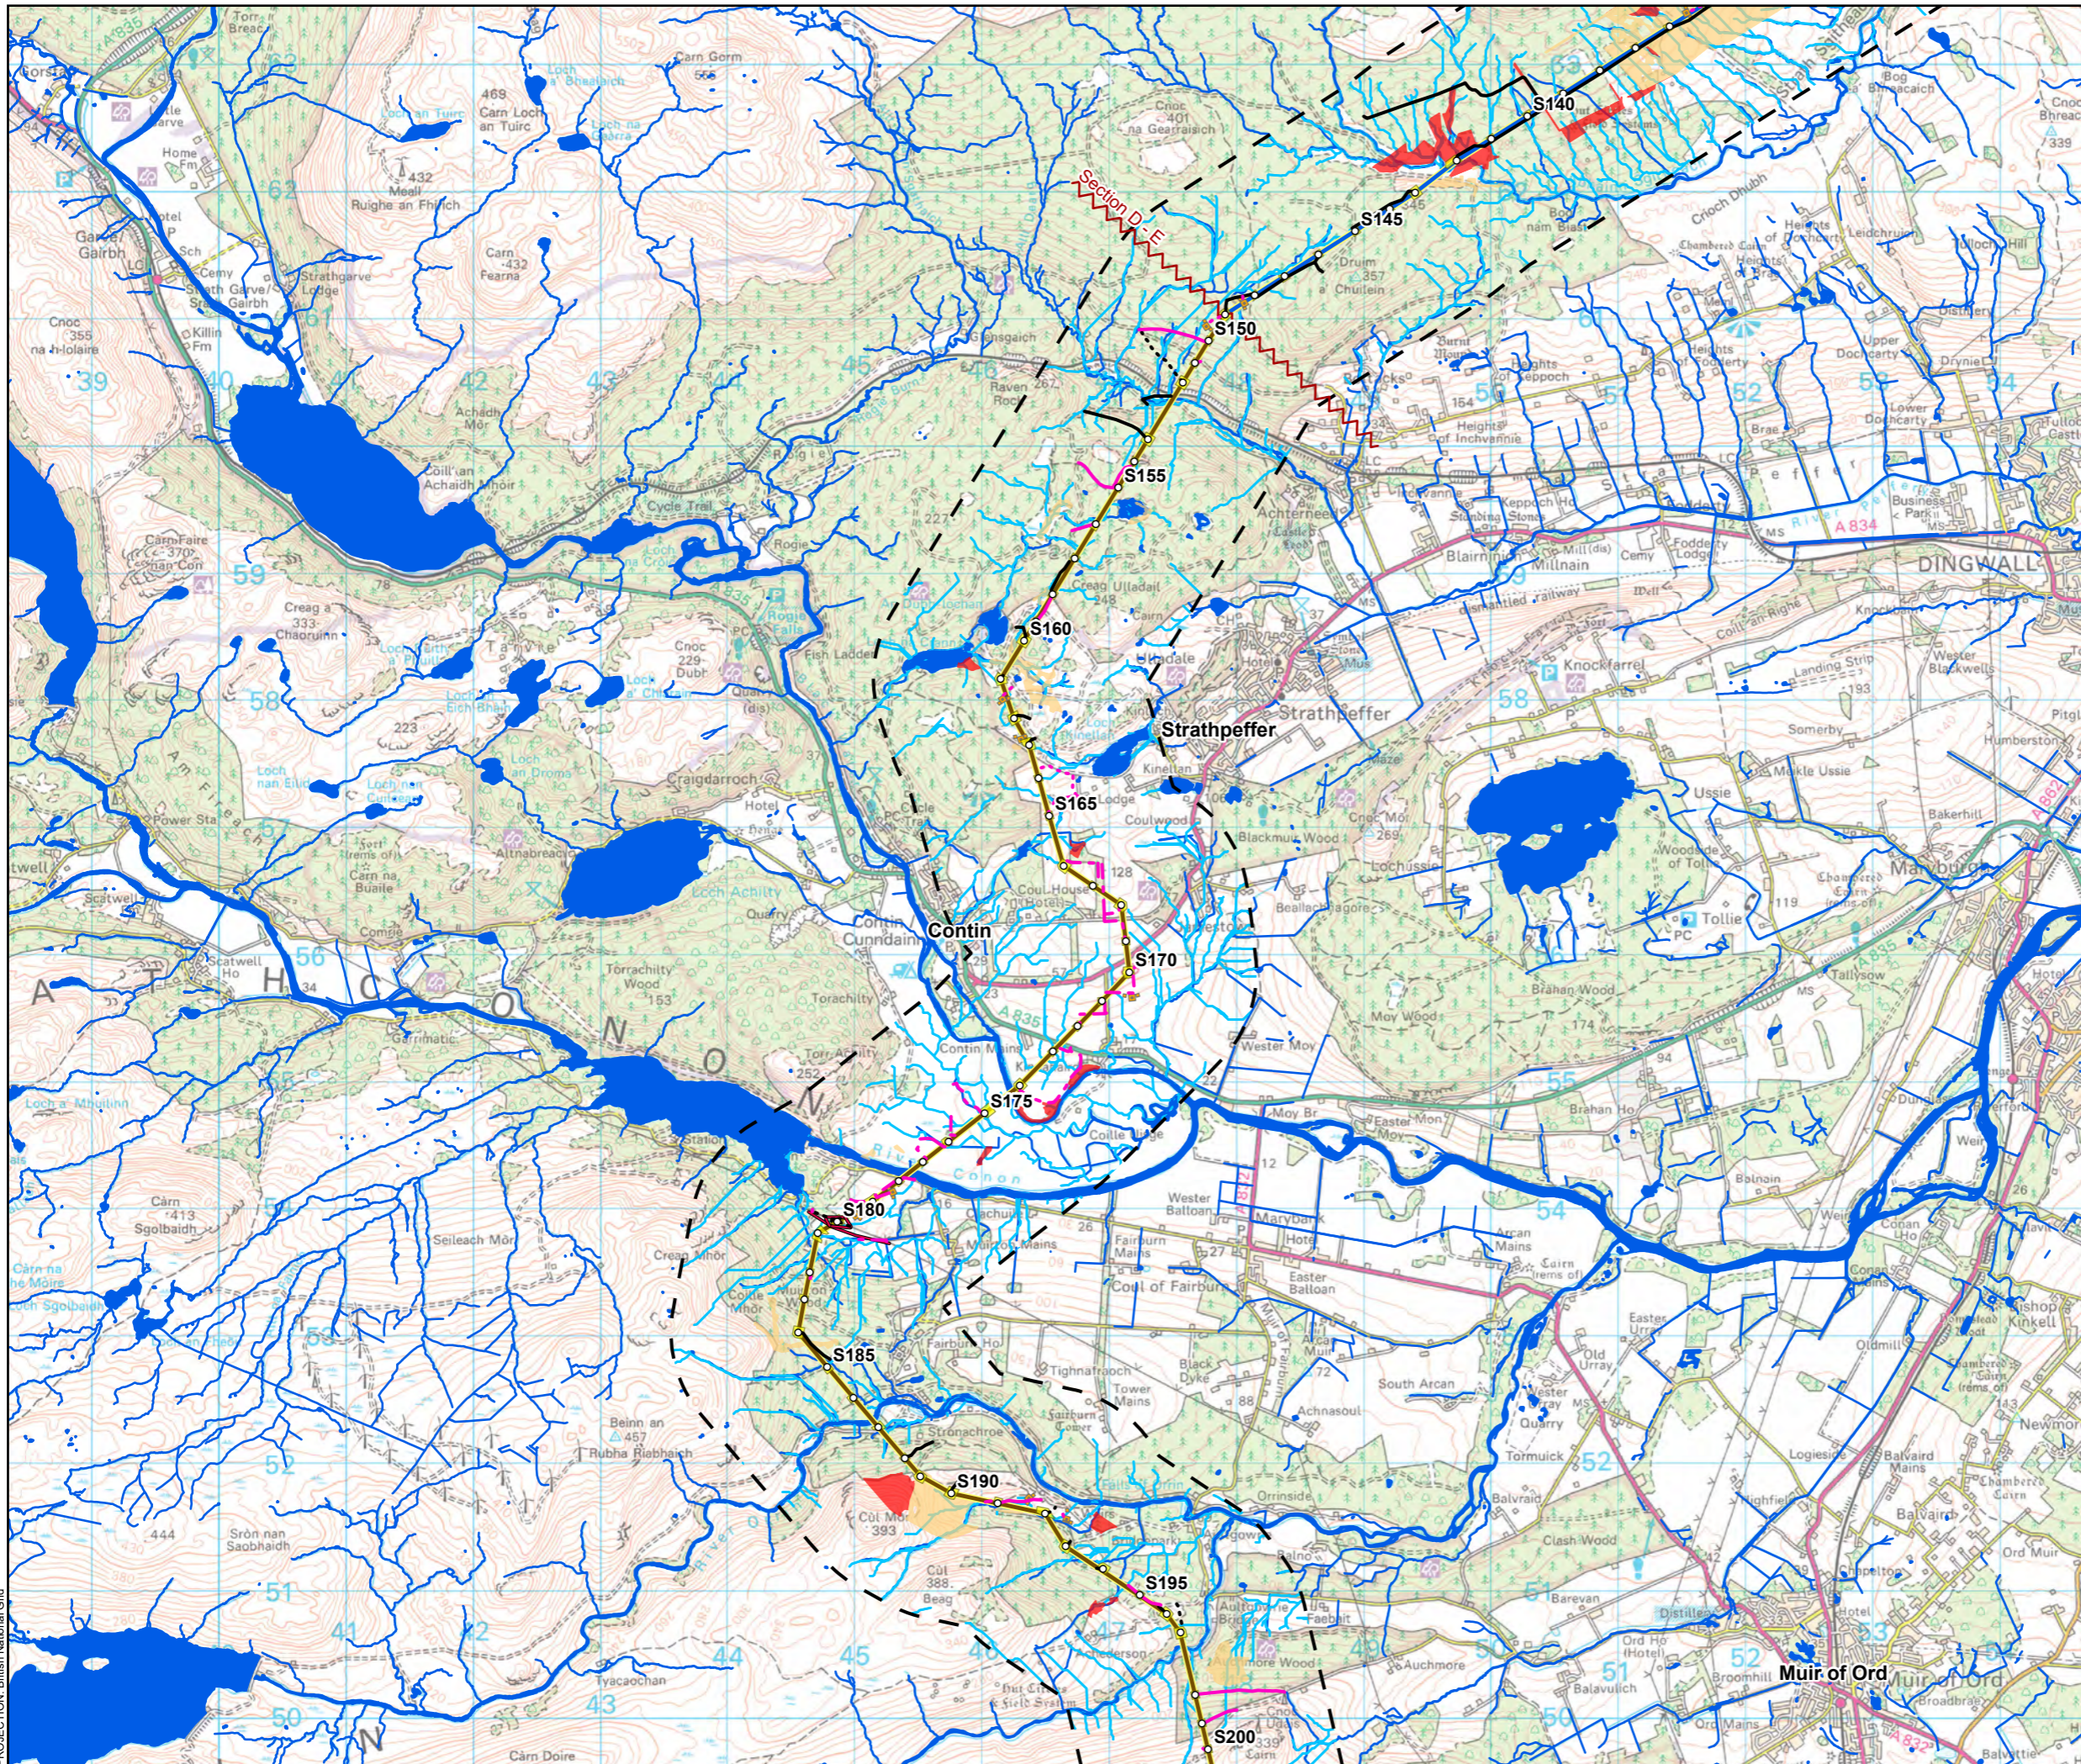

- Tower Location
 - Alignment Section D
 - Alignment Section E
 - Special Arrangement
 - Temporary Tower Compound Area
 - Equipotential Zone (EPZ) (Pulling Position)
 - Temporary Access Track - Trackway Panel
 - Temporary Access Track - Cut/Fill
 - Temporary Access Track - Floating
 - Permanent Access Track - Cut/Fill
 - Permanent Access Track - Floating
 - Alignment Section Break
 - Study Area (1 km Buffer)
 - Stream Network within Study Area (1 km Buffer)
 - Surface Watercourse (OS MasterMap)
 - Surface Waterbody (OS MasterMap)
- Groundwater Dependency Based On NVC Classification
- High
 - Moderate

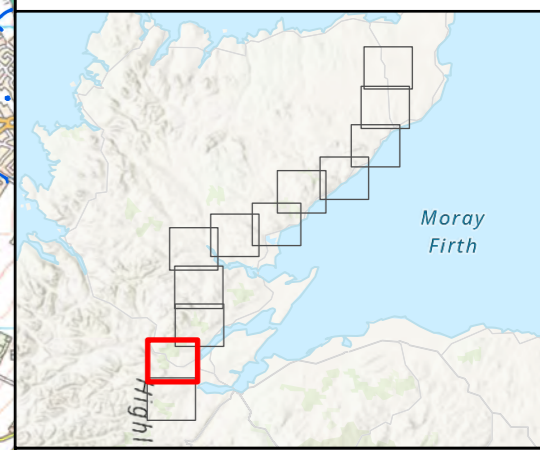


SCALE: See Scale Bar	VERSION: A04
SIZE: A3	DRAWN: JG
PROJECT: 0720281	CHECKED: RD
DATE: 11/08/2025	APPROVED: KG

Figure 10.7 - 11
Spittal - Loch Buidhe - Beauly 400 kV OHL Connection
Groundwater Dependent Terrestrial Ecosystems



ERM

Scottish & Southern
Electricity Networks
TRANSMISSION

PROJECTION: British National Grid

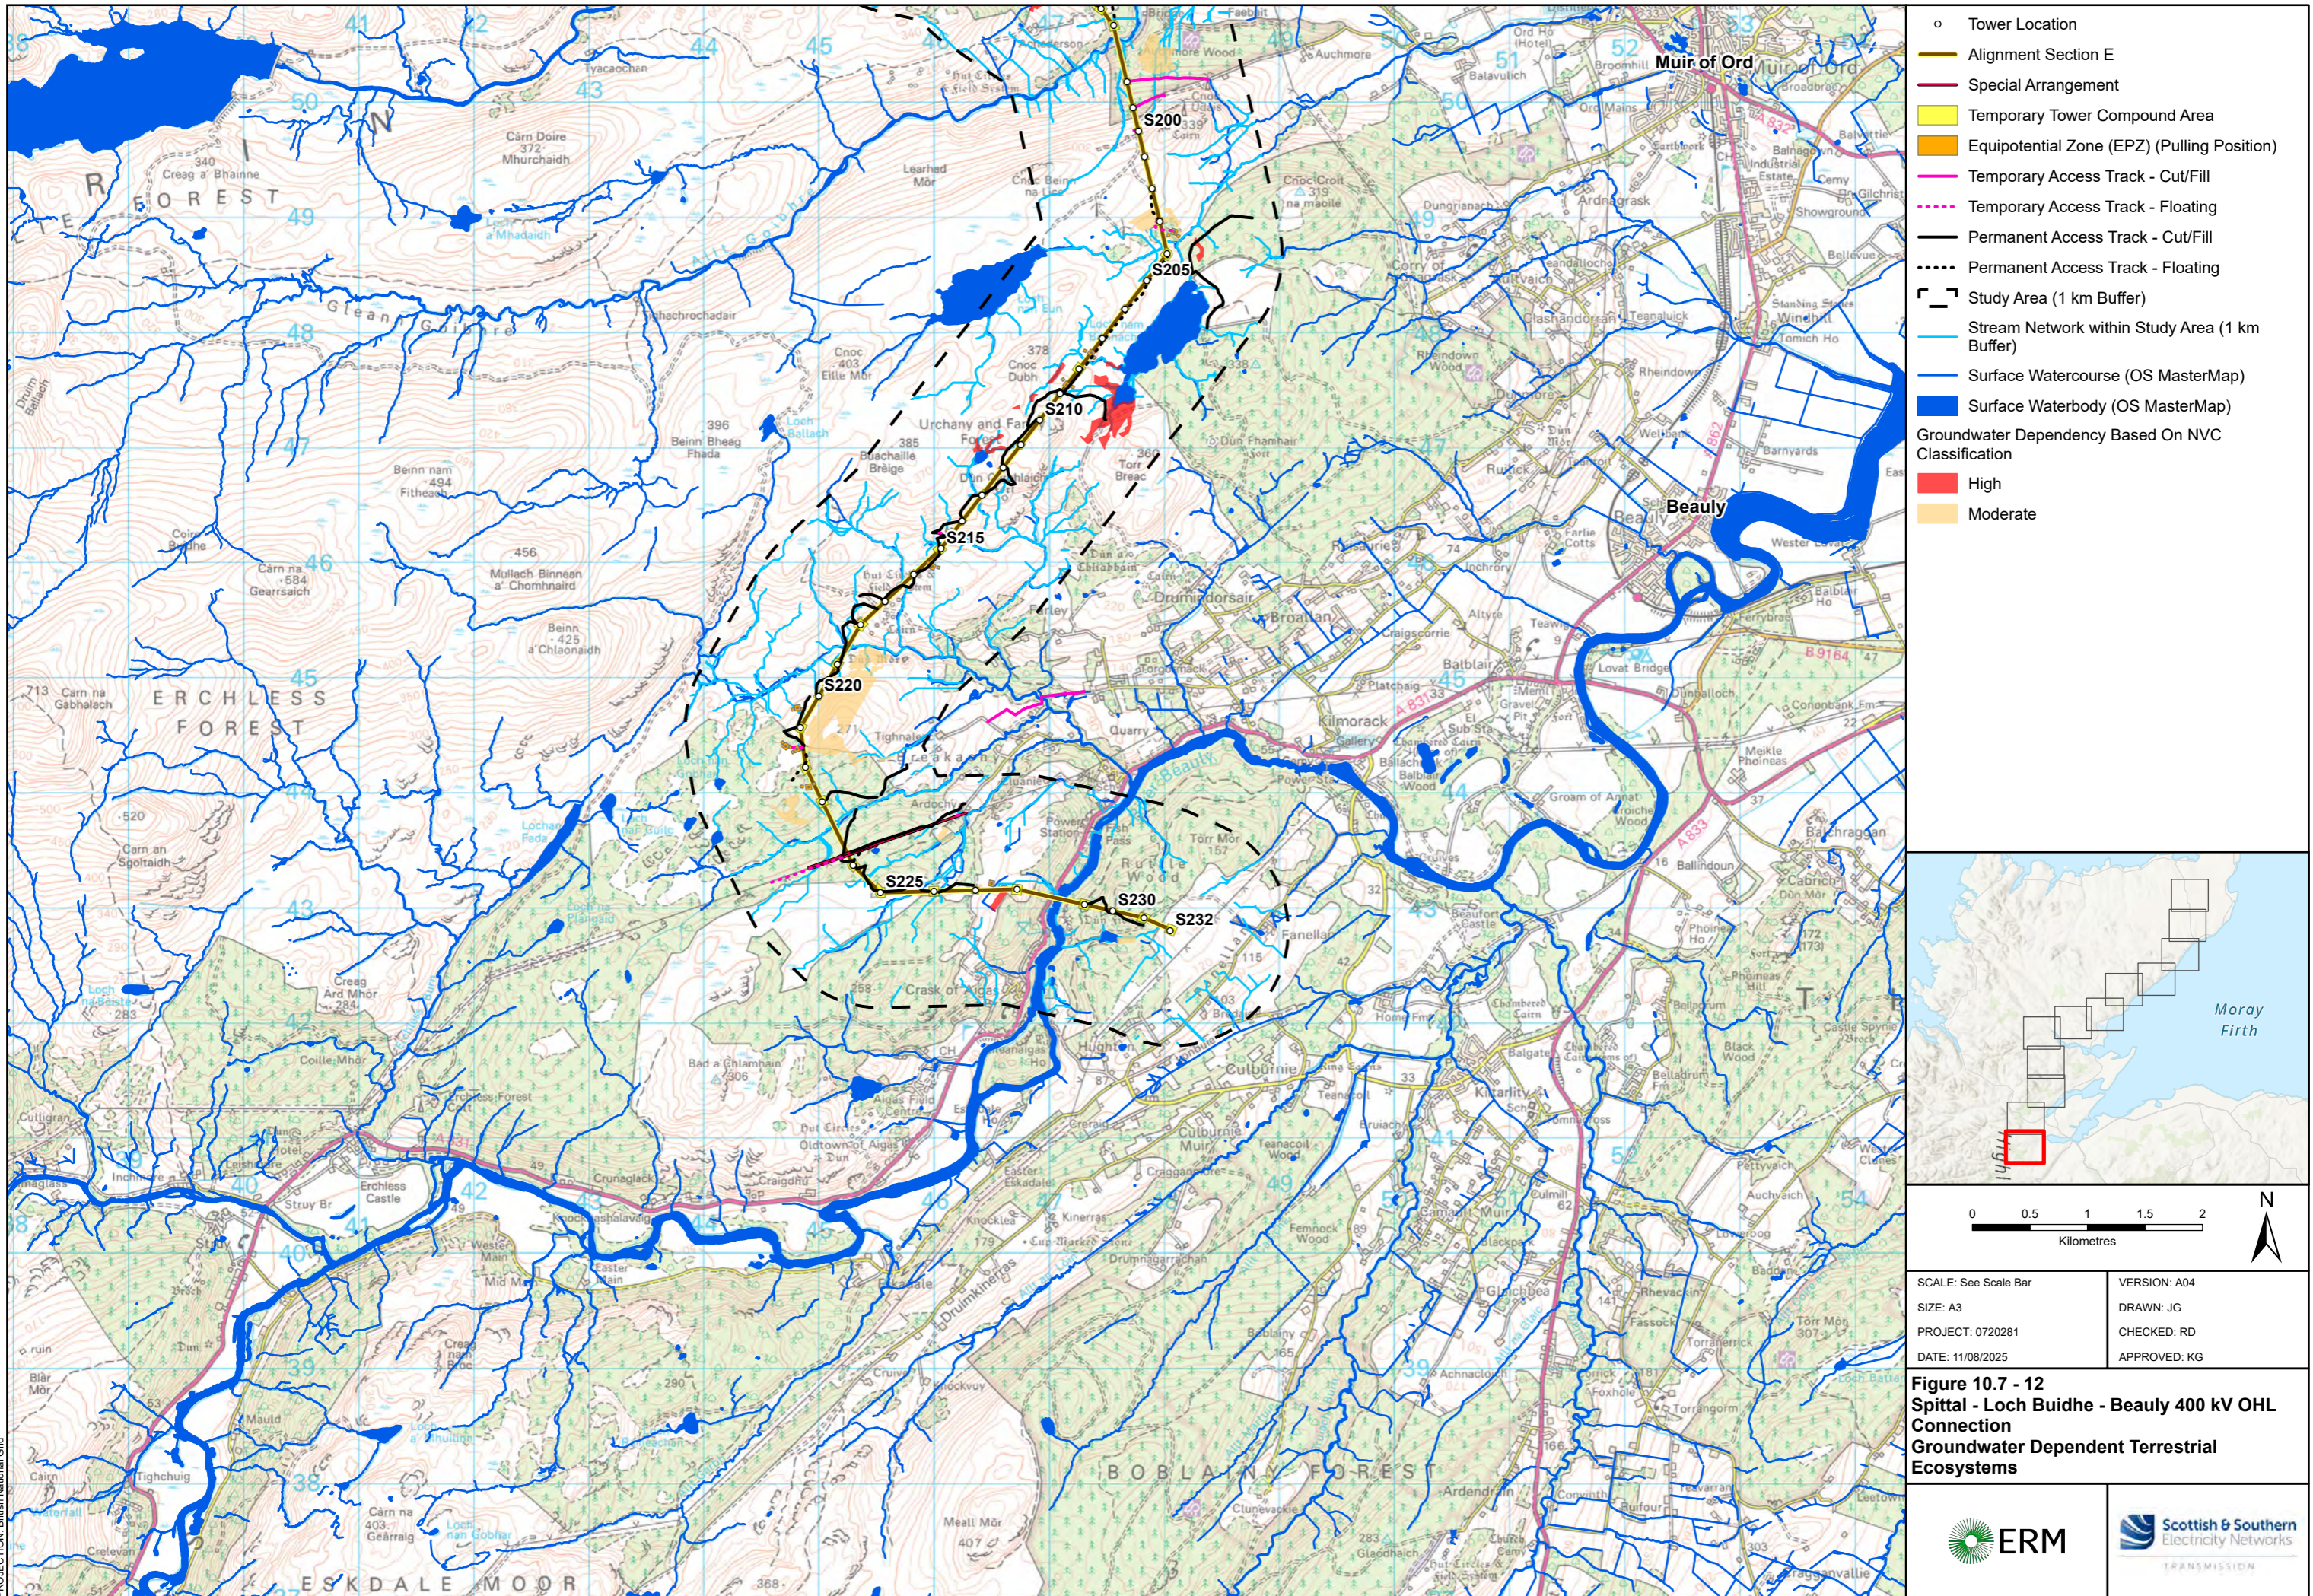

- Tower Location
 - Alignment Section E
 - Special Arrangement
 - Temporary Tower Compound Area
 - Equipotential Zone (EPZ) (Pulling Position)
 - Temporary Access Track - Cut/Fill
 - Temporary Access Track - Floating
 - Permanent Access Track - Cut/Fill
 - Permanent Access Track - Floating
 - Study Area (1 km Buffer)
 - Stream Network within Study Area (1 km Buffer)
 - Surface Watercourse (OS MasterMap)
 - Surface Waterbody (OS MasterMap)
- Groundwater Dependency Based On NVC Classification
- High
 - Moderate

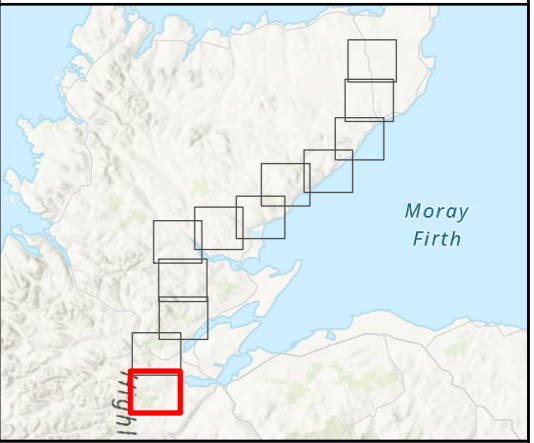

SCALE: See Scale Bar	VERSION: A04
SIZE: A3	DRAWN: JG
PROJECT: 0720281	CHECKED: RD
DATE: 11/08/2025	APPROVED: KG

Figure 10.7 - 12
Spittal - Loch Buidhe - Beaully 400 kV OHL
Connection
Groundwater Dependent Terrestrial
Ecosystems



PROJECTION: British National Grid