



- Tower Location
- Alignment Section
- Alignment Section A
- ⊠ Study Area (500m buffer from LoD)
- Noise Sensitive Receptors




SCALE: See Scale Bar	VERSION: A01
SIZE: A3	DRAWN: CI
PROJECT: 0652629	CHECKED: ES
DATE: 8/12/2025	APPROVED: KG



Figure 15.1 - 1
Spittal - Loch Buidhe - Beaulieu
400 kV OHL Connection
Noise Sensitive Receptors

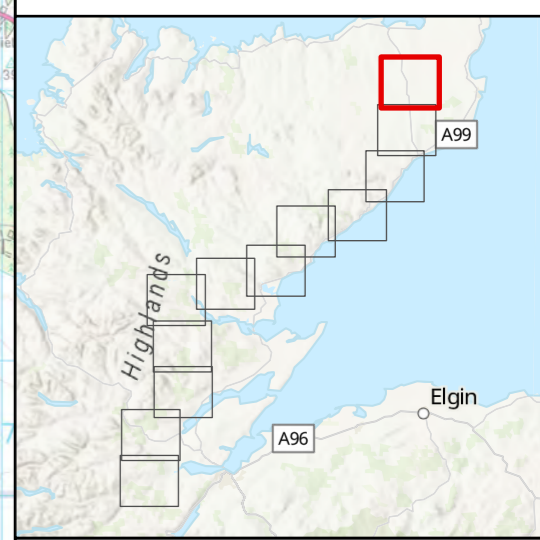

PROJECTION: British National Grid

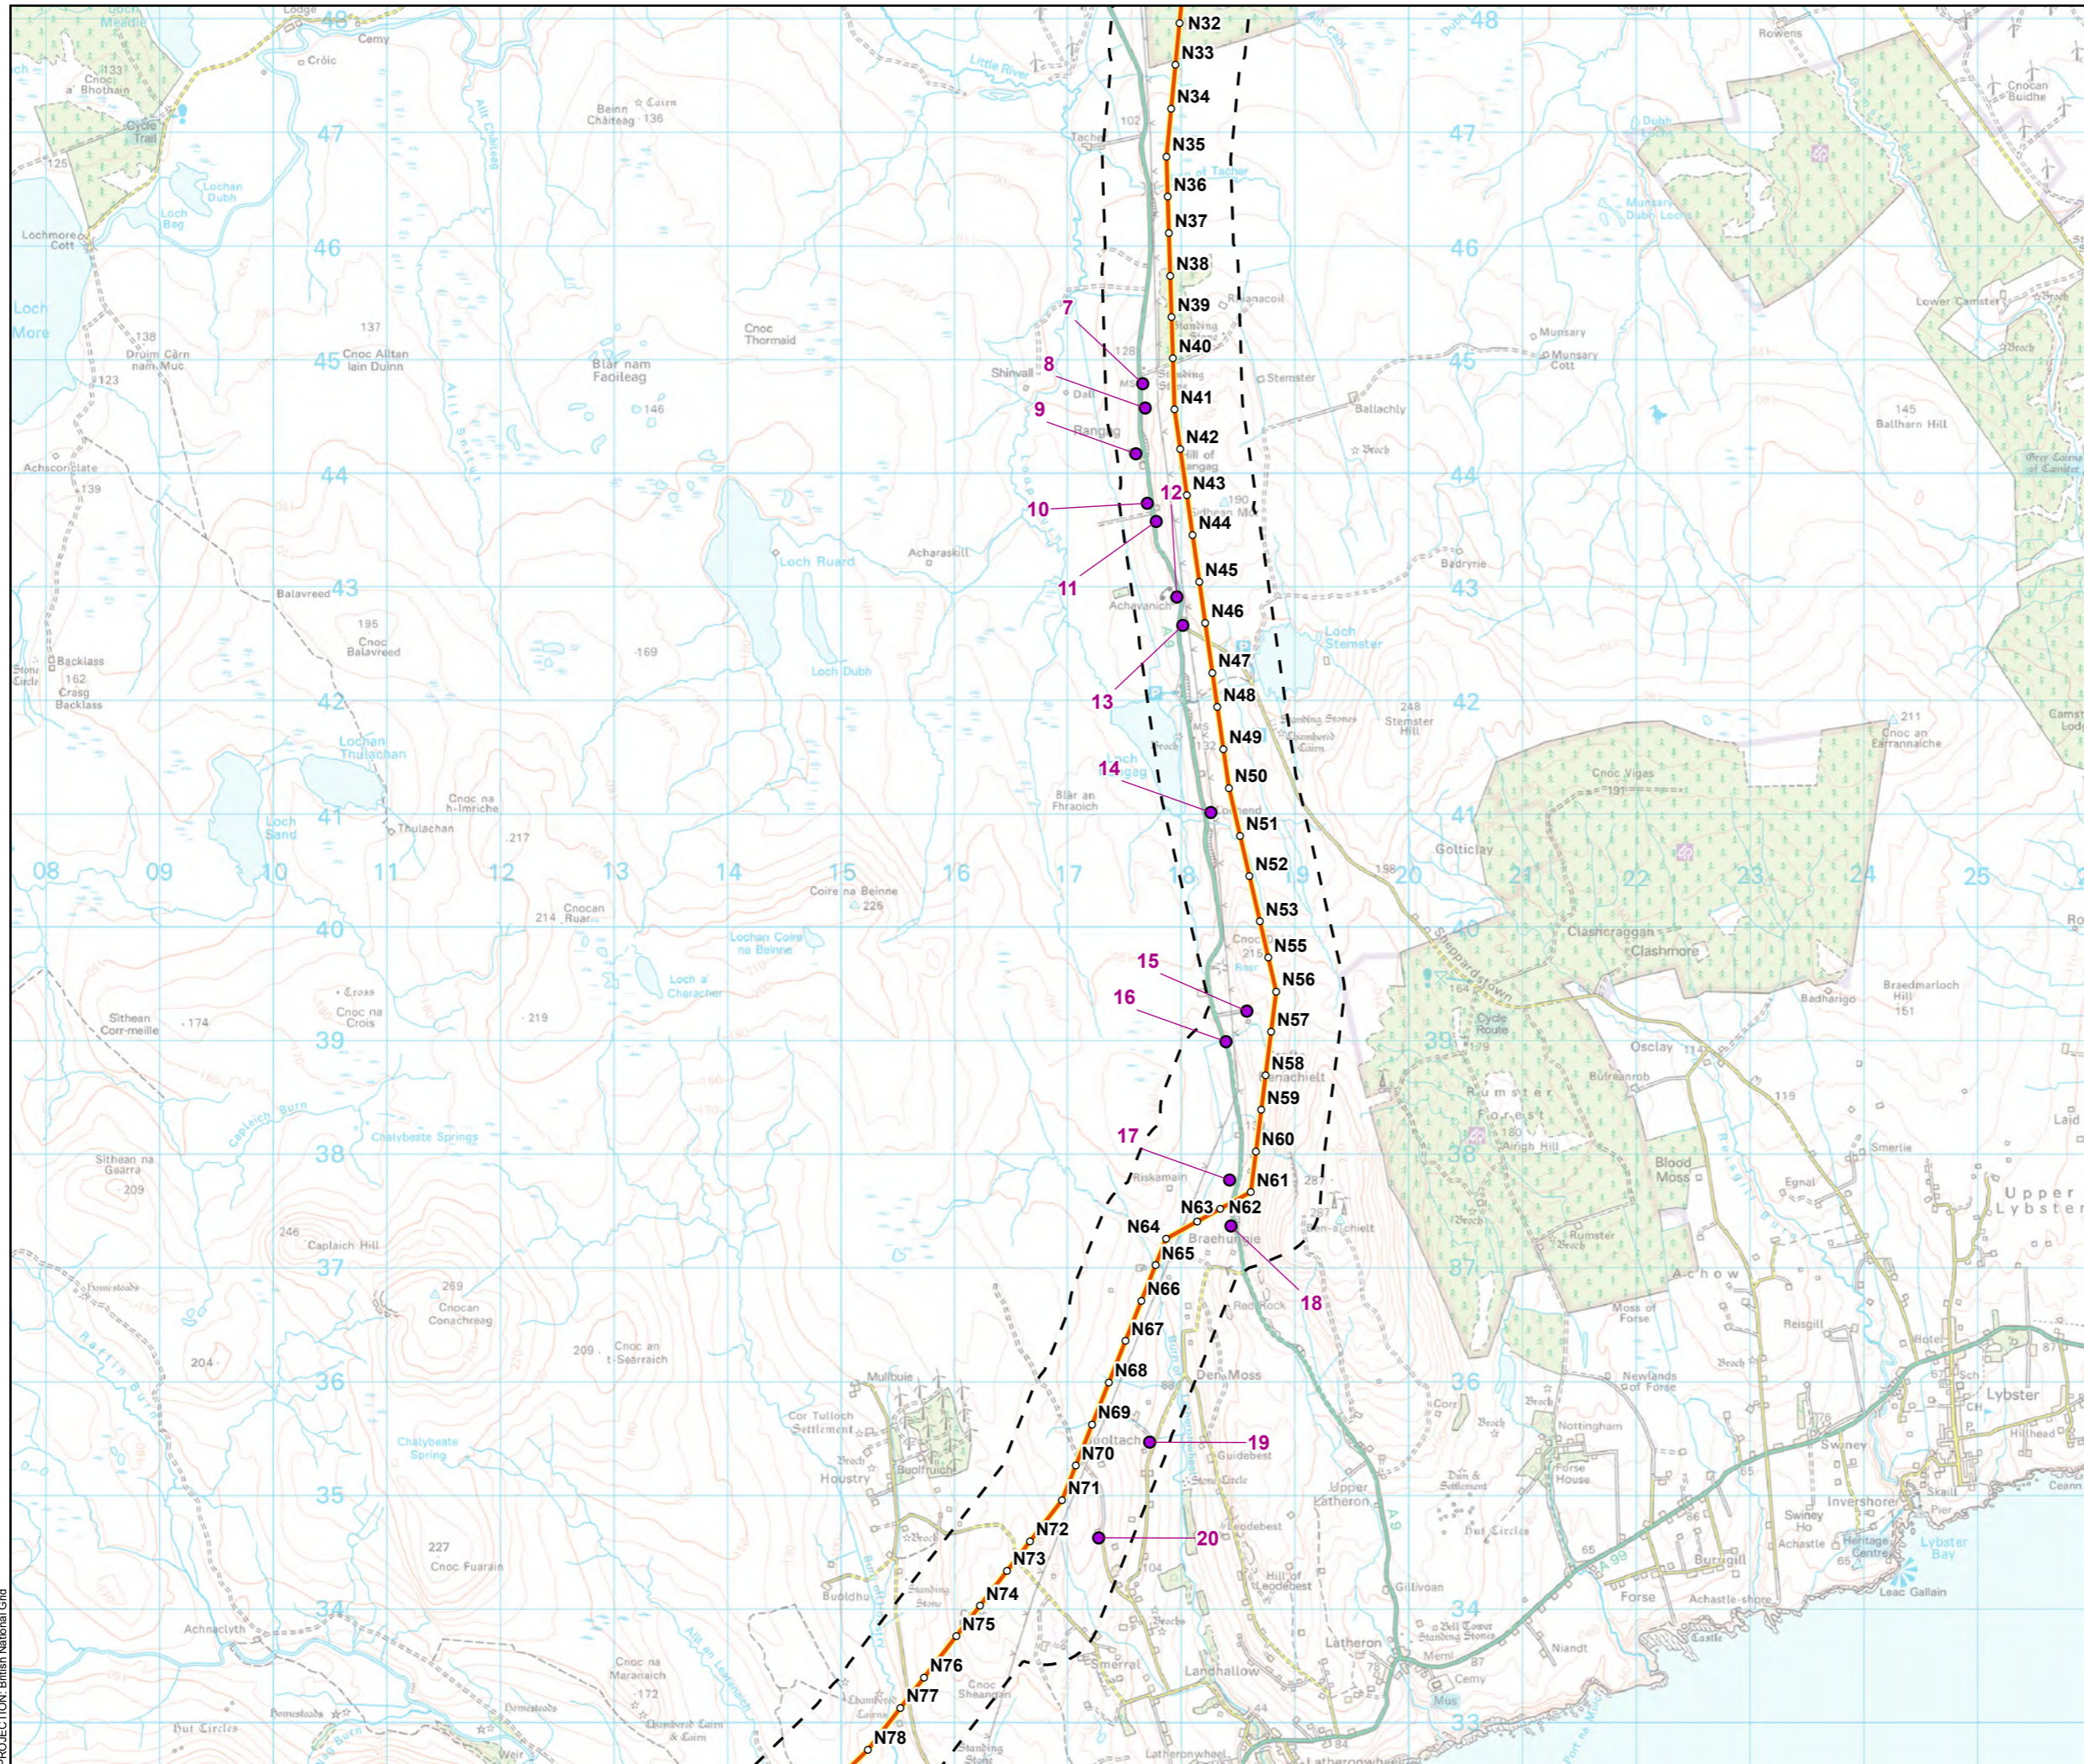

- Tower Location
- Alignment Section
- Alignment Section A
- - - Study Area (500m buffer from LoD)
- Noise Sensitive Receptors

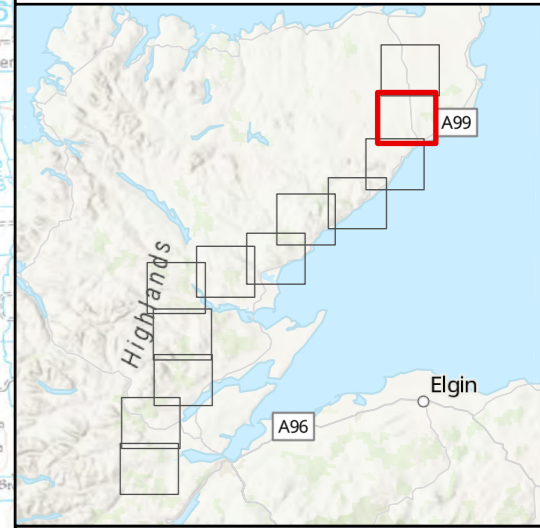


SCALE: See Scale Bar	VERSION: A01
SIZE: A3	DRAWN: CI
PROJECT: 0652629	CHECKED: ES
DATE: 8/12/2025	APPROVED: KG



Figure 15.1 - 2
Spittal - Loch Buidhe - Beaulieu
400 kV OHL Connection
Noise Sensitive Receptors



PROJECTION: British National Grid

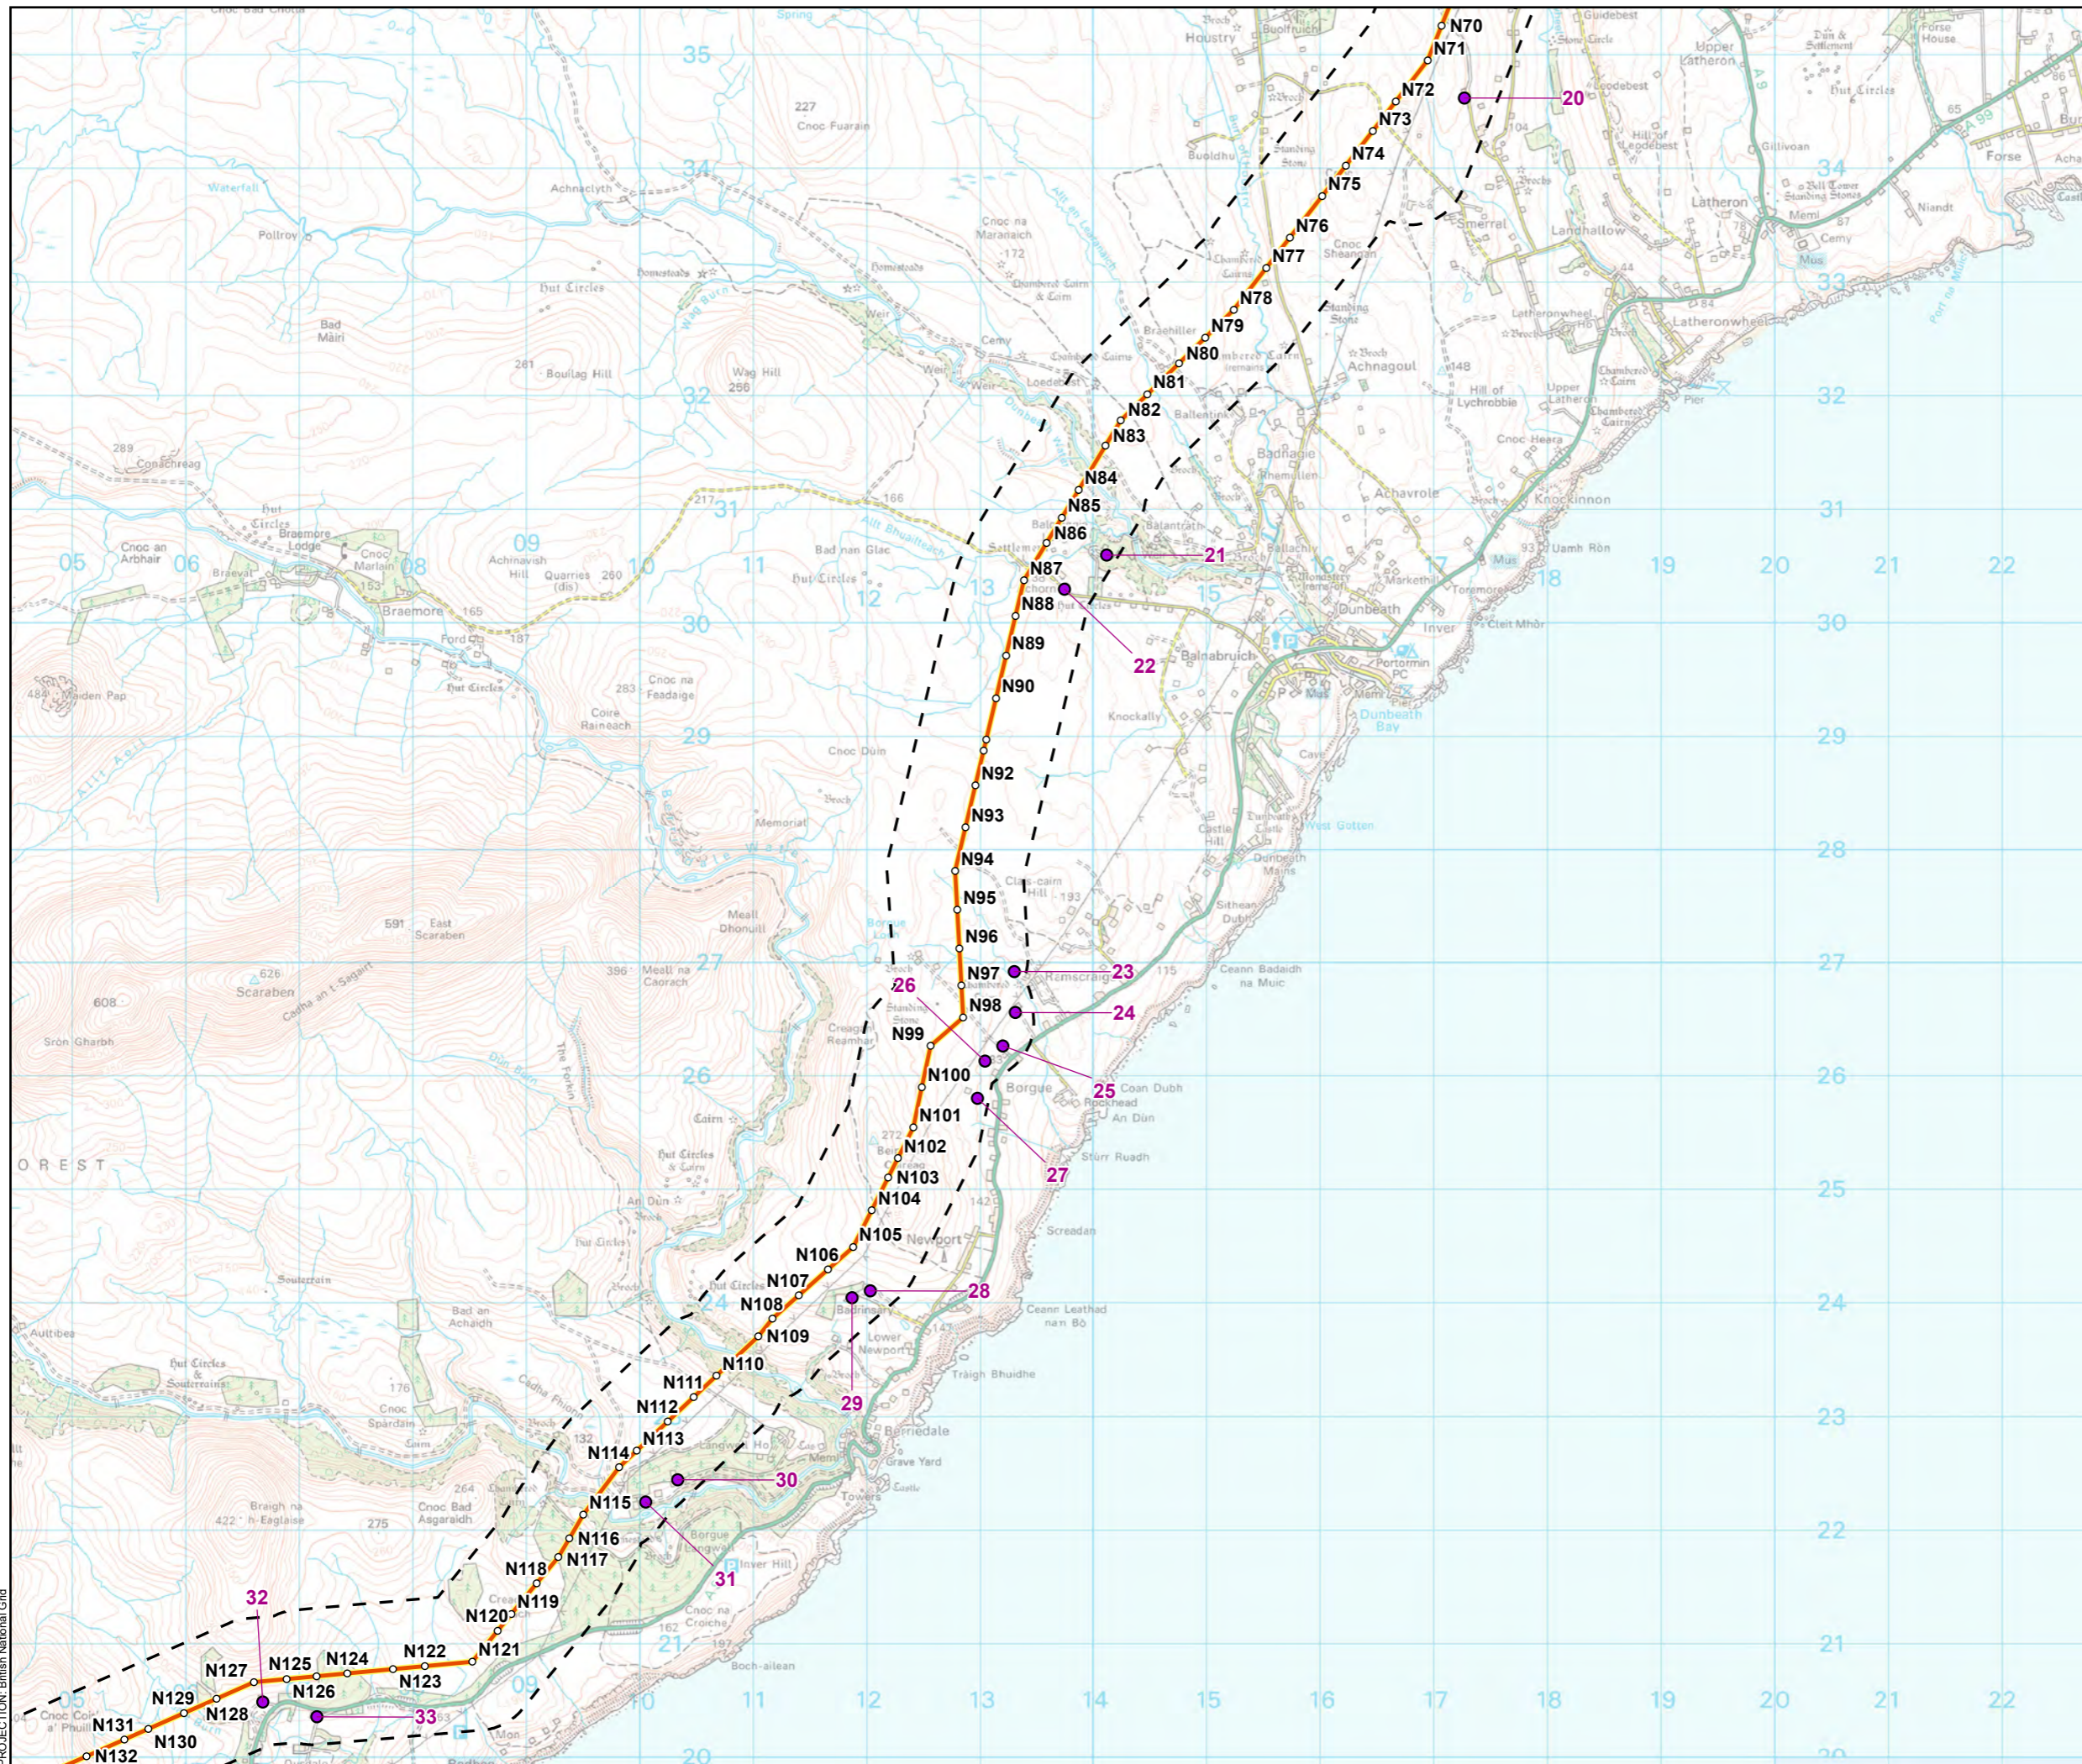

- Tower Location
- Alignment Section
- - - Study Area (500m buffer from LoD)
- Noise Sensitive Receptors



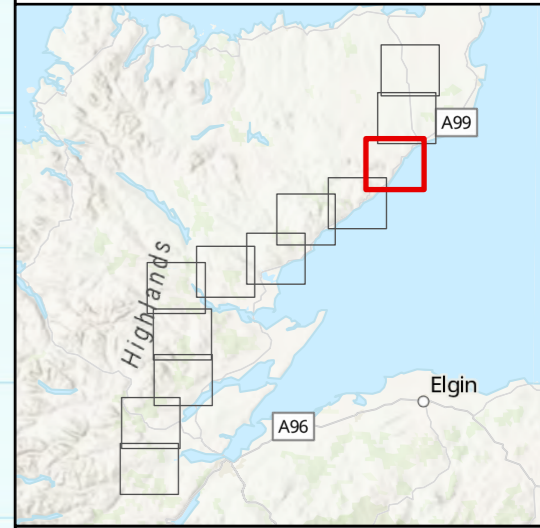


SCALE: See Scale Bar	VERSION: A01
SIZE: A3	DRAWN: CI
PROJECT: 0652629	CHECKED: ES
DATE: 8/12/2025	APPROVED: KG

Figure 15.1 - 3
Spittal - Loch Buidhe - Beaulieu
400 kV OHL Connection
Noise Sensitive Receptors




PROJECTION: British National Grid

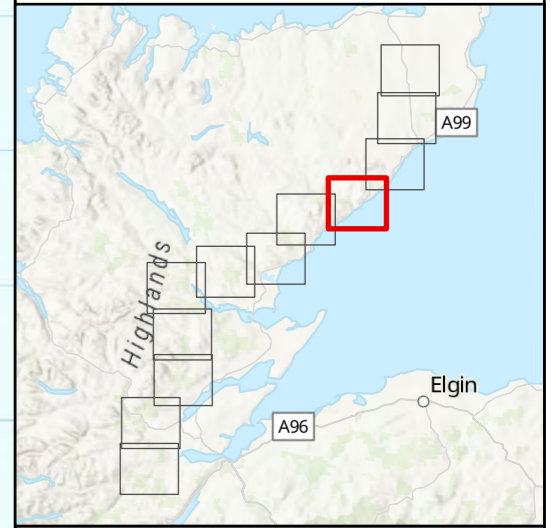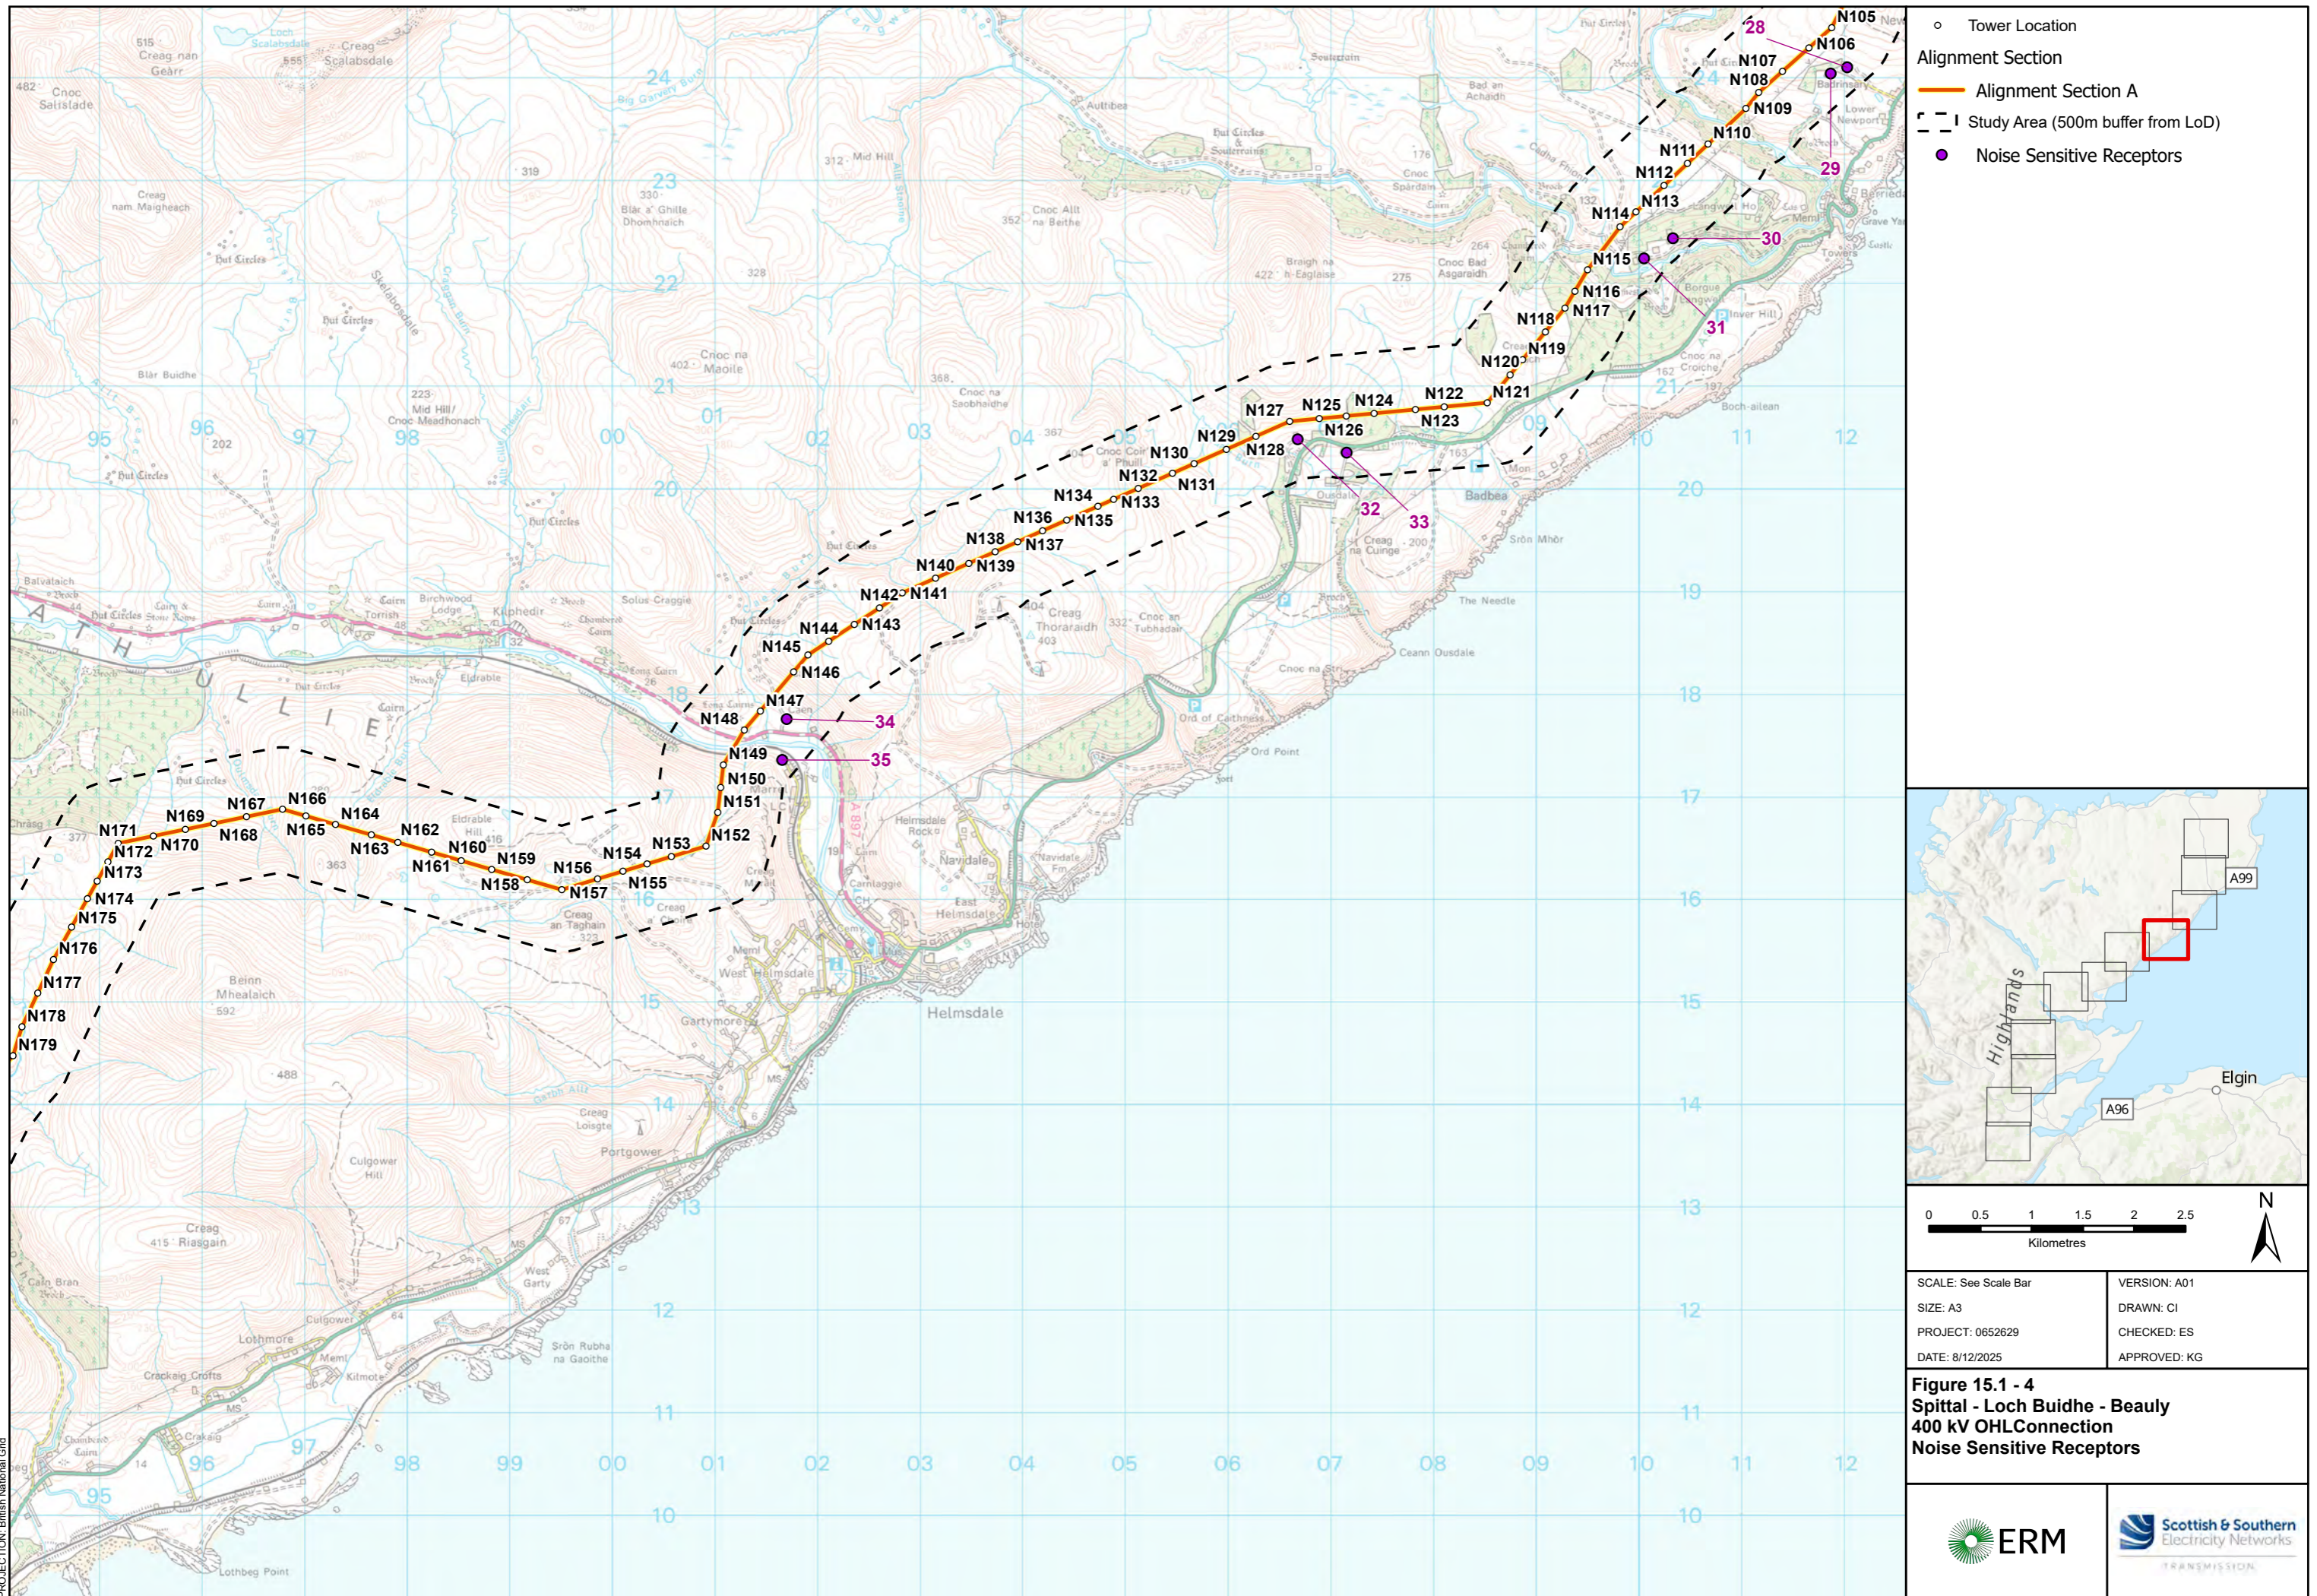


SCALE: See Scale Bar	VERSION: A01
SIZE: A3	DRAWN: CI
PROJECT: 0652629	CHECKED: ES
DATE: 8/12/2025	APPROVED: KG



Figure 15.1 - 4
Spittal - Loch Buidhe - Beaulieu
400 kV OHL Connection
Noise Sensitive Receptors

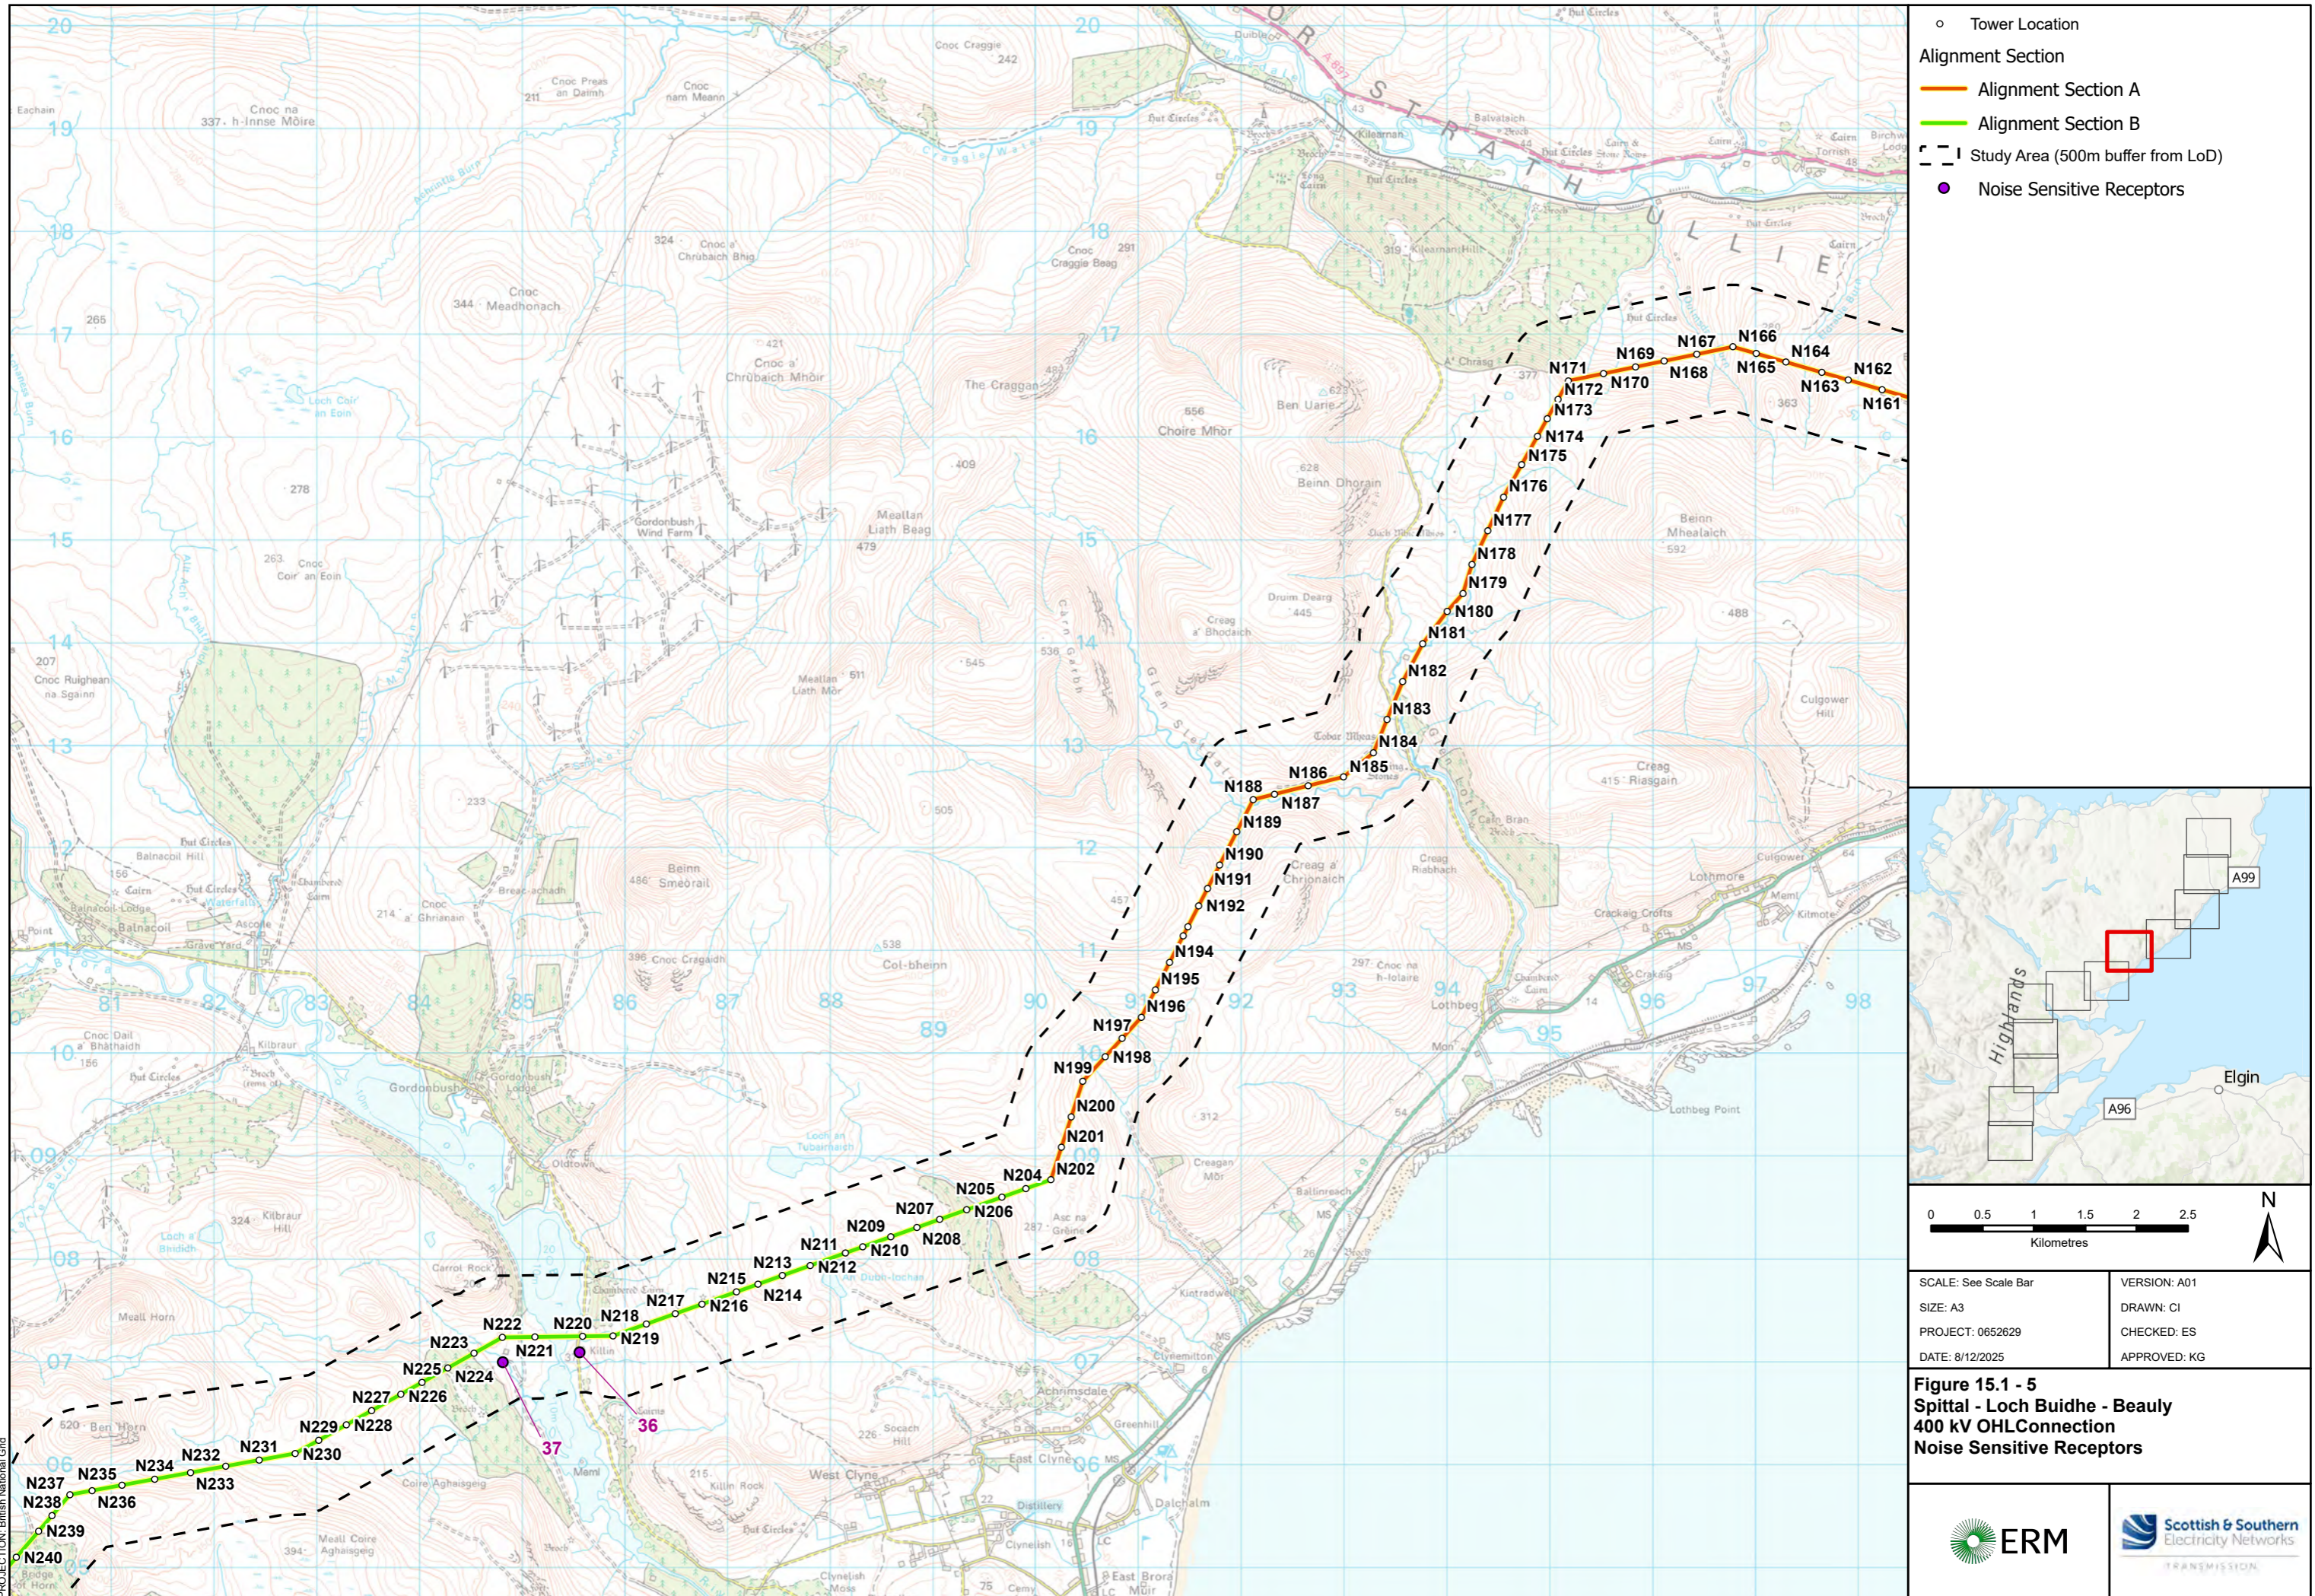

PROJECTION: British National Grid

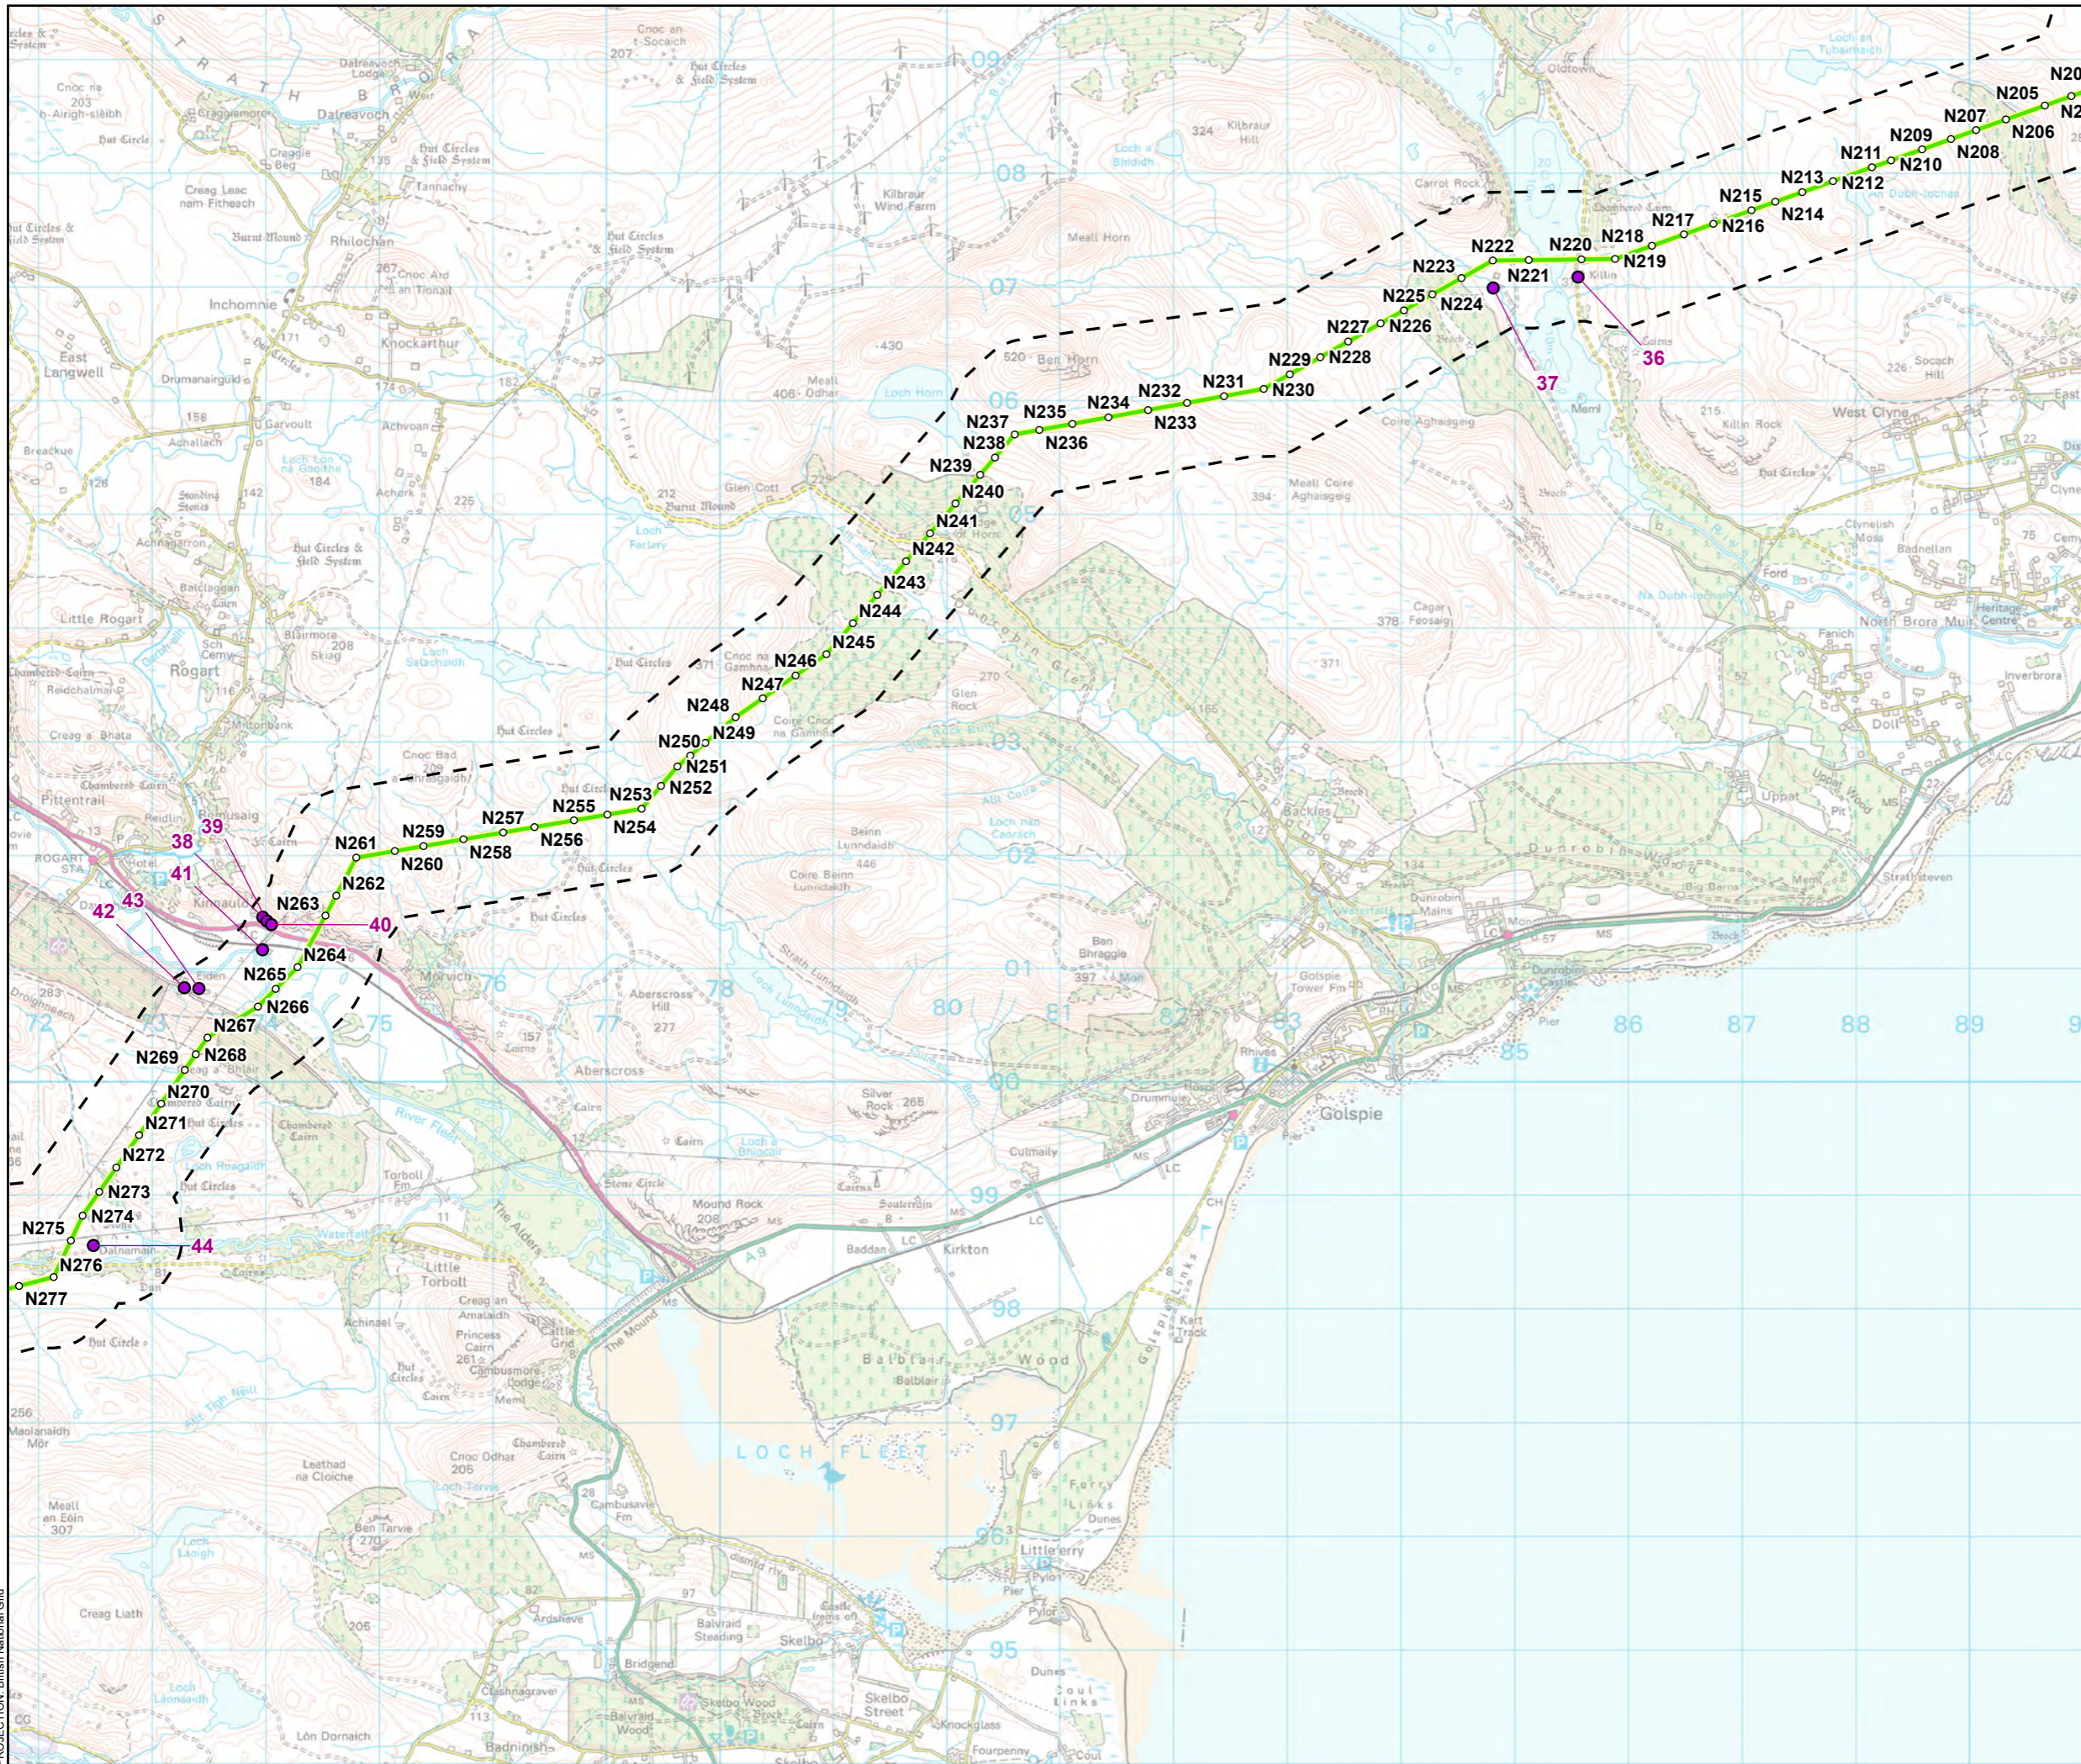

- Tower Location
- Alignment Section A
- Alignment Section B
- - - Study Area (500m buffer from LoD)
- Noise Sensitive Receptors

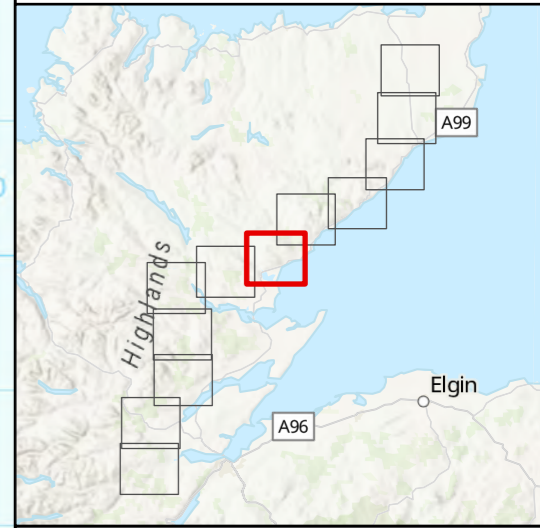

SCALE: See Scale Bar	VERSION: A01
SIZE: A3	DRAWN: CI
PROJECT: 0652629	CHECKED: ES
DATE: 8/12/2025	APPROVED: KG

Figure 15.1 - 6
Spittal - Loch Buidhe - Beaulieu
400 kV OHL Connection
Noise Sensitive Receptors



PROJECTION: British National Grid