


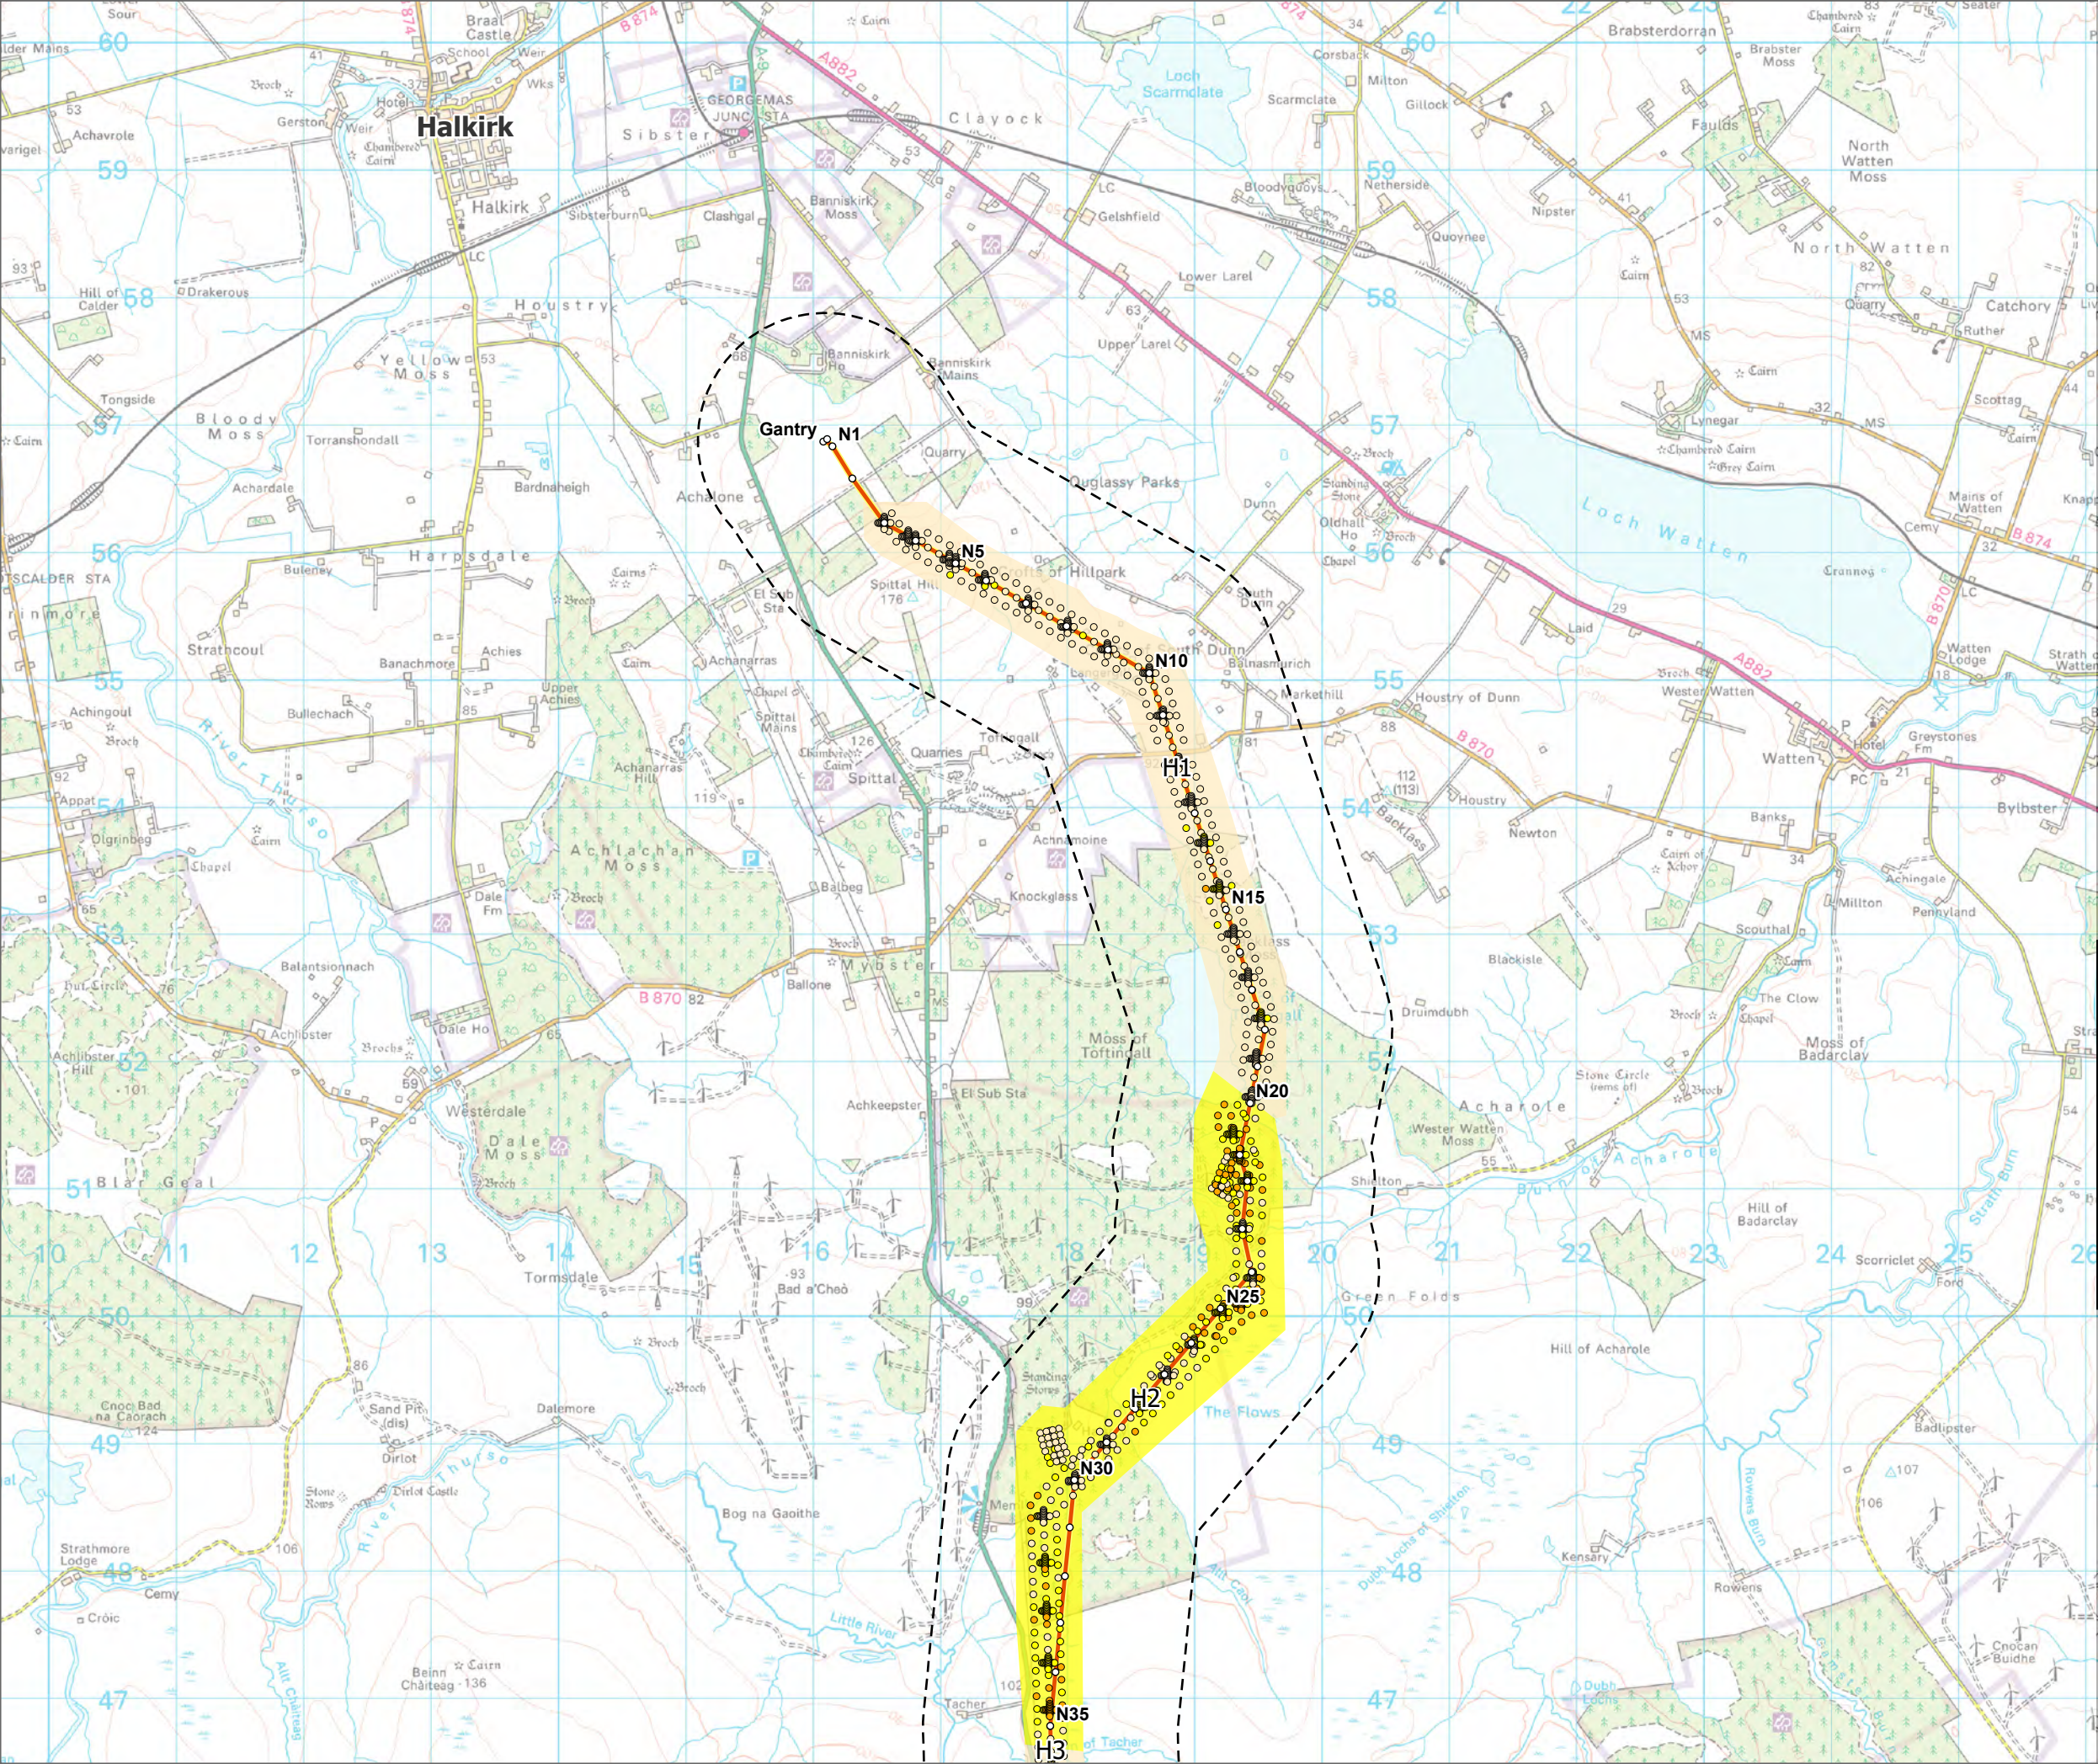

Tower Location

Alignment Section A

Alignment Section Break

Study Area (1 km Buffer)

Hazard Ranking Zone

Negligible

Low

Moderate

High

Hazard Ranking Point

Negligible

Low

Moderate

High

0

500

1,000

1,500

2,000

2,500

Metres

N

SCALE: See Scale Bar

SIZE: A3

PROJECT: 0720281

DATE: 07/08/2025

VERSION: A02

DRAWN: BW

CHECKED: CM

APPROVED: KG

Figure 7 - 1

Spittal - Loch Buidhe - Beaully 400 kV OHL Connection

Peat Landslide Hazard Risk Assessment

Hazard Ranking Plan

ERM


Scottish & Southern

Electricity Networks

TRANSMISSION

PROJECTION: British National Grid

Sources: Esri, TomTom, Garmin, FAO, NOAA, USGS, © OpenStreetMap contributors, and the GIS User Community, Esri, USGS; © Landmark Information Group Limited and/or its Data Suppliers (All rights reserved 2010) Path: \\ukspgdisfs01\Data\Arcus\Projects\0652629 - SSE Beaully to Loch Buidhe\Workspace\Engineering\SLBB Engineering v1.aprx - 0652659 - Figure 11.1.7 - Hazard Ranking Plan - A01

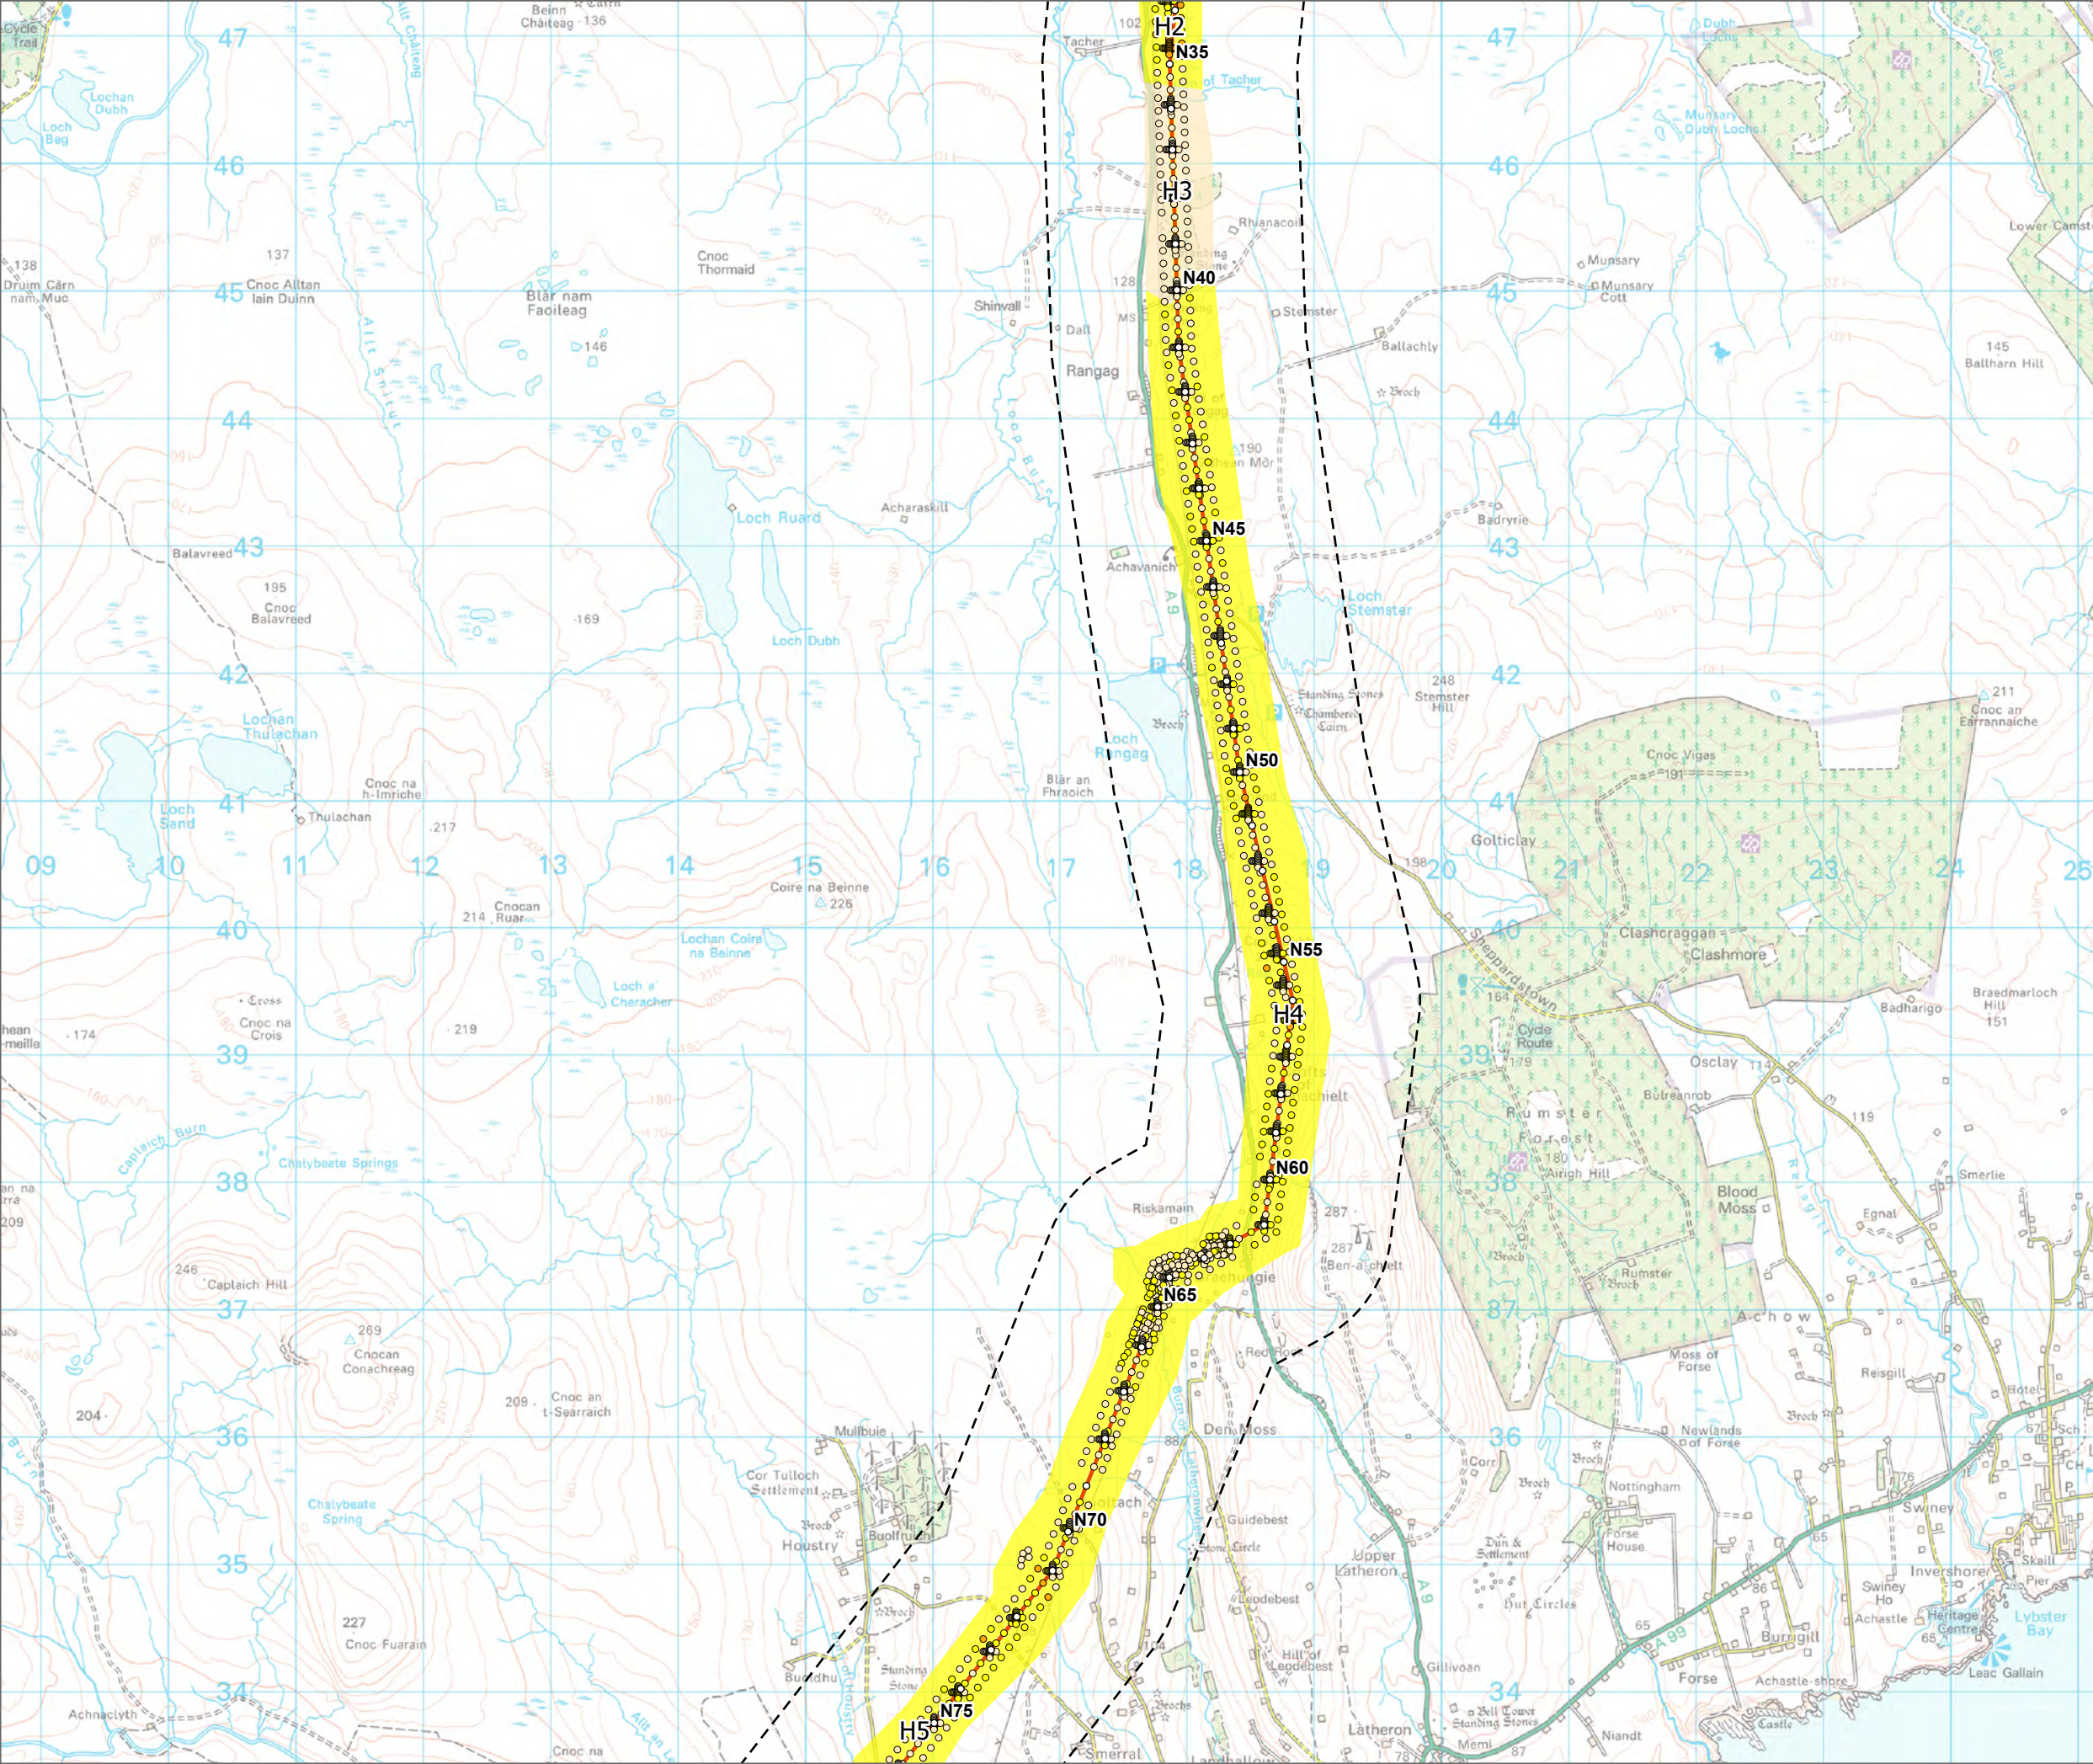

Tower Location

Alignment Section A

Alignment Section Break

Study Area (1 km Buffer)

Hazard Ranking Zone

Negligible

Low

Moderate

High

Hazard Ranking Point

Negligible

Low

Moderate


High

SCALE: See Scale Bar	VERSION: A02
SIZE: A3	DRAWN: BW
PROJECT: 0720281	CHECKED: CM
DATE: 07/08/2025	APPROVED: KG

Figure 7 - 2
Spittal - Loch Buidhe - Beauly 400 kV OHL
Connection
Peat Landslide Hazard Risk Assessment
Hazard Ranking Plan

Sources: Esri, TomTom, Garmin, FAO, NOAA, USGS, © OpenStreetMap contributors, and the GIS User Community, Esri, USGS; © Landmark Information Group Limited and/or its Data Suppliers (All rights reserved 2010)

Path: \\ukspgdis01\Data\Arcus\Projects\0652629 - SSE Beauly to Loch Buidhe\Workspace\Engineering\SLBB Engineering v1.aprx - 0652659 - Figure 11.1.7 - Hazard Ranking Plan - A01

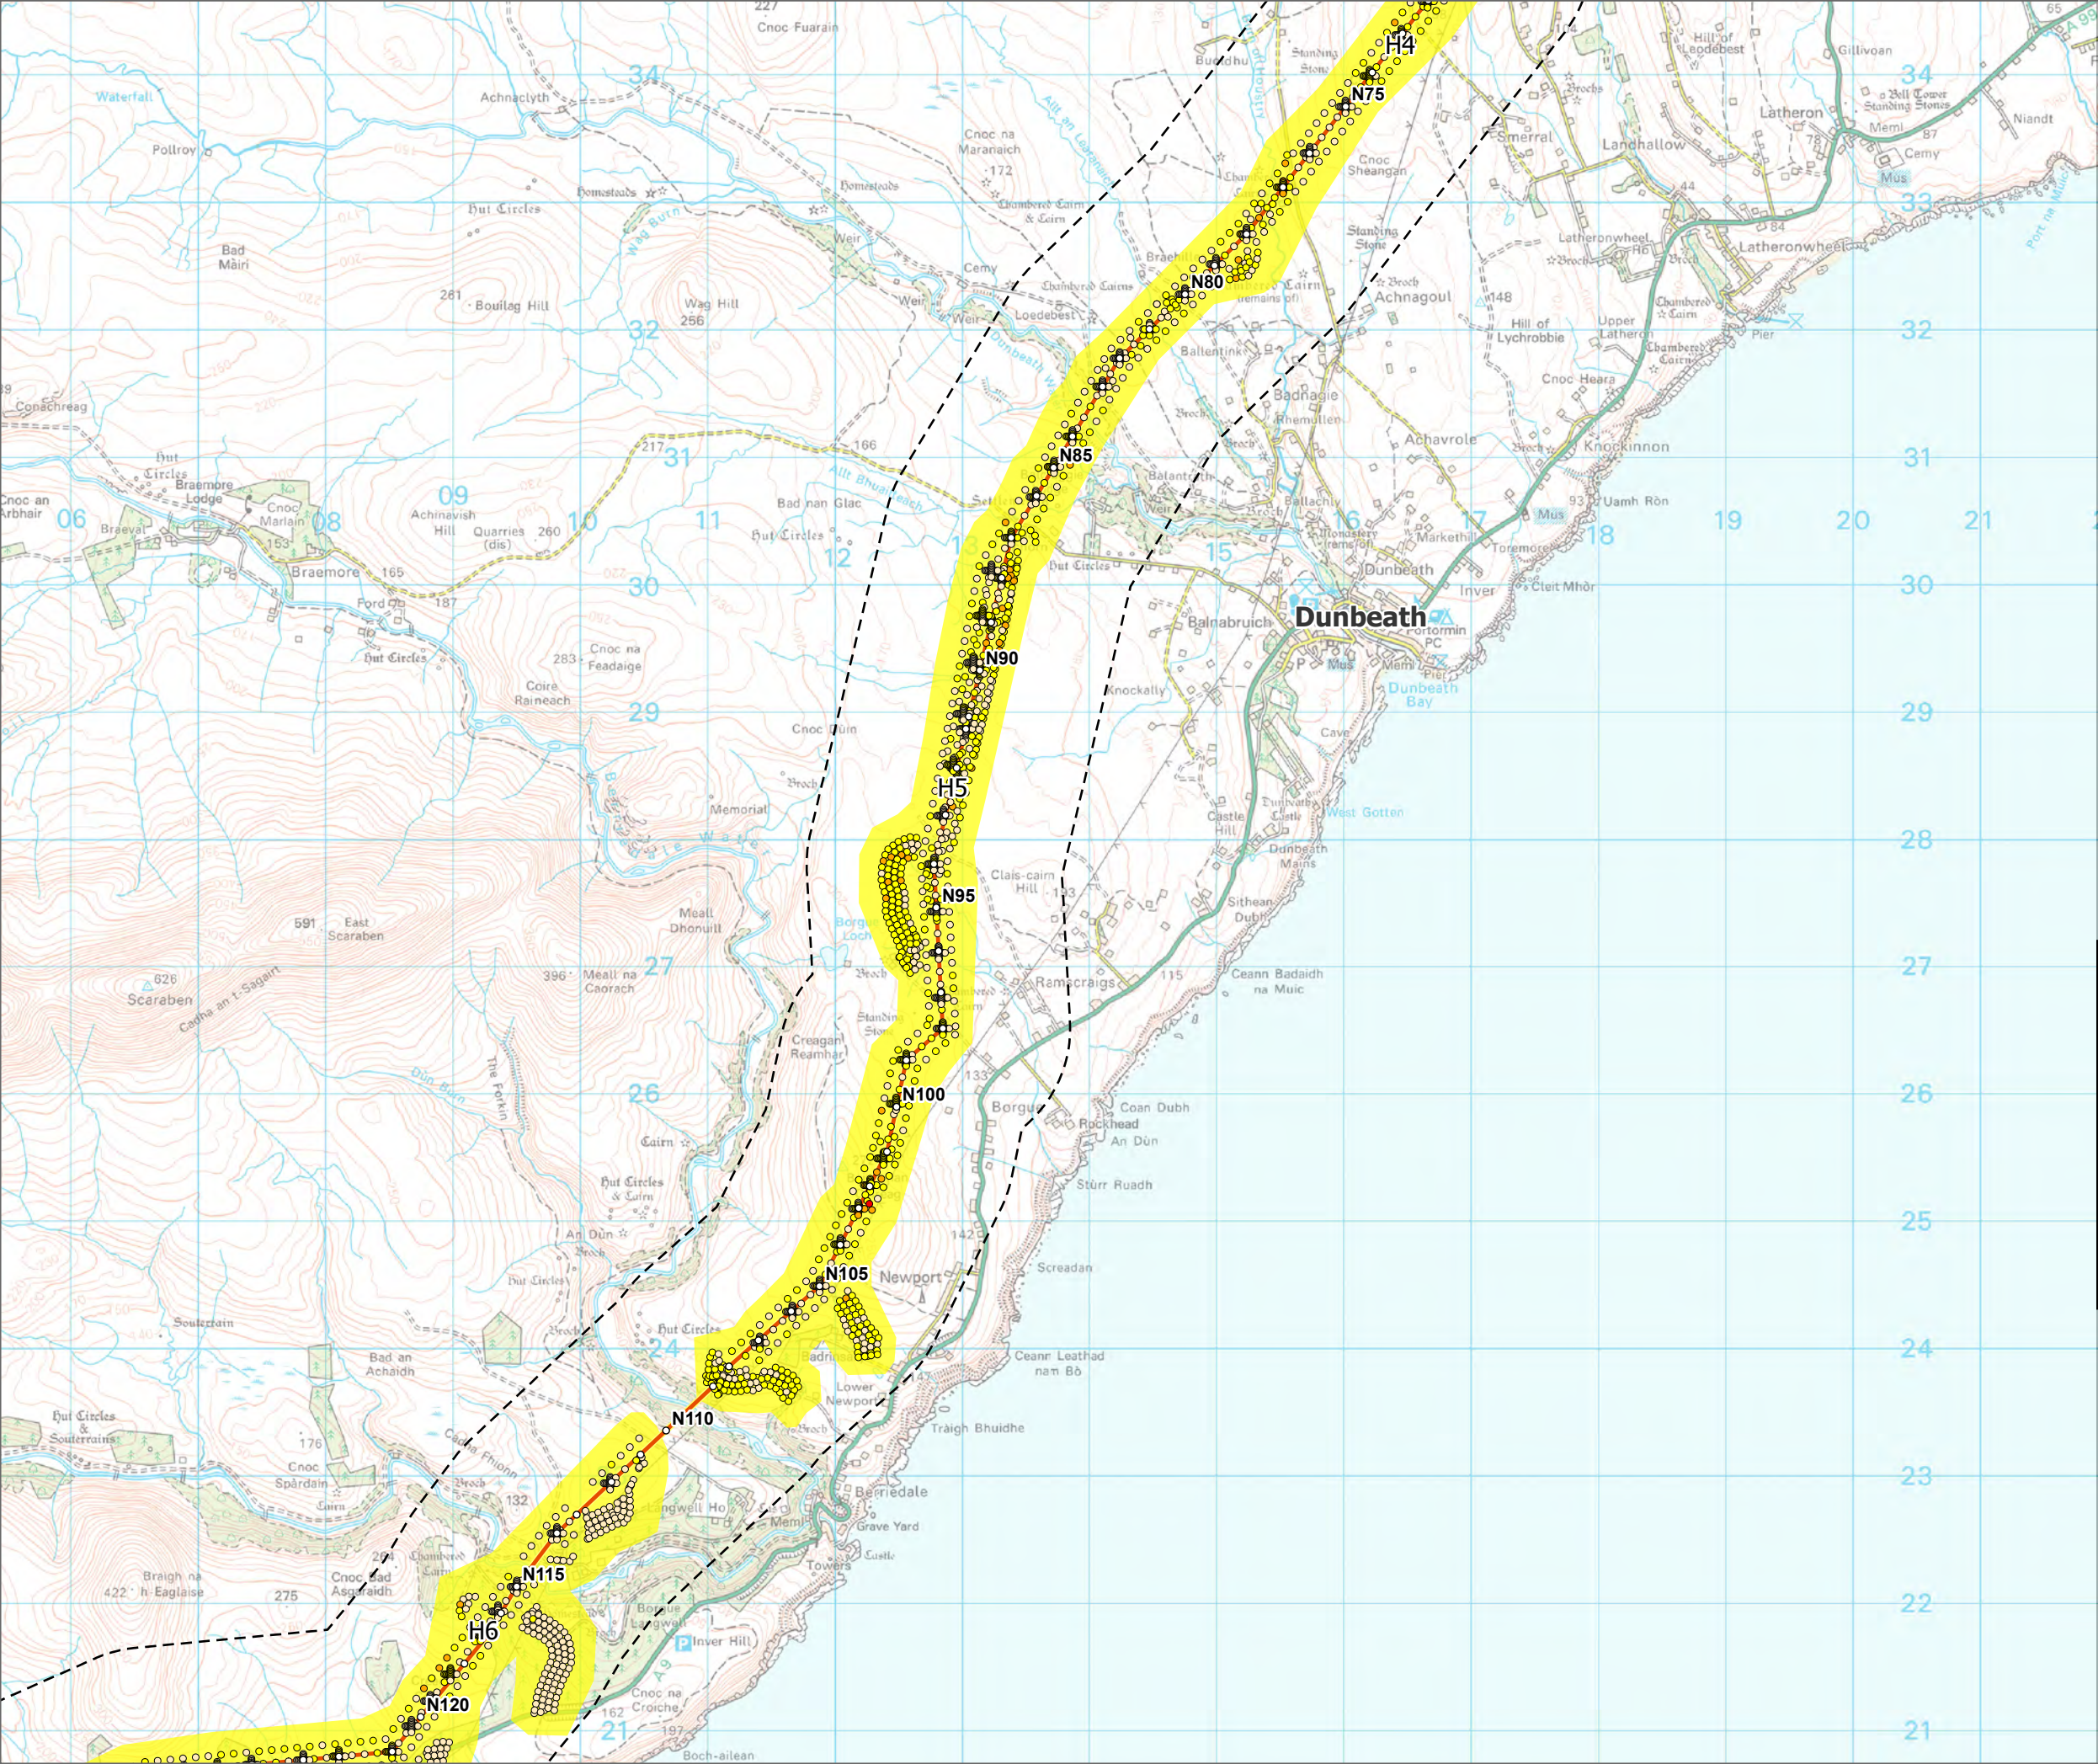

Tower Location

Alignment Section A

Alignment Section Break

Study Area (1 km Buffer)

Hazard Ranking Zone

Negligible

Low

Moderate

High

Hazard Ranking Point

Negligible

Low

Moderate

High

0

500

1,000

1,500

2,000

2,500

Metres

N

SCALE: See Scale Bar

SIZE: A3

PROJECT: 0720281

DATE: 07/08/2025

VERSION: A02

DRAWN: BW

CHECKED: CM

APPROVED: KG

Figure 7 - 3

Spittal - Loch Buidhe - Beaully 400 kV OHL Connection

Peat Landslide Hazard Risk Assessment

Hazard Ranking Plan

ERM



Scottish & Southern Electricity Networks


TRANSMISSION

PROJECTION: British National Grid

Sources: Esri, TomTom, Garmin, FAO, NOAA, USGS, © OpenStreetMap contributors, and the GIS User Community, Esri, USGS; © Landmark Information Group Limited and/or its Data Suppliers (All rights reserved 2010)

Path: \\ukspdr\gis\011\Data\Arcus\Projects\0652629 - SSE Beaully to Loch Buidhe\Workspace\Engineering\SLBB Engineering v1.aprx - 0652659 - Figure 11.1.7 - Hazard Ranking Plan - A01

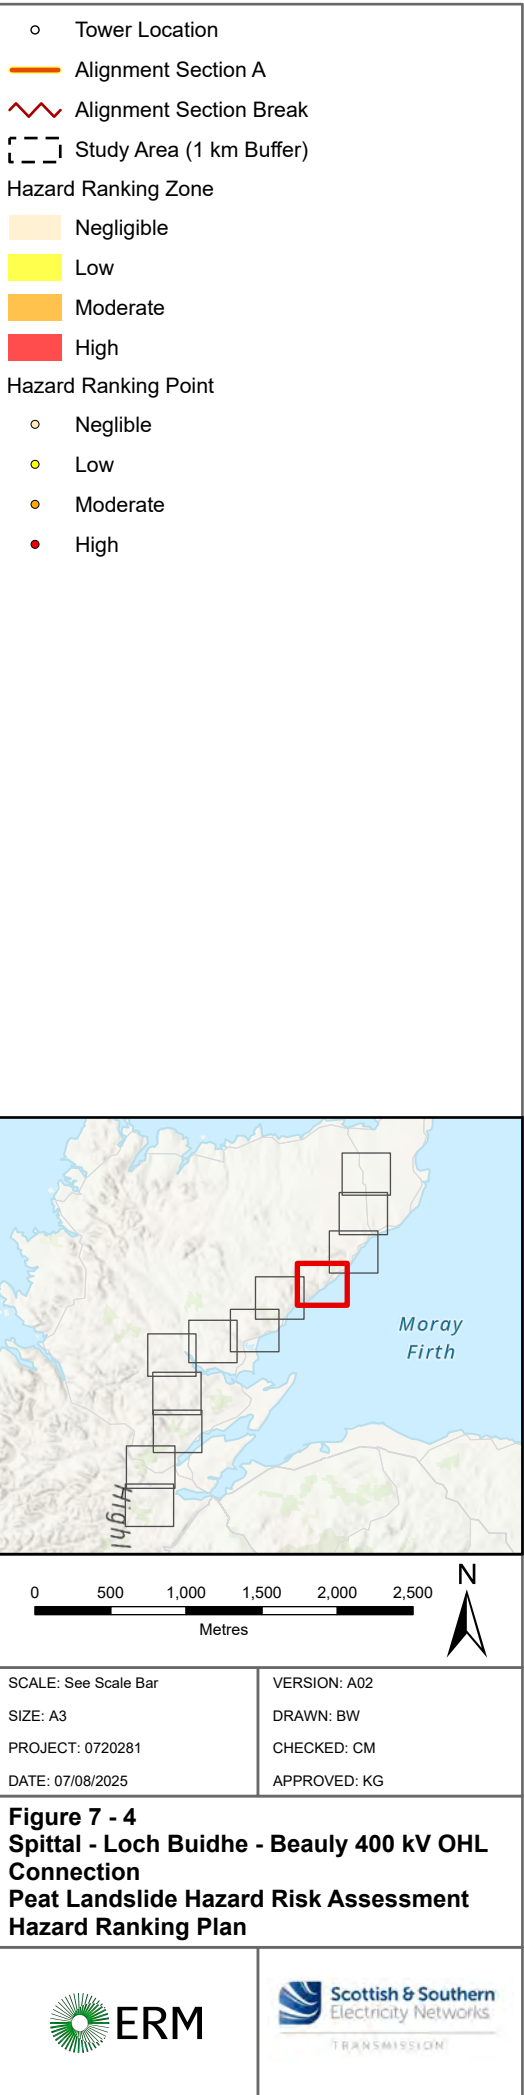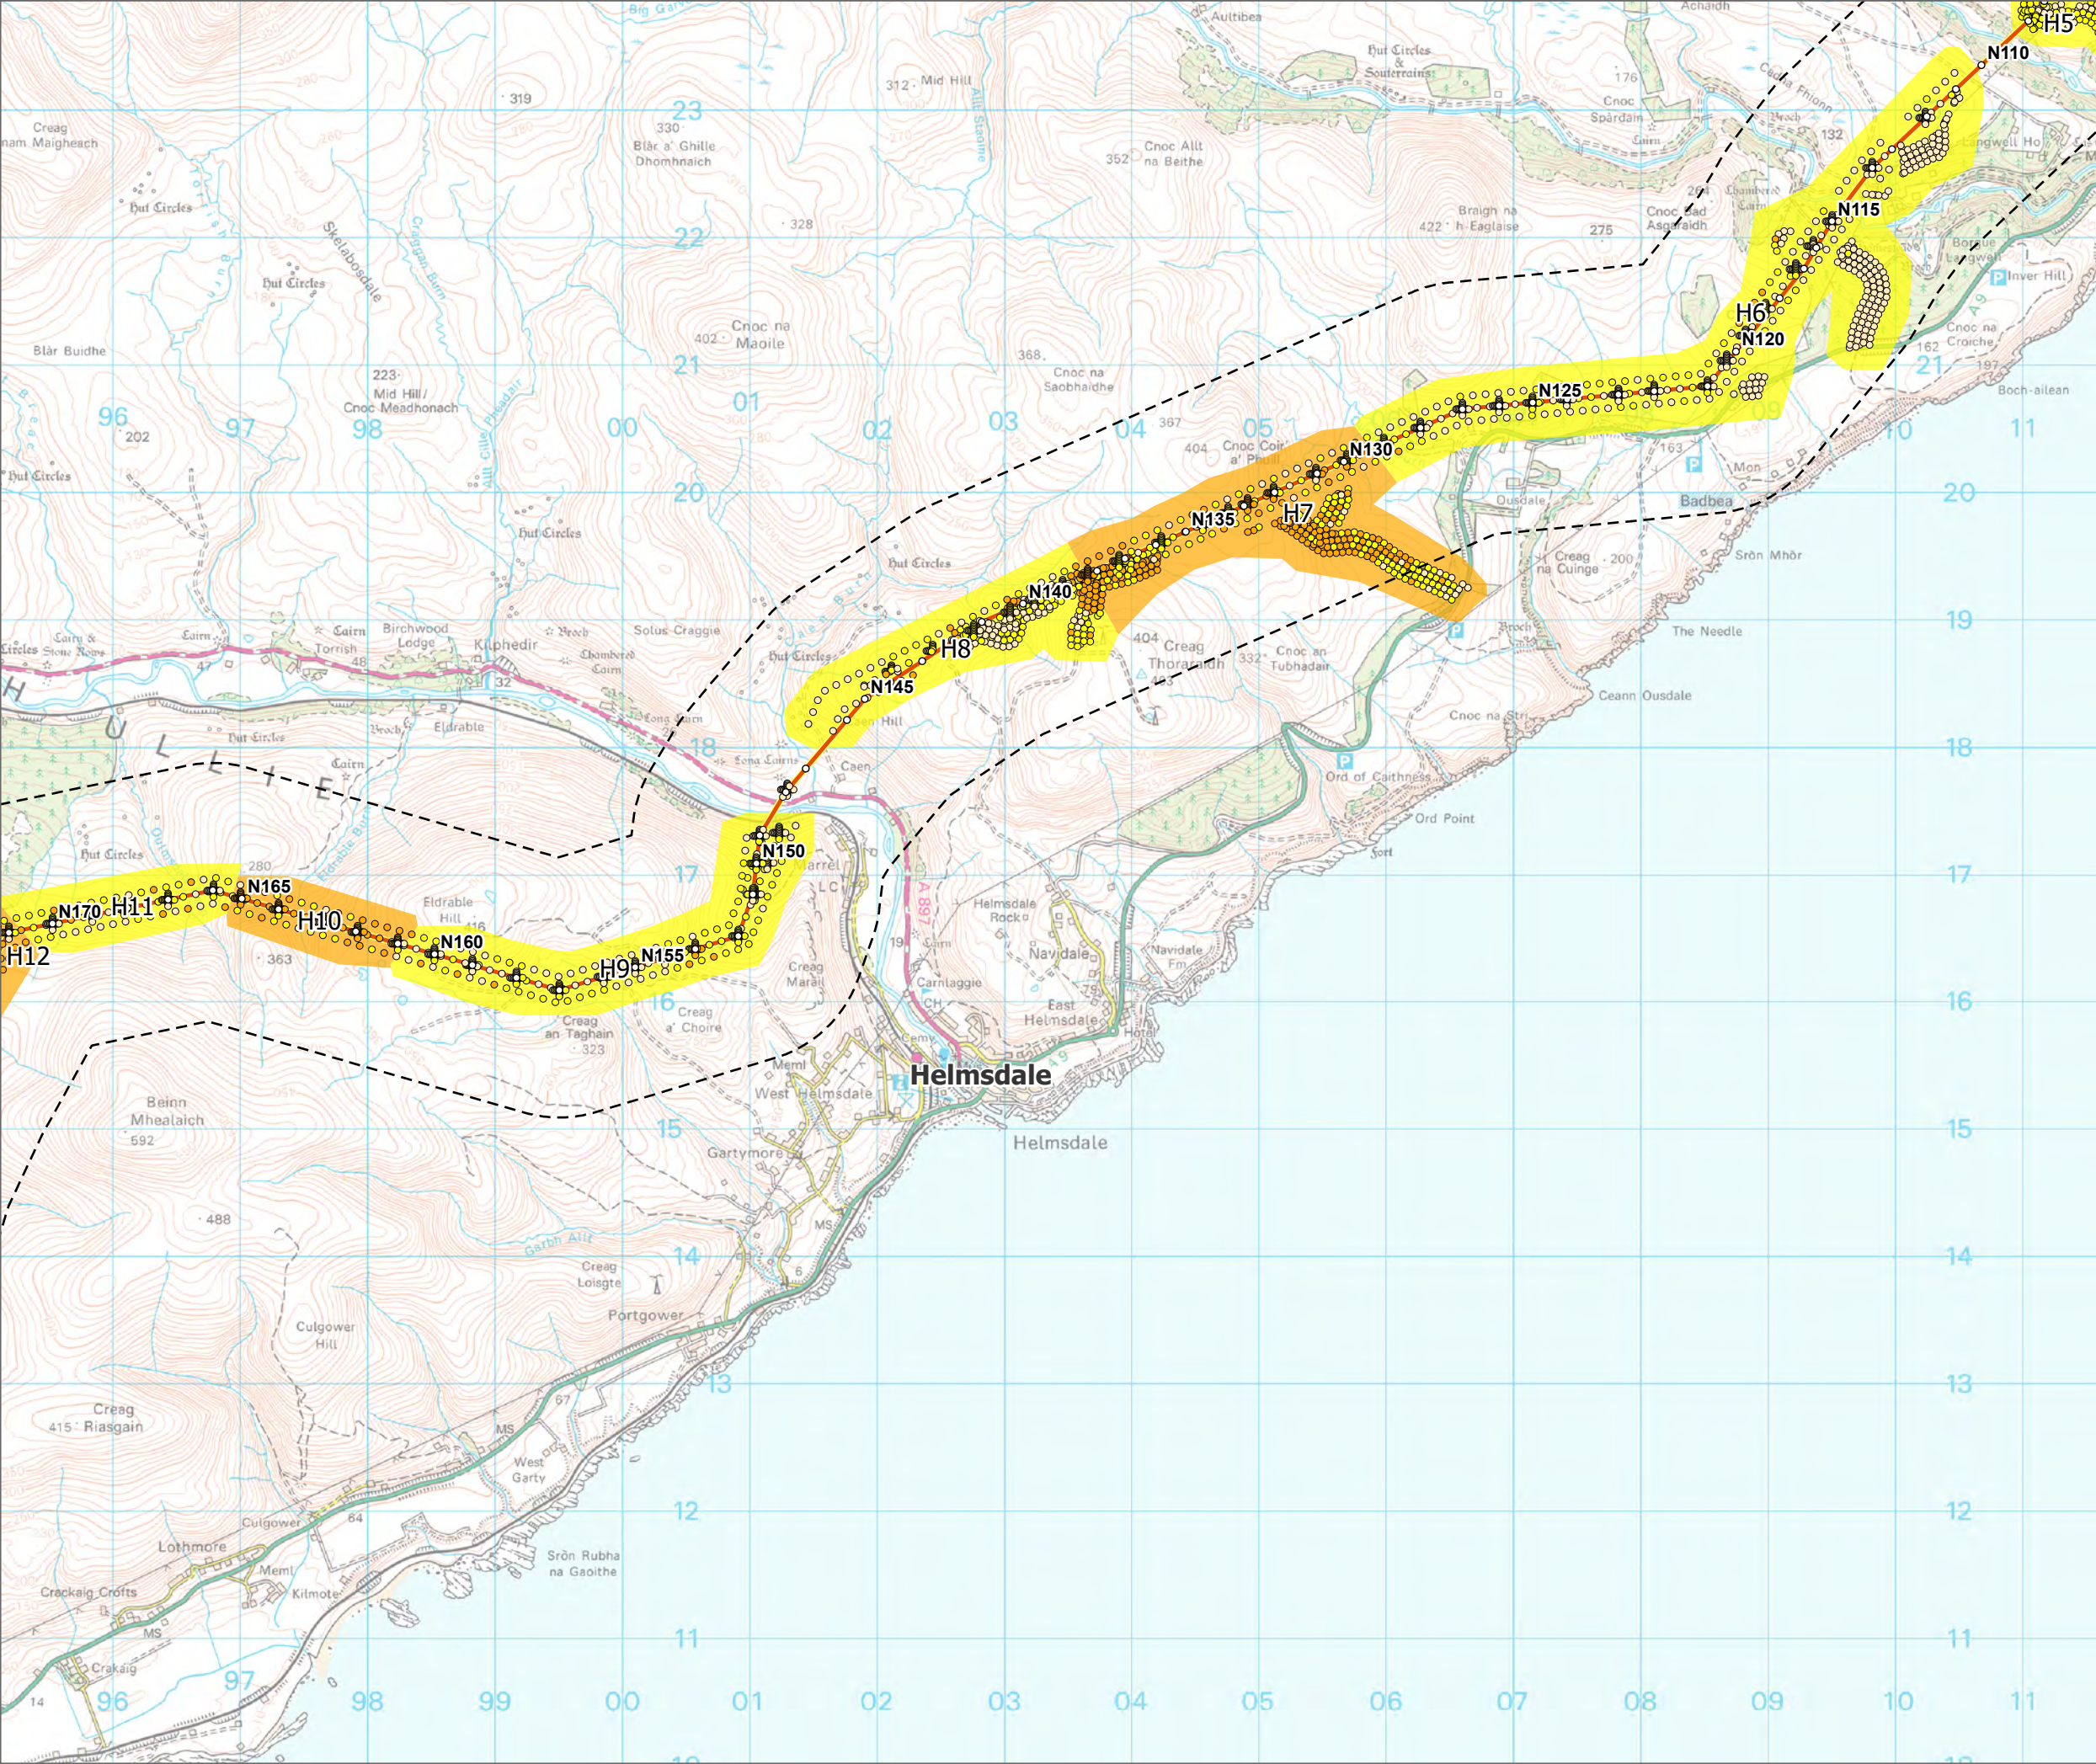

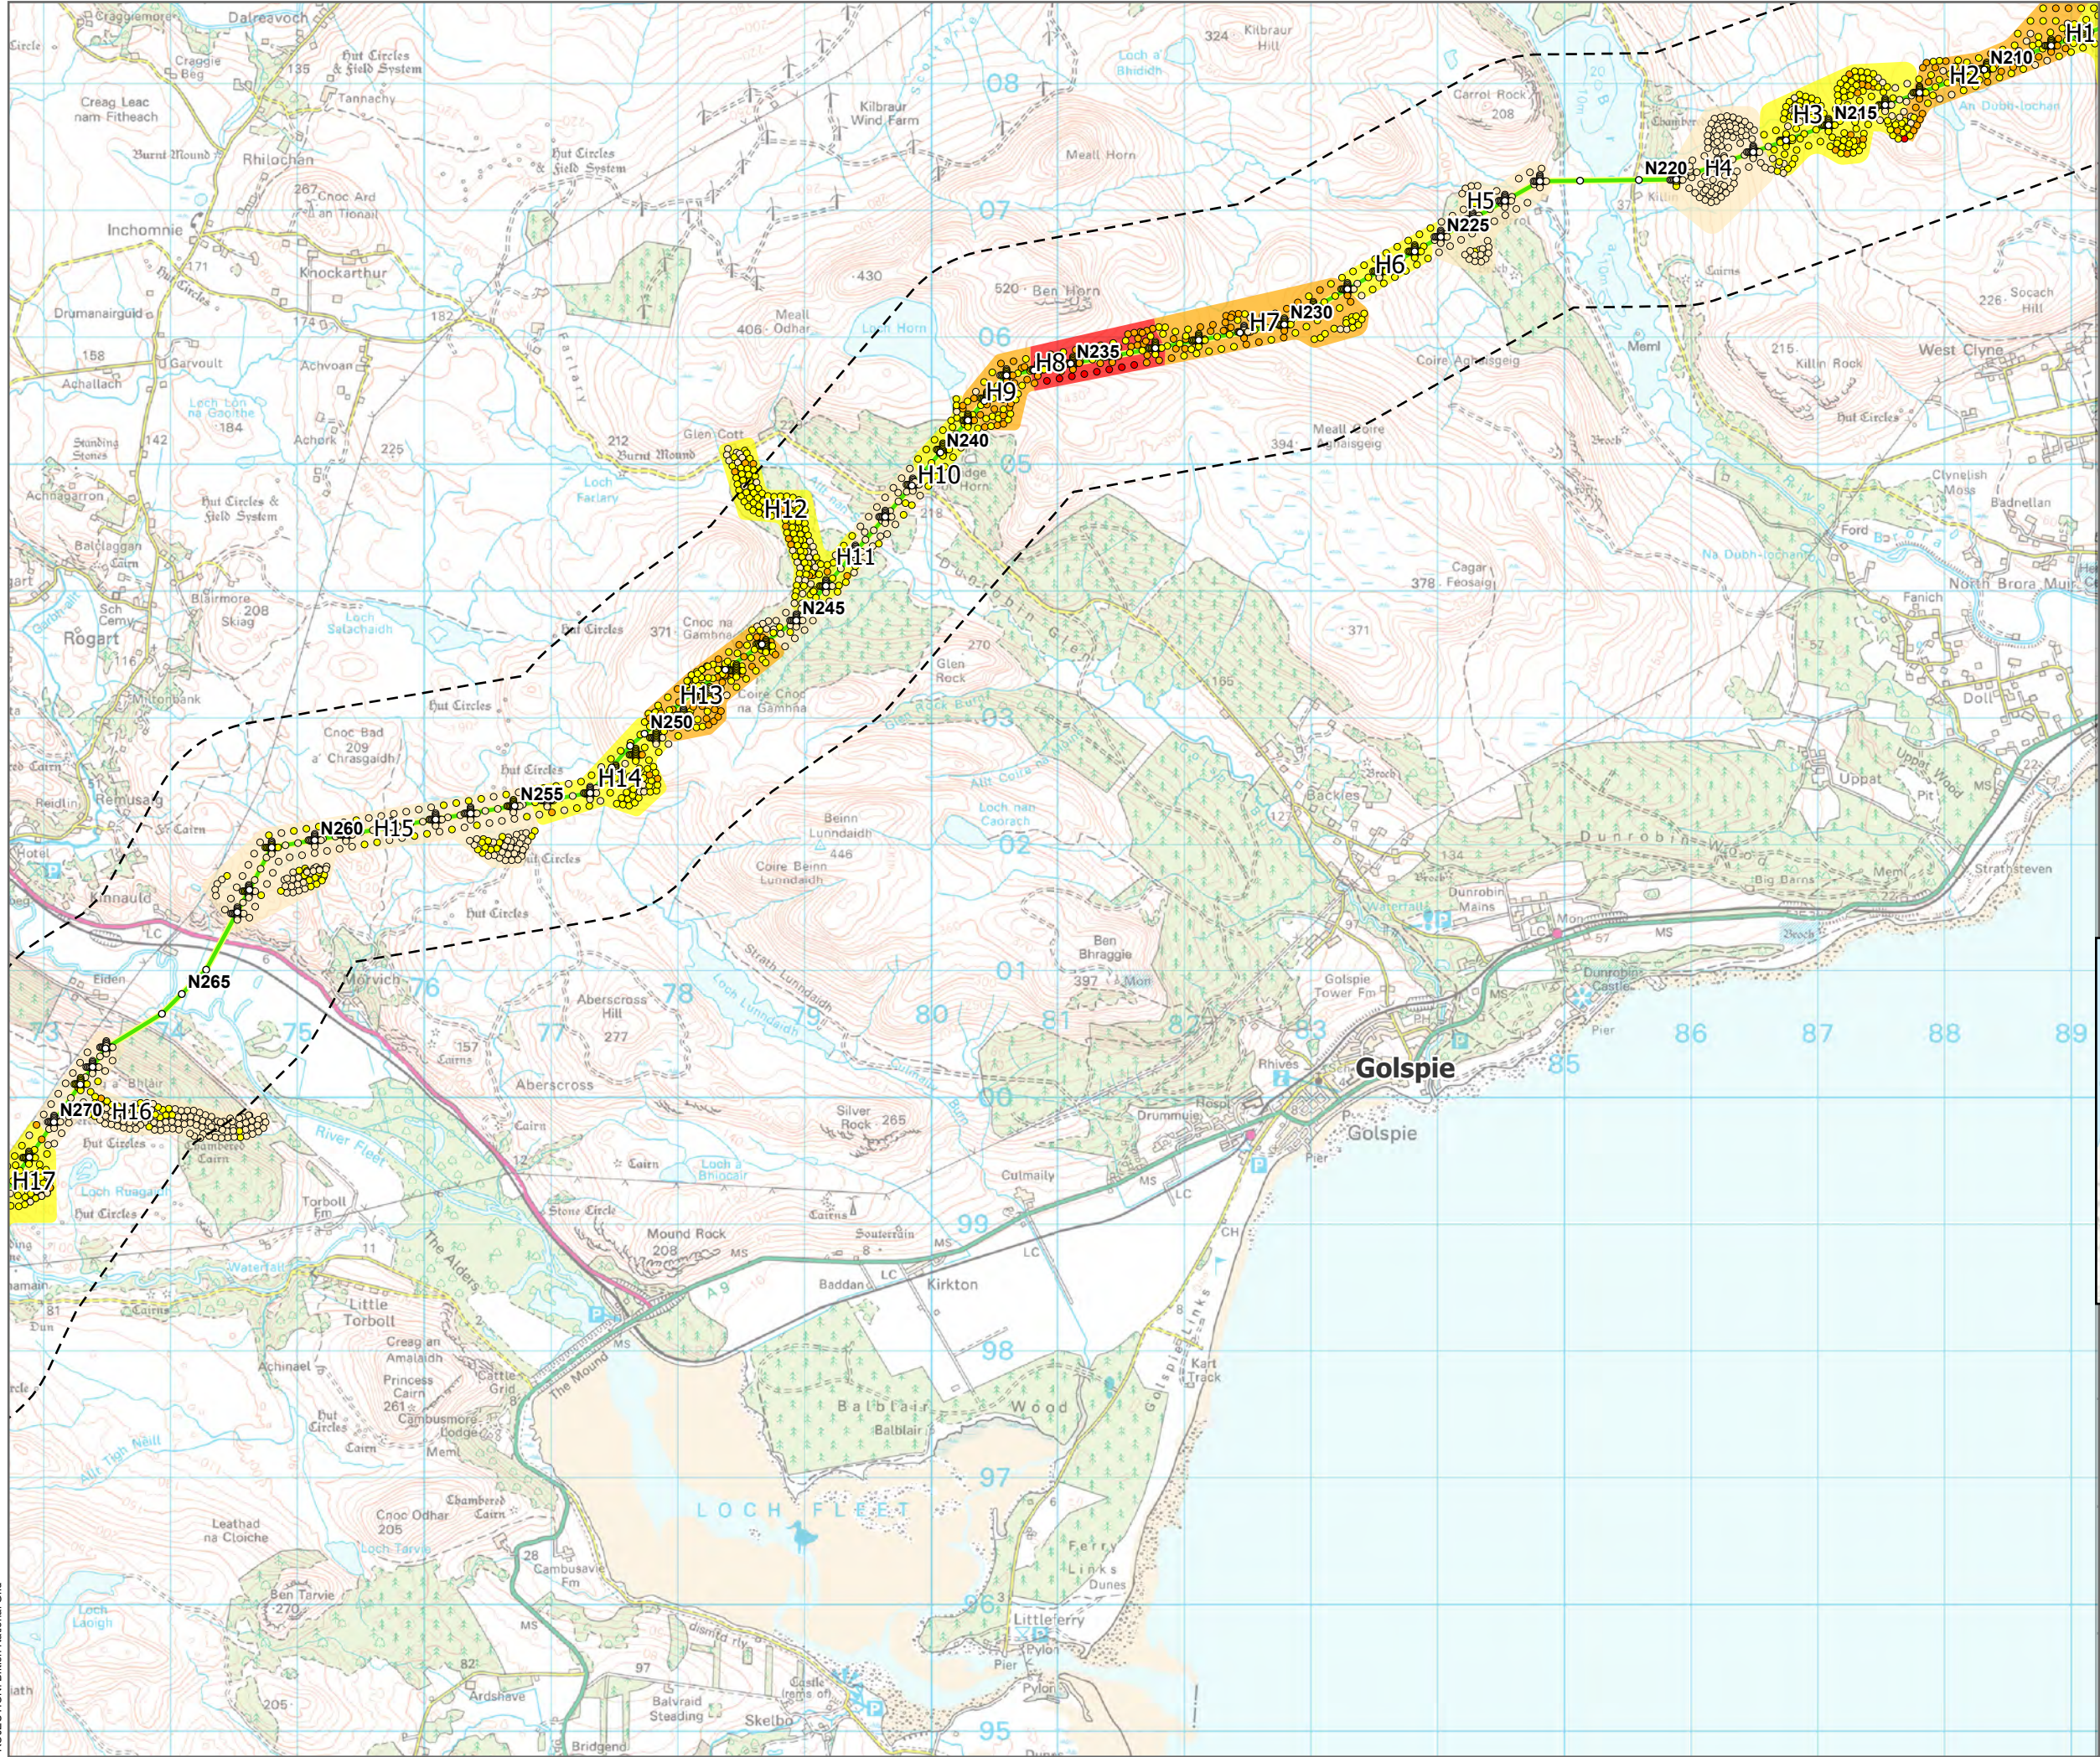

Tower Location

Alignment Section B

Alignment Section Break

Study Area (1 km Buffer)

Hazard Ranking Zone

Negligible

Low

Moderate

High

Hazard Ranking Point

Negligible

Low

Moderate

High

0

500

1,000

1,500

2,000

2,500

Metres

N

SCALE: See Scale Bar

VERSION: A02

SIZE: A3

DRAWN: BW

PROJECT: 0720281

CHECKED: CM

DATE: 07/08/2025

APPROVED: KG

Figure 7 - 6

Spittal - Loch Buidhe - Beaully 400 kV OHL

Connection

Peat Landslide Hazard Risk Assessment

Hazard Ranking Plan

ERM

Scottish & Southern

Electricity Networks

TRANSMISSION

Sources: Esri, TomTom, Garmin, FAO, NOAA, USGS, © OpenStreetMap contributors, and the GIS User Community, Esri, USGS; © Landmark Information Group Limited and/or its Data Suppliers (All rights reserved 2010)

Path: \\ukspdrGIS\011Data\Arcus\Projects\0652629 - SSE Beaully to Loch Buidhe\Workspace\Engineering\SLBB Engineering v1.aprx - 0652659 - Figure 11.1.7 - Hazard Ranking Plan - A01



Tower Location

Alignment Section B

Alignment Section C

Alignment Section Break

Study Area (1 km Buffer)

Hazard Ranking Zone

Negligible

Low

Moderate

High

Hazard Ranking Point

Negligible


Low

Moderate

High

SCALE: See Scale Bar	VERSION: A02
SIZE: A3	DRAWN: BW
PROJECT: 0720281	CHECKED: CM
DATE: 07/08/2025	APPROVED: KG

Figure 7 - 7
Spittal - Loch Buidhe - Beaulieu 400 kV OHL
Connection
Peat Landslide Hazard Risk Assessment
Hazard Ranking Plan

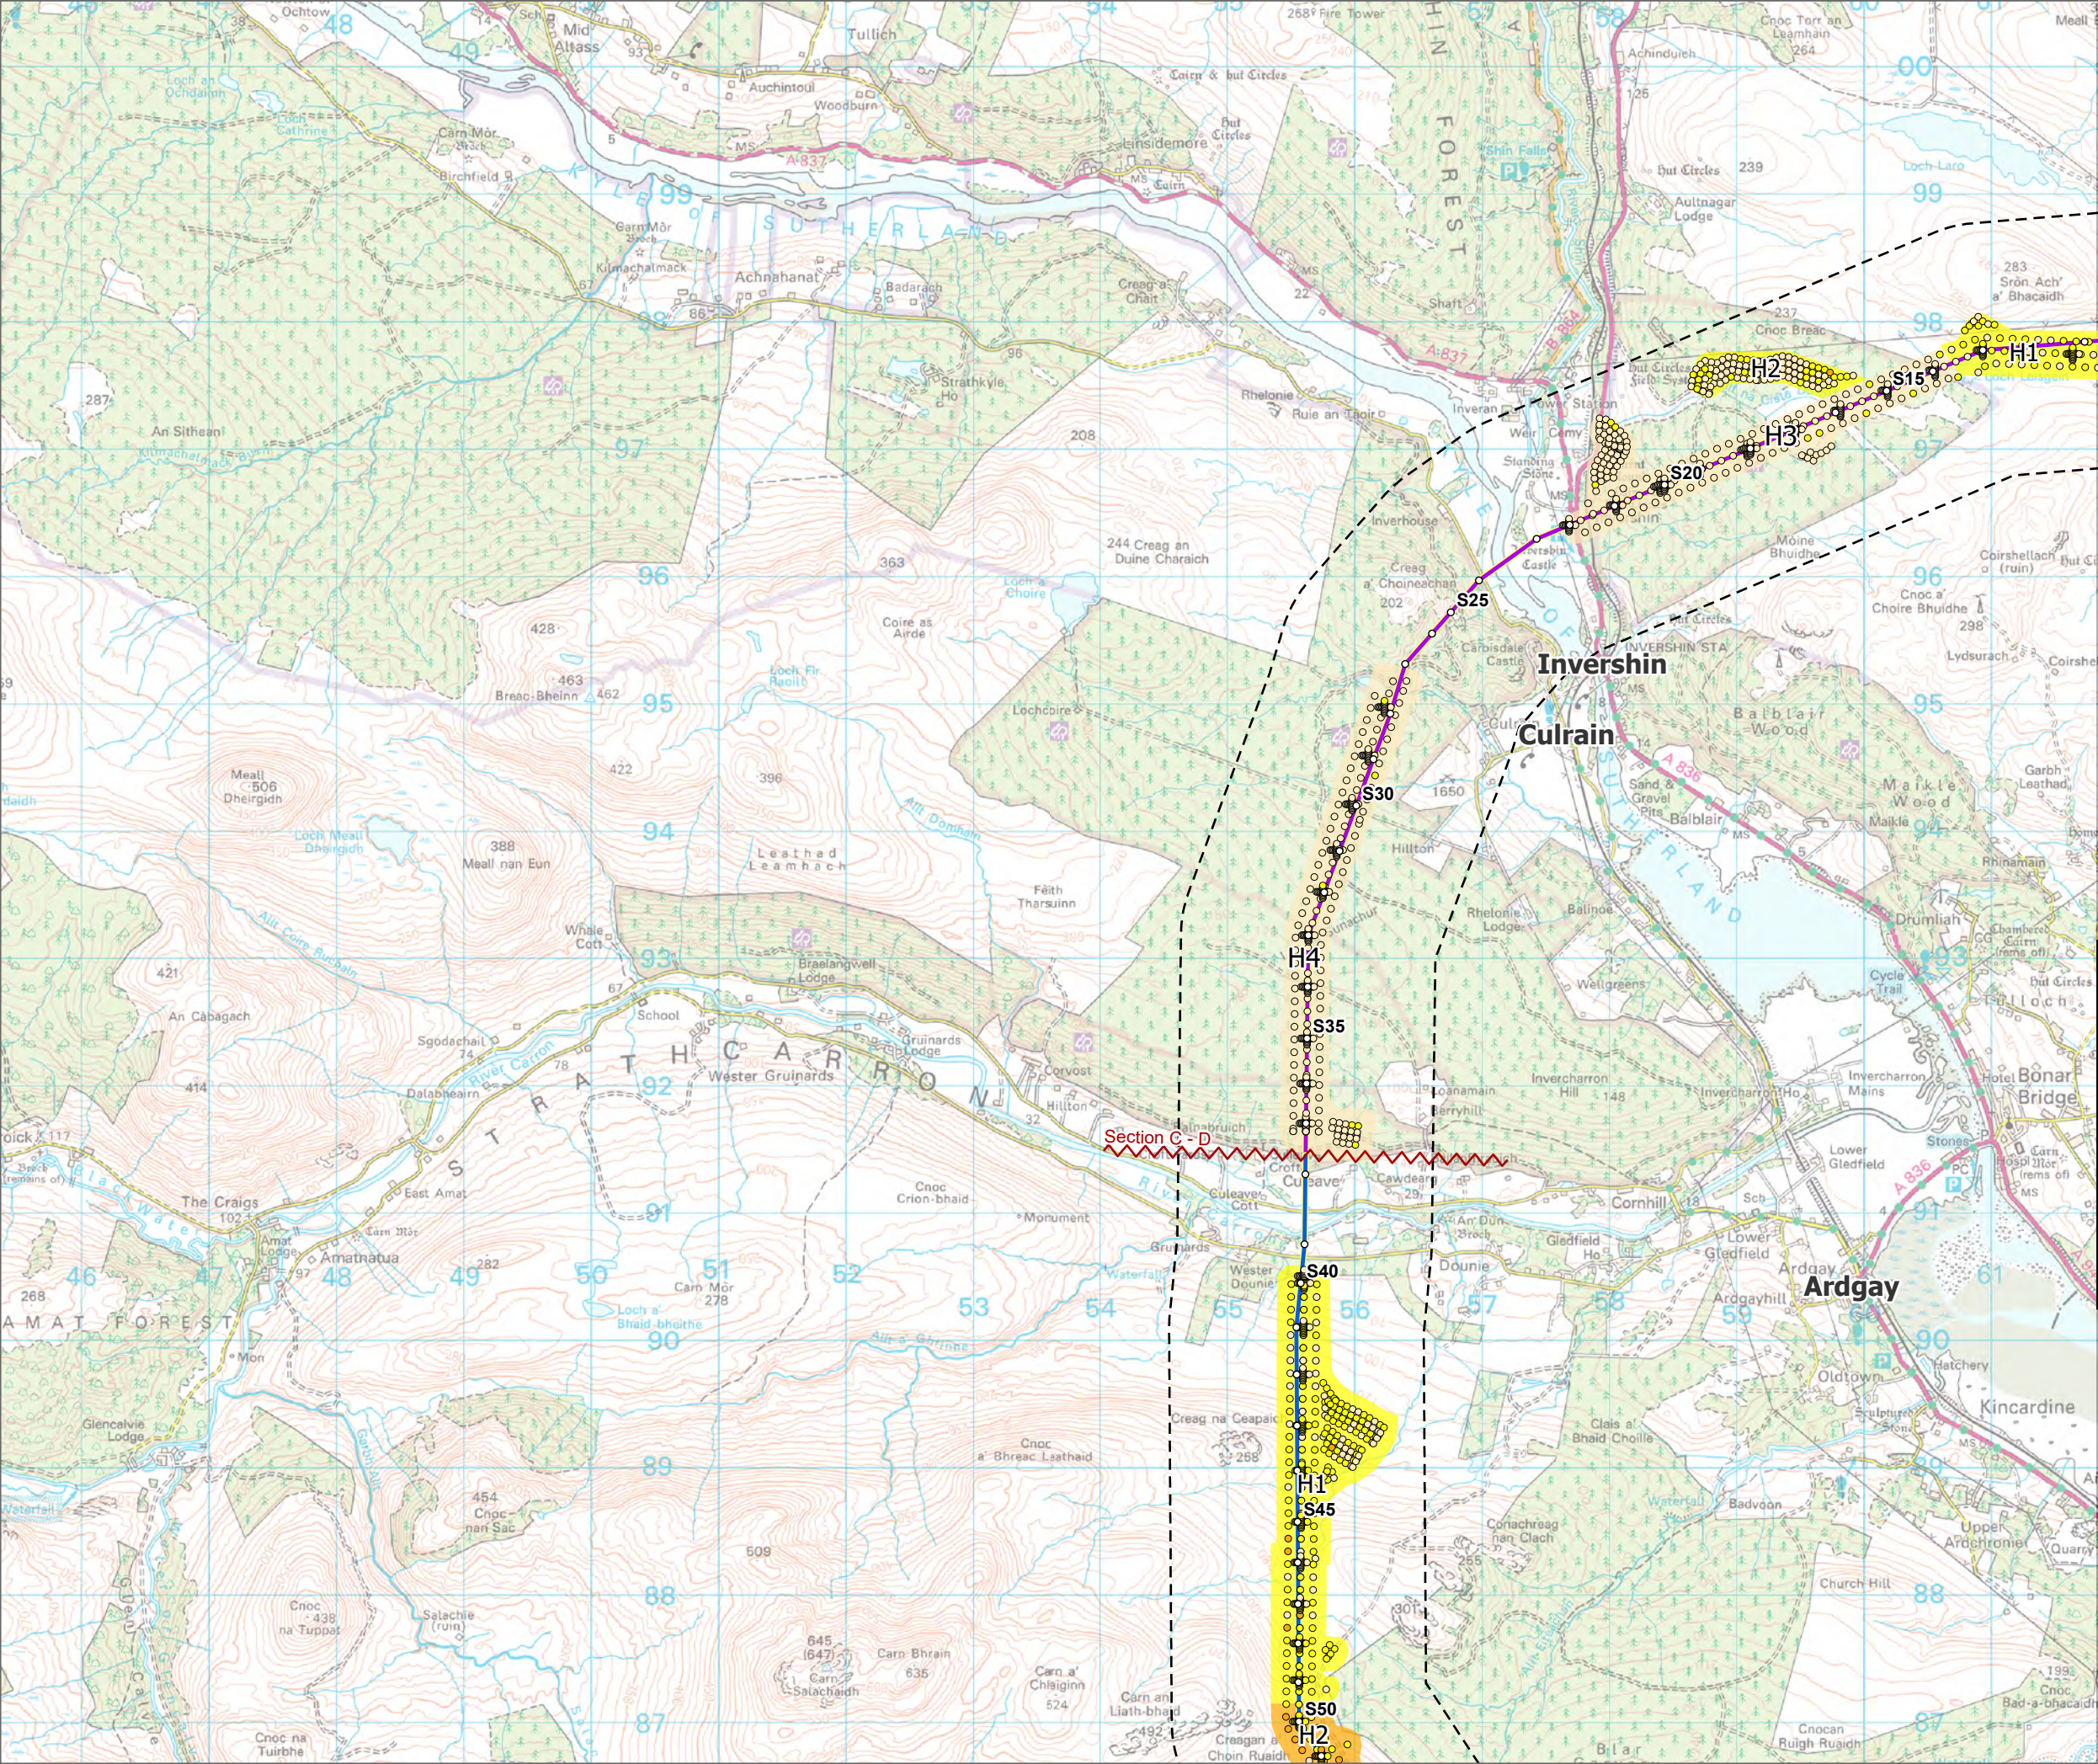

Tower Location

Alignment Section C

Alignment Section D

Alignment Section Break

Study Area (1 km Buffer)

Negligible

Low

Moderate

High

Negligible

Low

Moderate

High

Figure 7 - 8

Spittal - Loch Buidhe - Beaulieu 400 kV OHL Connection

Peat Landslide Hazard Risk Assessment


Hazard Ranking Plan

ERM

Scottish & Southern Electricity Networks

Sources: Esri, TomTom, Garmin, FAO, NOAA, USGS, © OpenStreetMap contributors, and the GIS User Community, Esri, USGS; © Landmark Information Group Limited and/or its Data Suppliers (All rights reserved 2010)

Path: \\ukspgdis011\Data\Arcus\Projects\0652629 - SSE Beaulieu to Loch Buidhe\Workspace\Engineering\SLBB Engineering v1.aprx - 0652659 - Figure 11.1.7 - Hazard Ranking Plan - A01

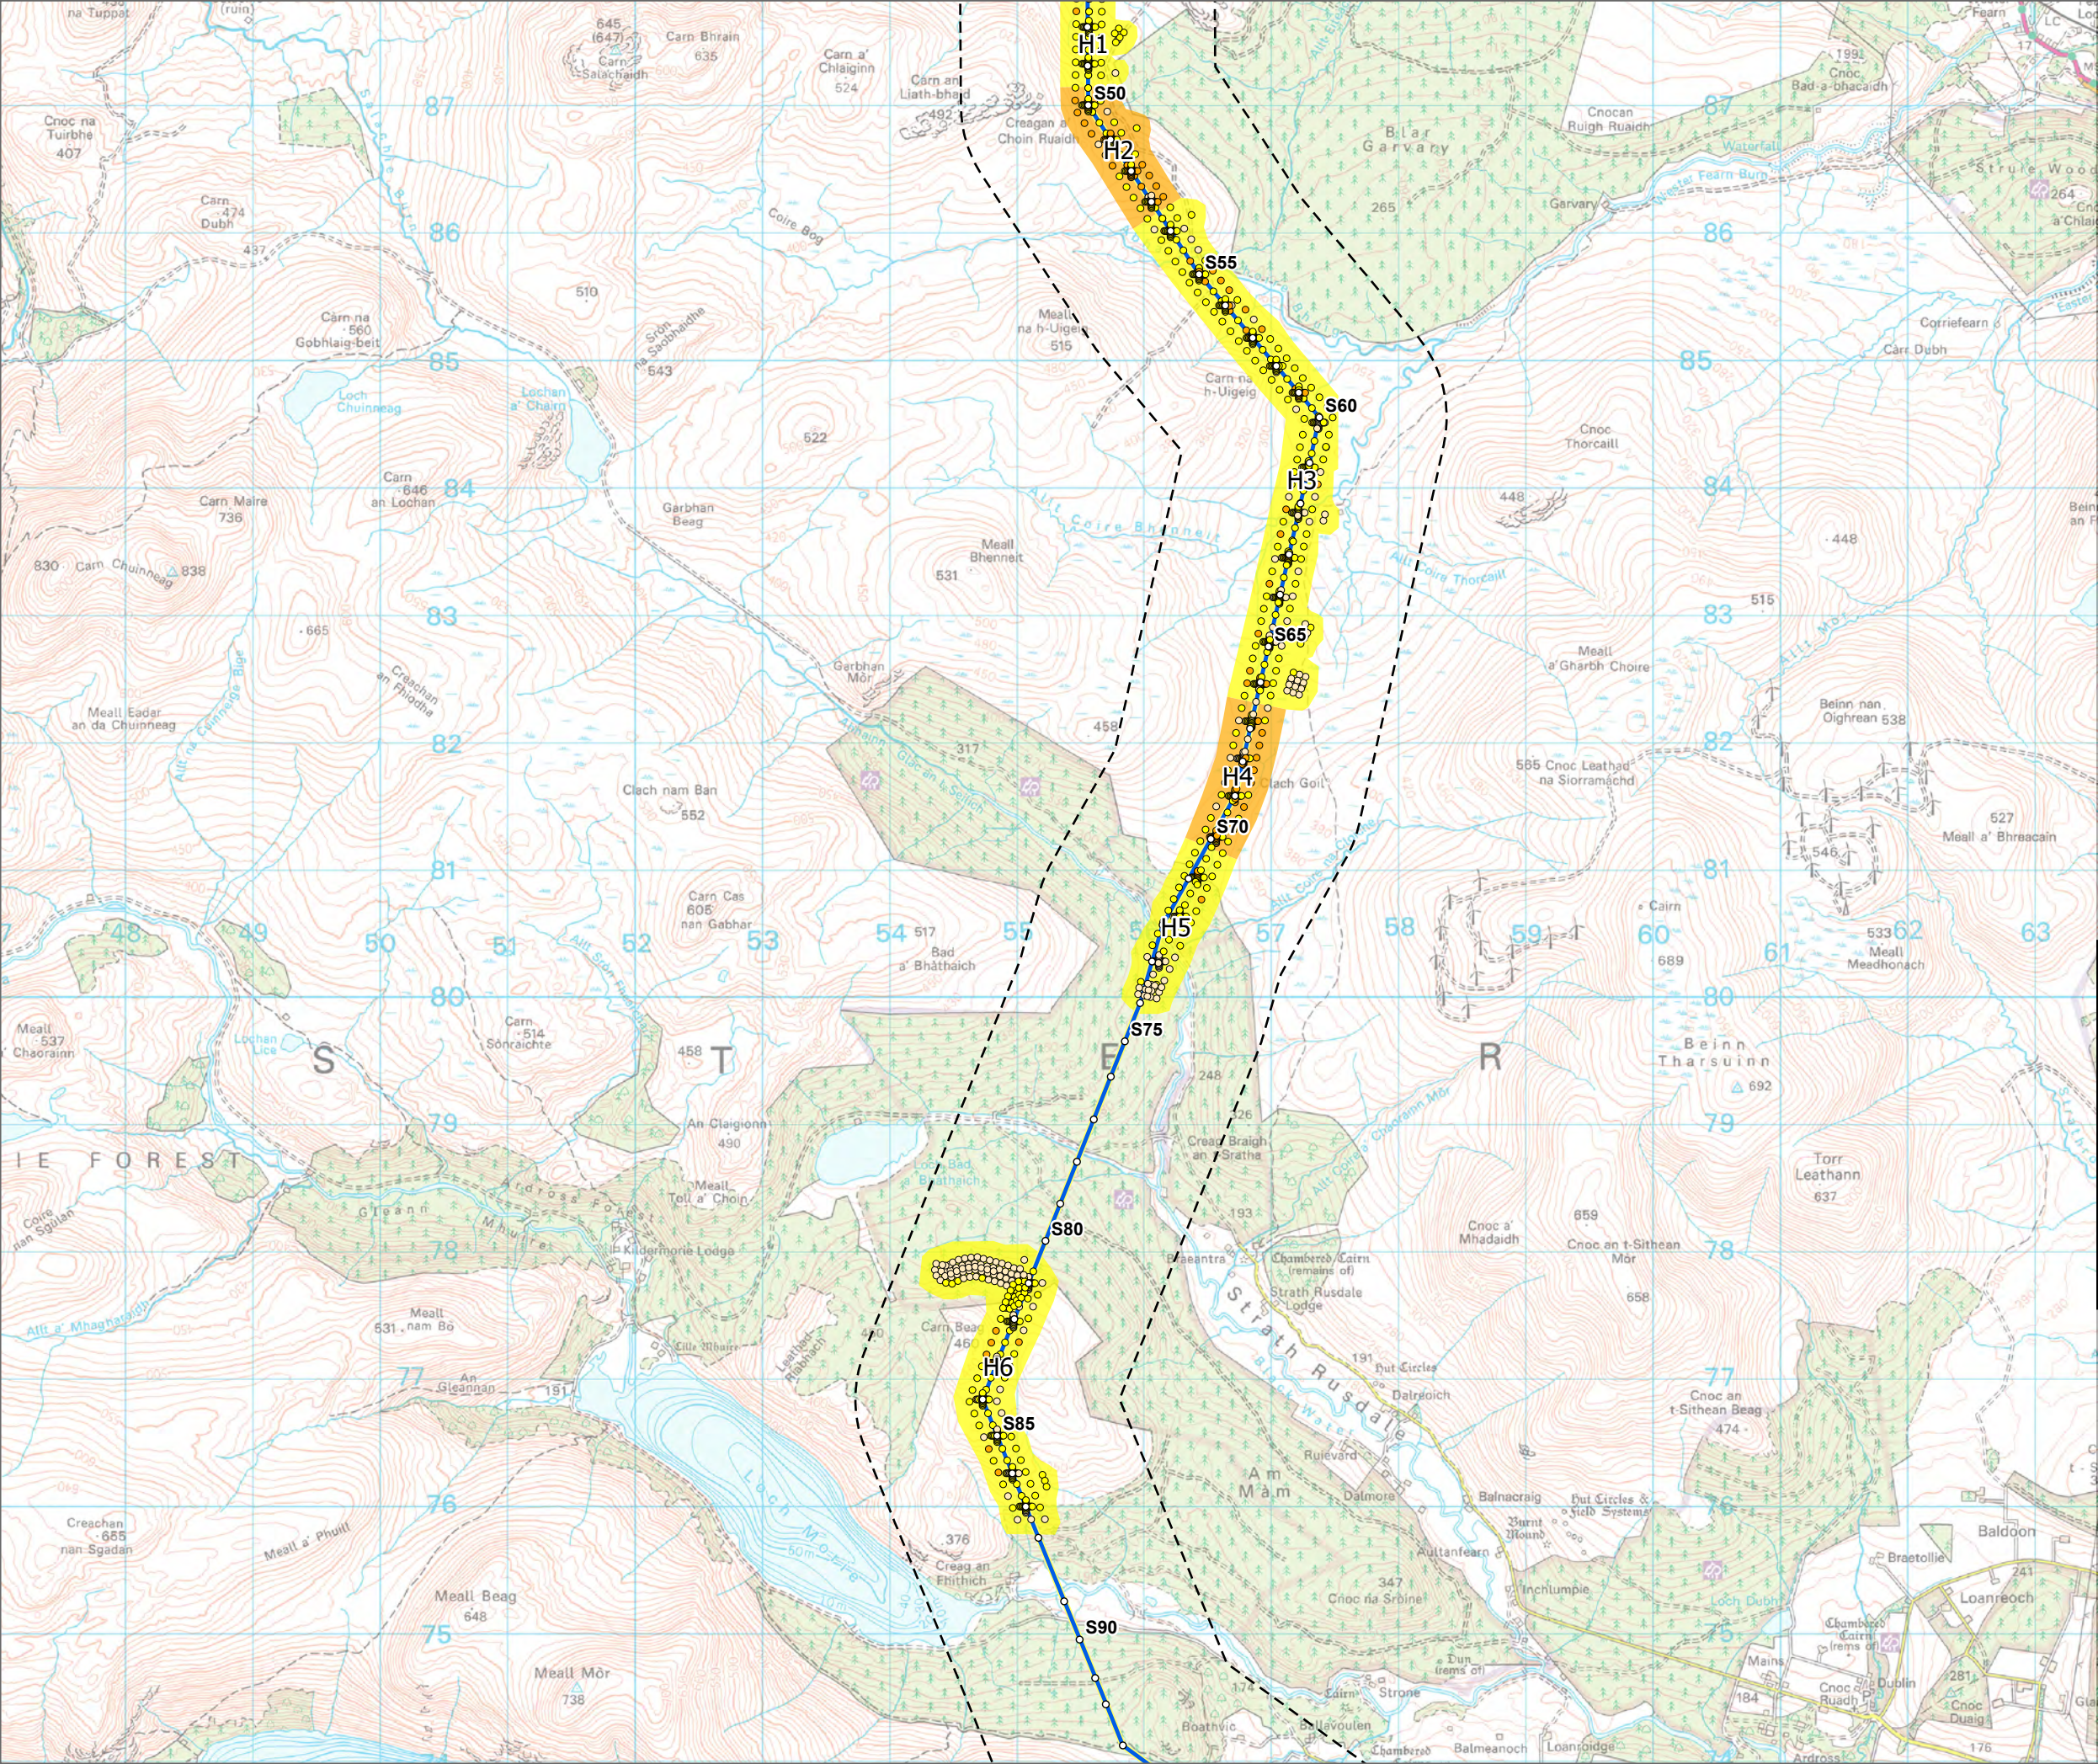

Tower Location

Alignment Section D

Alignment Section Break

Study Area (1 km Buffer)

Hazard Ranking Zone

Negligible

Low

Moderate

High

Hazard Ranking Point

Negligible

Low

Moderate

High

0

500

1,000

1,500

2,000

2,500

Metres

N

SCALE: See Scale Bar

SIZE: A3

PROJECT: 0720281

DATE: 07/08/2025

VERSION: A02

DRAWN: BW

CHECKED: CM

APPROVED: KG

Figure 7 - 9

Spittal - Loch Buidhe - Beaully 400 kV OHL Connection

Peat Landslide Hazard Risk Assessment


Hazard Ranking Plan

ERM

Scottish & Southern Electricity Networks

Sources: Esri, TomTom, Garmin, FAO, NOAA, USGS, © OpenStreetMap contributors, and the GIS User Community, Esri, USGS; © Landmark Information Group Limited and/or its Data Suppliers (All rights reserved 2010)

Path: \\ukspgdisfs01\Data\Arcus\Projects\0652629 - SSE Beaully to Loch Buidhe\Workspace\Engineering\SLBB Engineering v1.aprx - 0652659 - Figure 11.1.7 - Hazard Ranking Plan - A01

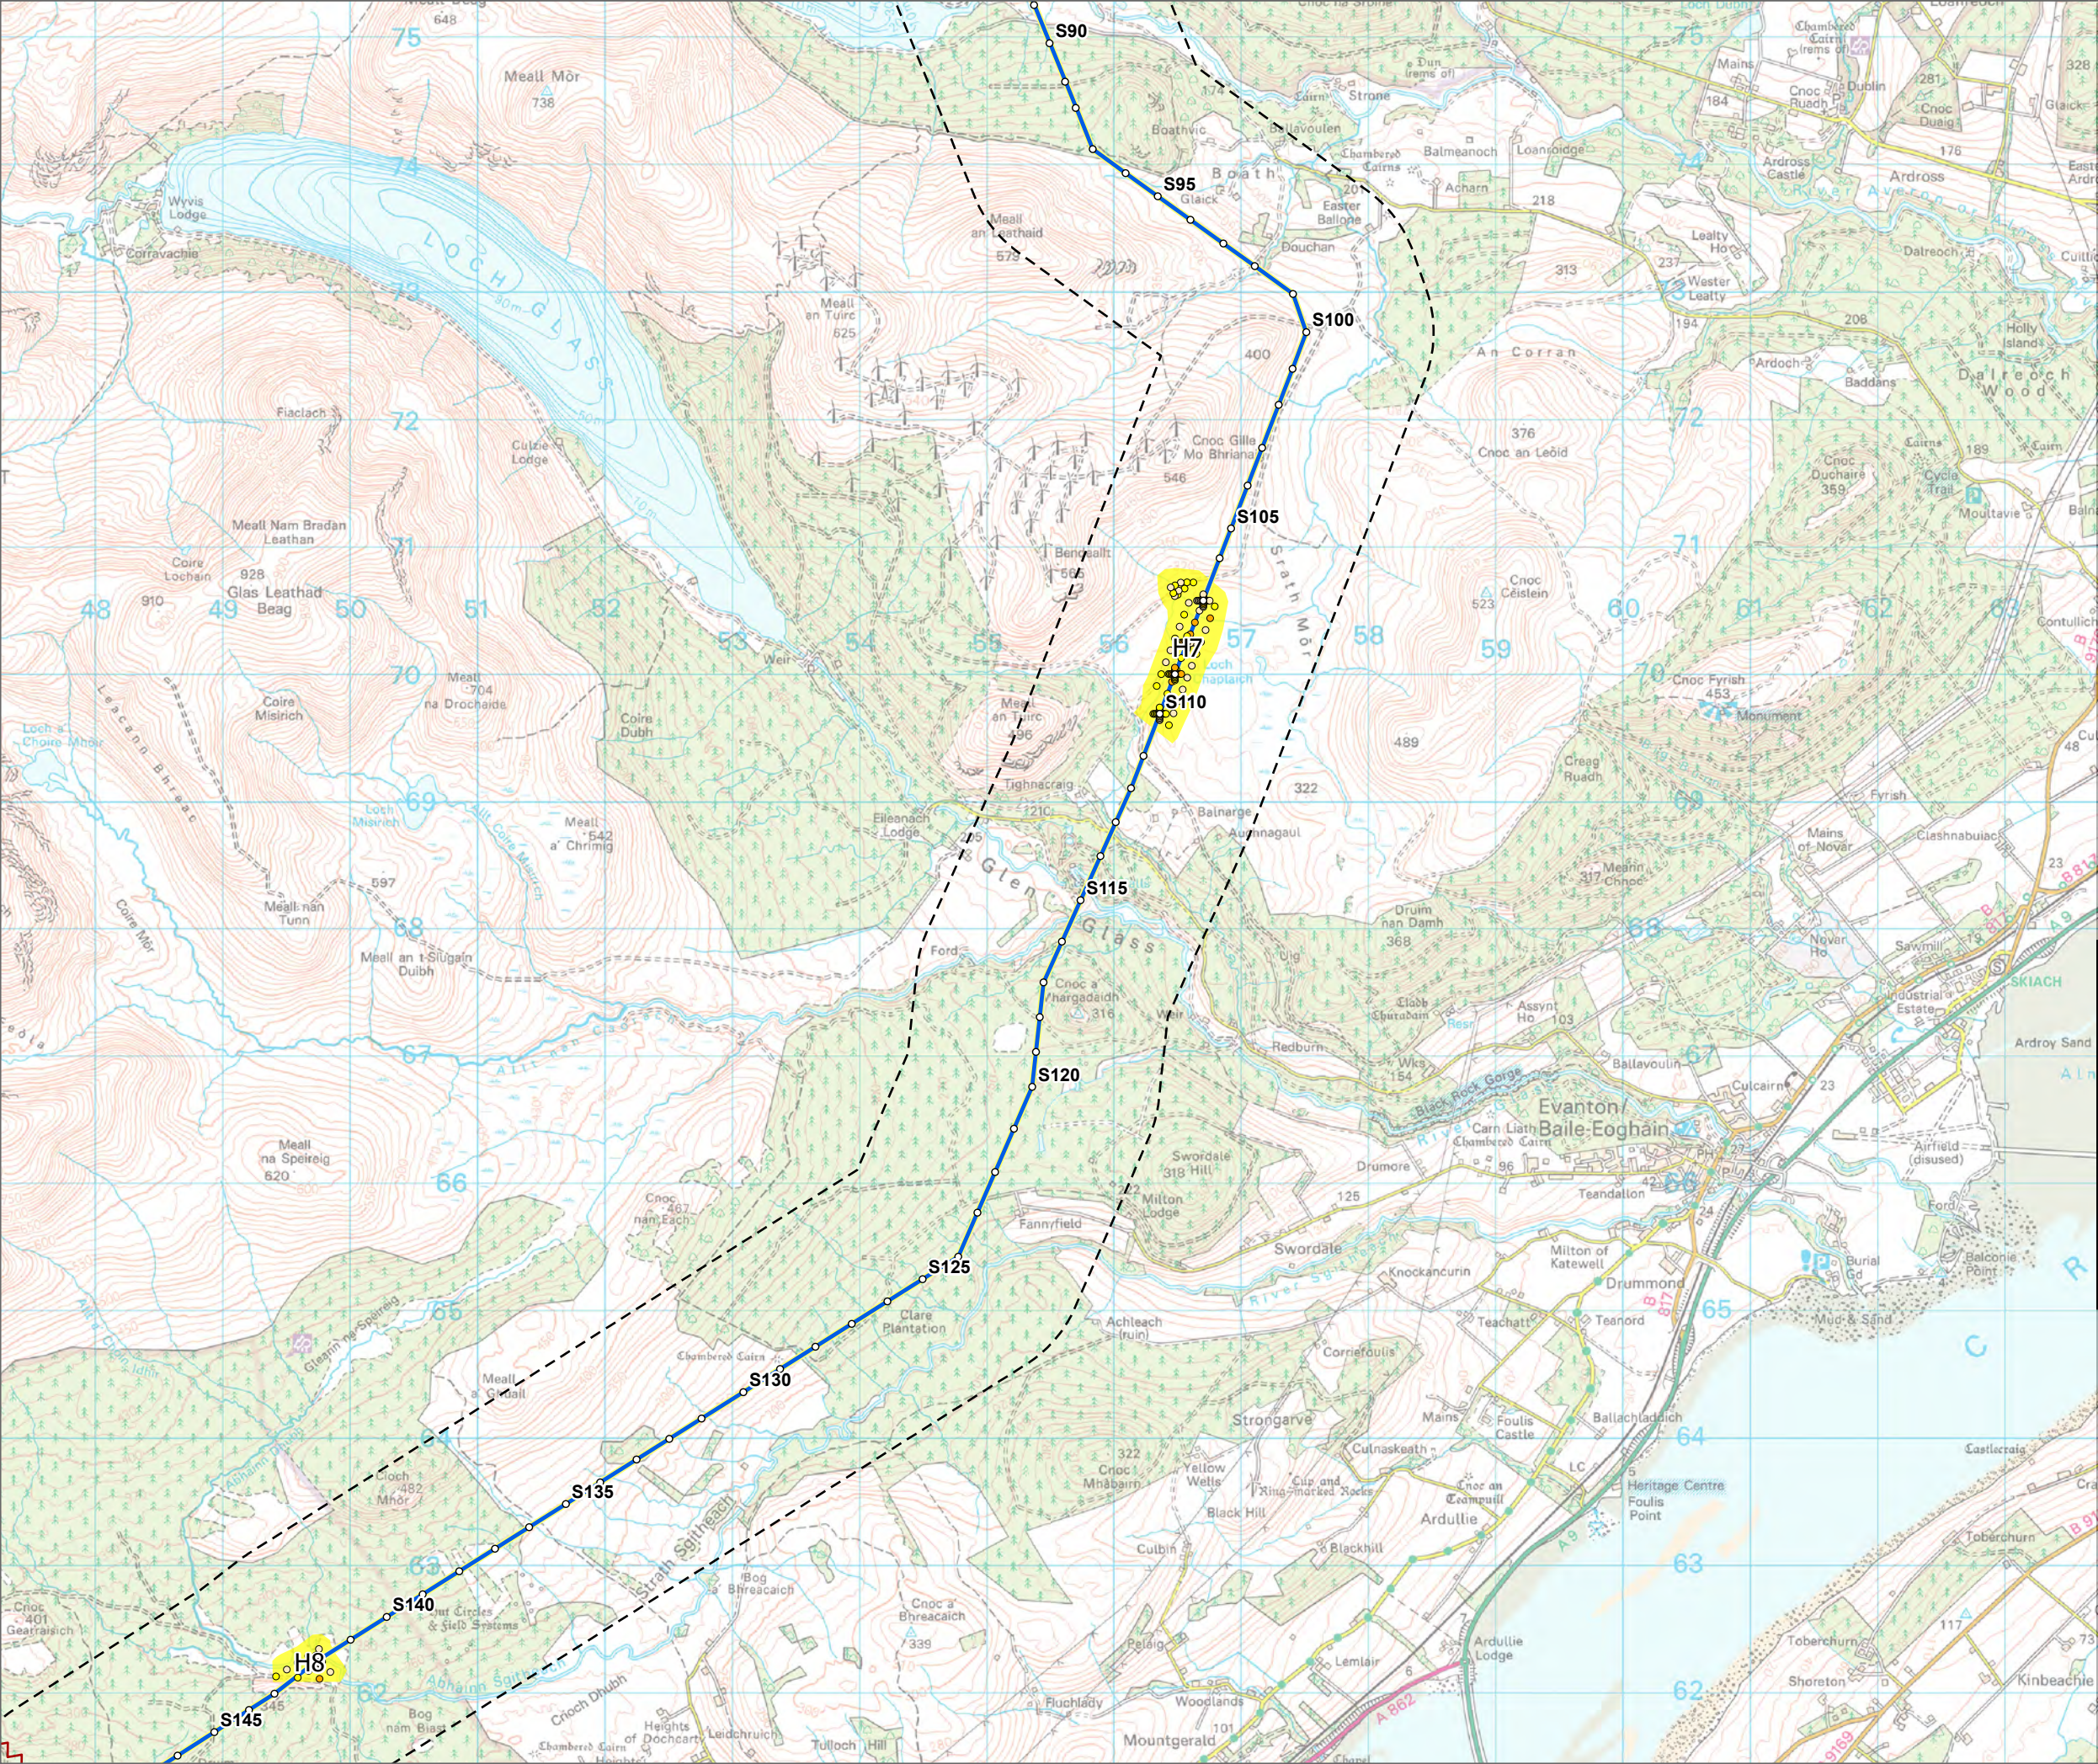

○ Tower Location

— Alignment Section D

— Alignment Section Break

- - - Study Area (1 km Buffer)

Hazard Ranking Zone

Negligible

Low

Moderate

High

Hazard Ranking Point

Negligible

Low

Moderate

High

0 500 1,000 1,500 2,000 2,500

Metres

SCALE: See Scale Bar

SIZE: A3

PROJECT: 0720281

DATE: 07/08/2025


VERSION: A02

DRAWN: BW

CHECKED: CM

APPROVED: KG

Figure 7 - 10
Spittal - Loch Buidhe - Beaulieu 400 kV OHL
Connection
Peat Landslide Hazard Risk Assessment
Hazard Ranking Plan

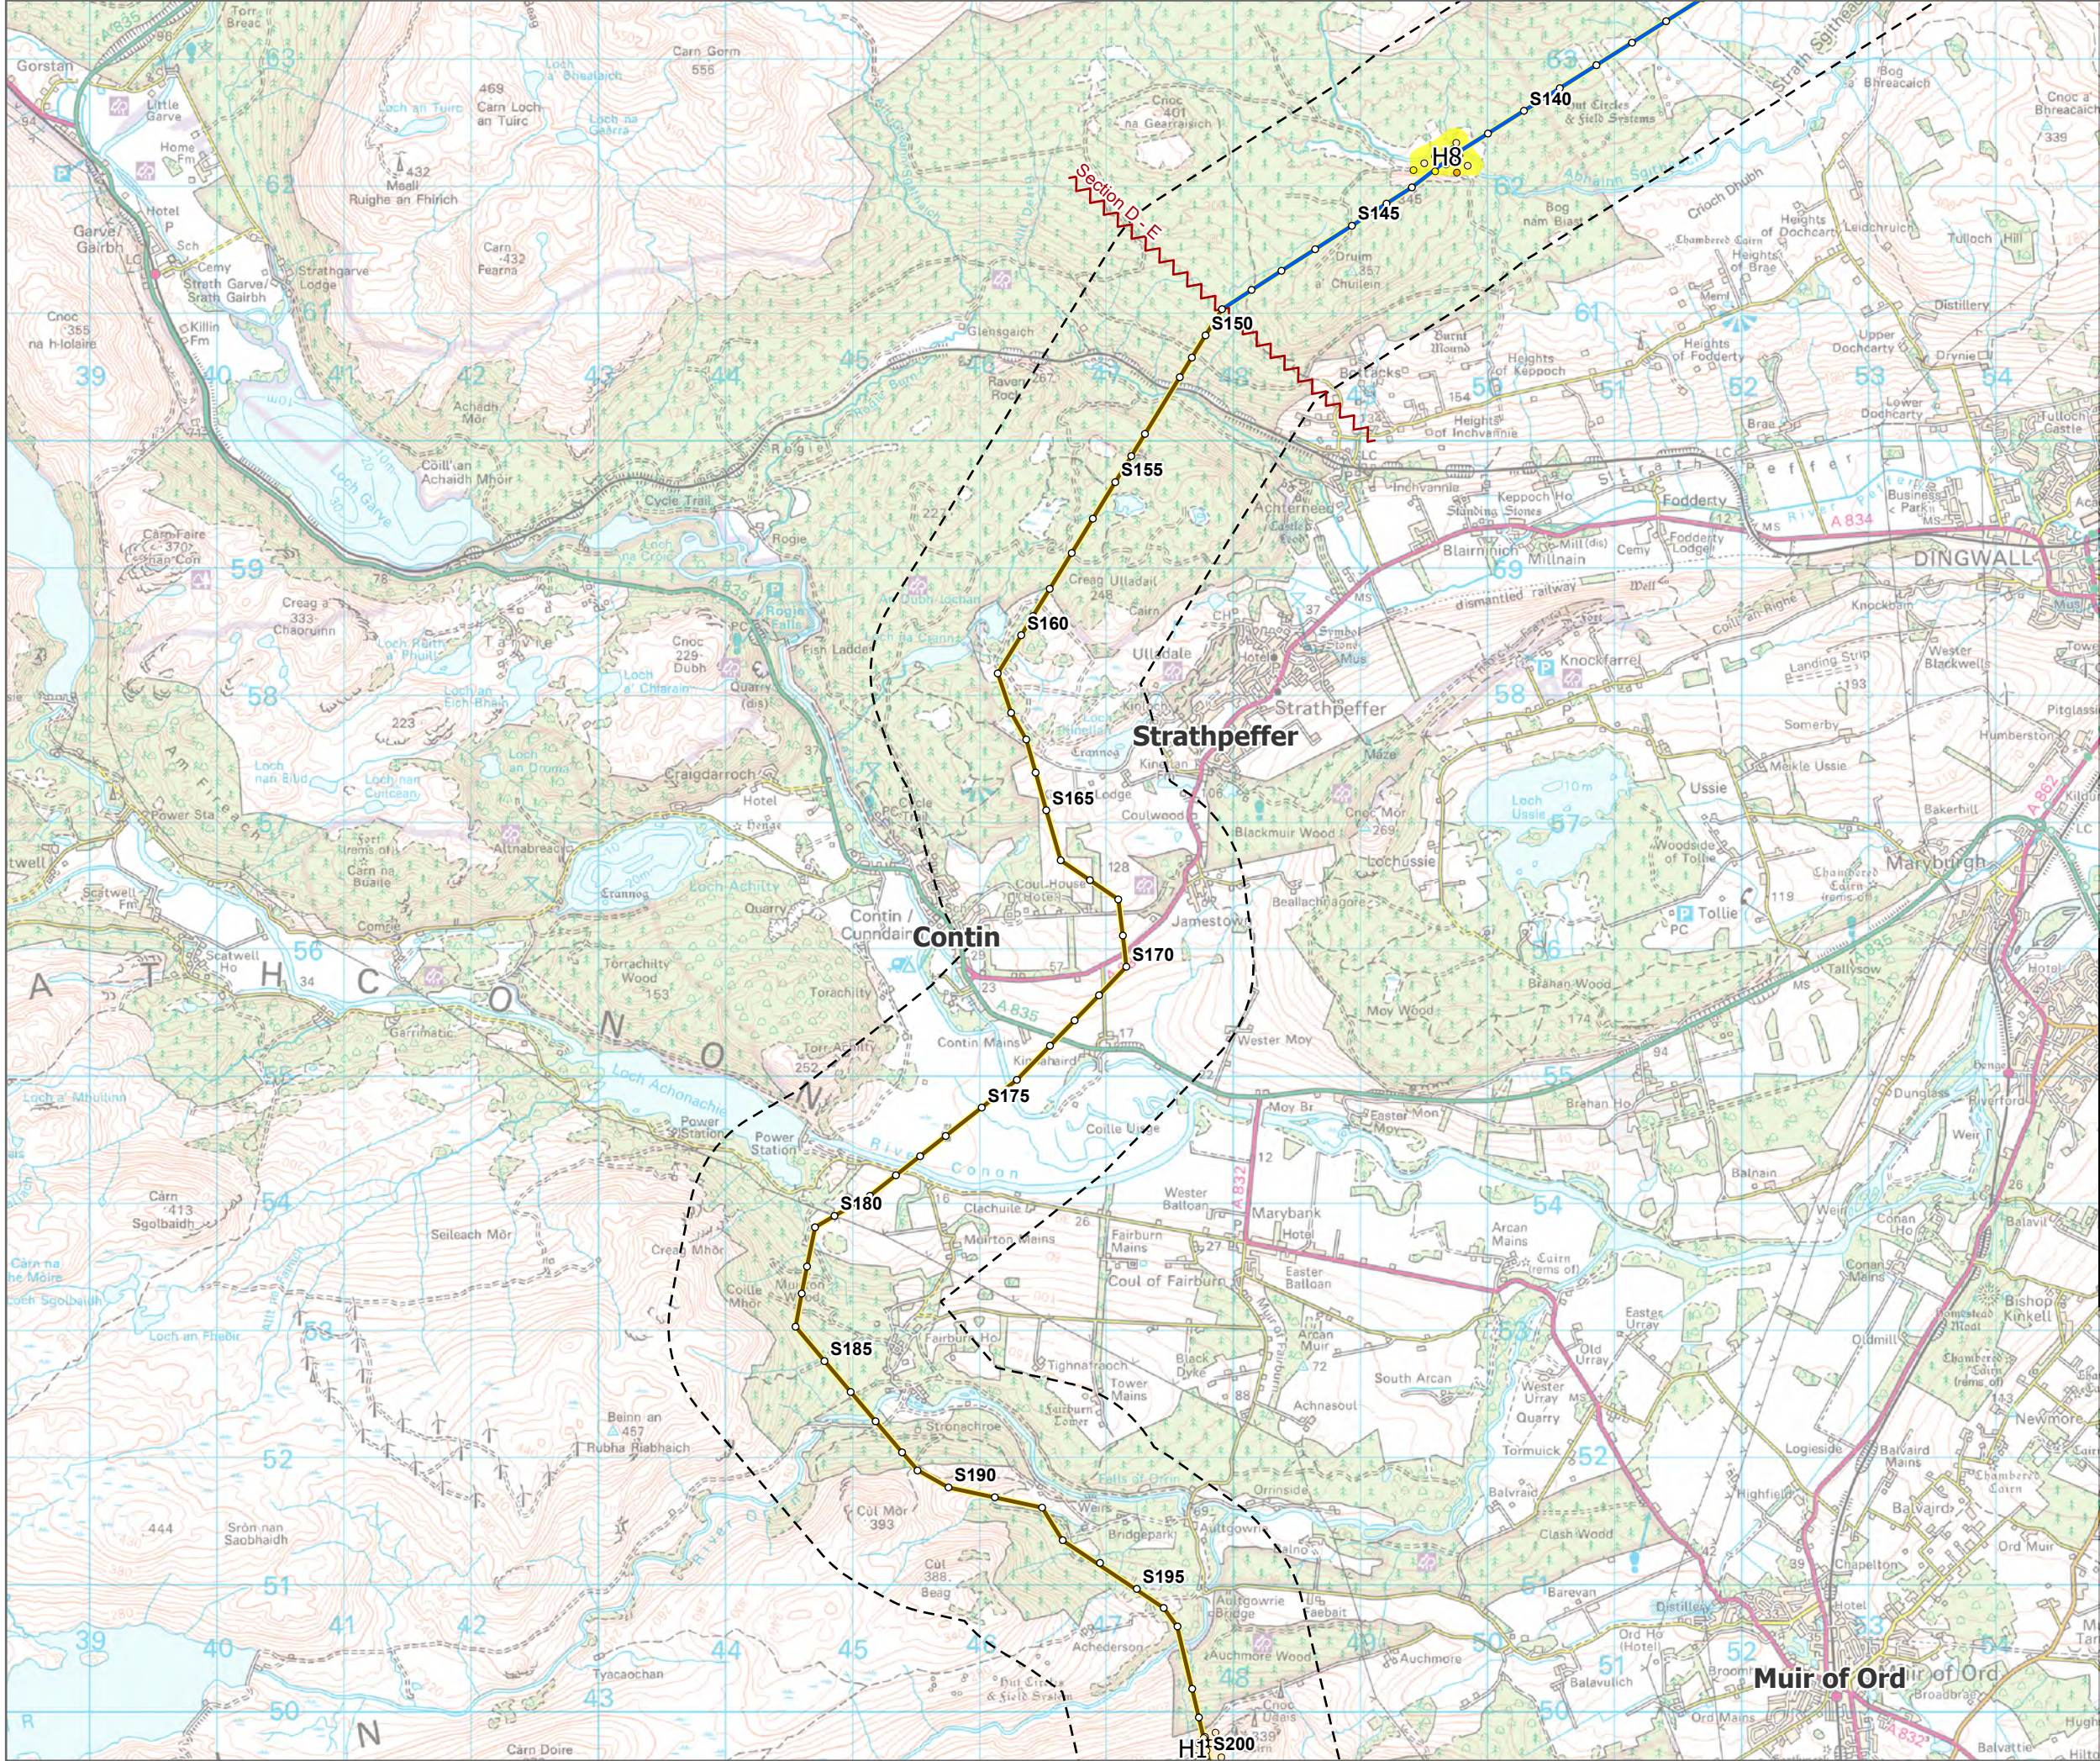

Tower Location

Alignment Section D

Alignment Section E

Alignment Section Break

Study Area (1 km Buffer)

Hazard Ranking Zone

Negligible

Low

Moderate

High

Hazard Ranking Point

Negligible

Low

Moderate

High

0

500

1,000

1,500

2,000

2,500

Metres

N

SCALE: See Scale Bar

SIZE: A3

PROJECT: 0720281

DATE: 07/08/2025

VERSION: A02

DRAWN: BW

CHECKED: CM

APPROVED: KG

Figure 7 - 11

Spittal - Loch Buidhe - Beaully 400 kV OHL Connection

Peat Landslide Hazard Risk Assessment

Hazard Ranking Plan

ERM


Scottish & Southern Electricity Networks

TRANSMISSION

PROJECTION: British National Grid

Sources: Esri, TomTom, Garmin, FAO, NOAA, USGS, © OpenStreetMap contributors, and the GIS User Community, Esri, USGS; © Landmark Information Group Limited and/or its Data Suppliers (All rights reserved 2010)

Path: \\ukspdrdgs011\Data\Arcus\Projects\0652629 - SSE Beaully to Loch Buidhe\Workspace\Engineering\SLBB Engineering v1.aprx - 0652659 - Figure 11.1.7 - Hazard Ranking Plan - A01

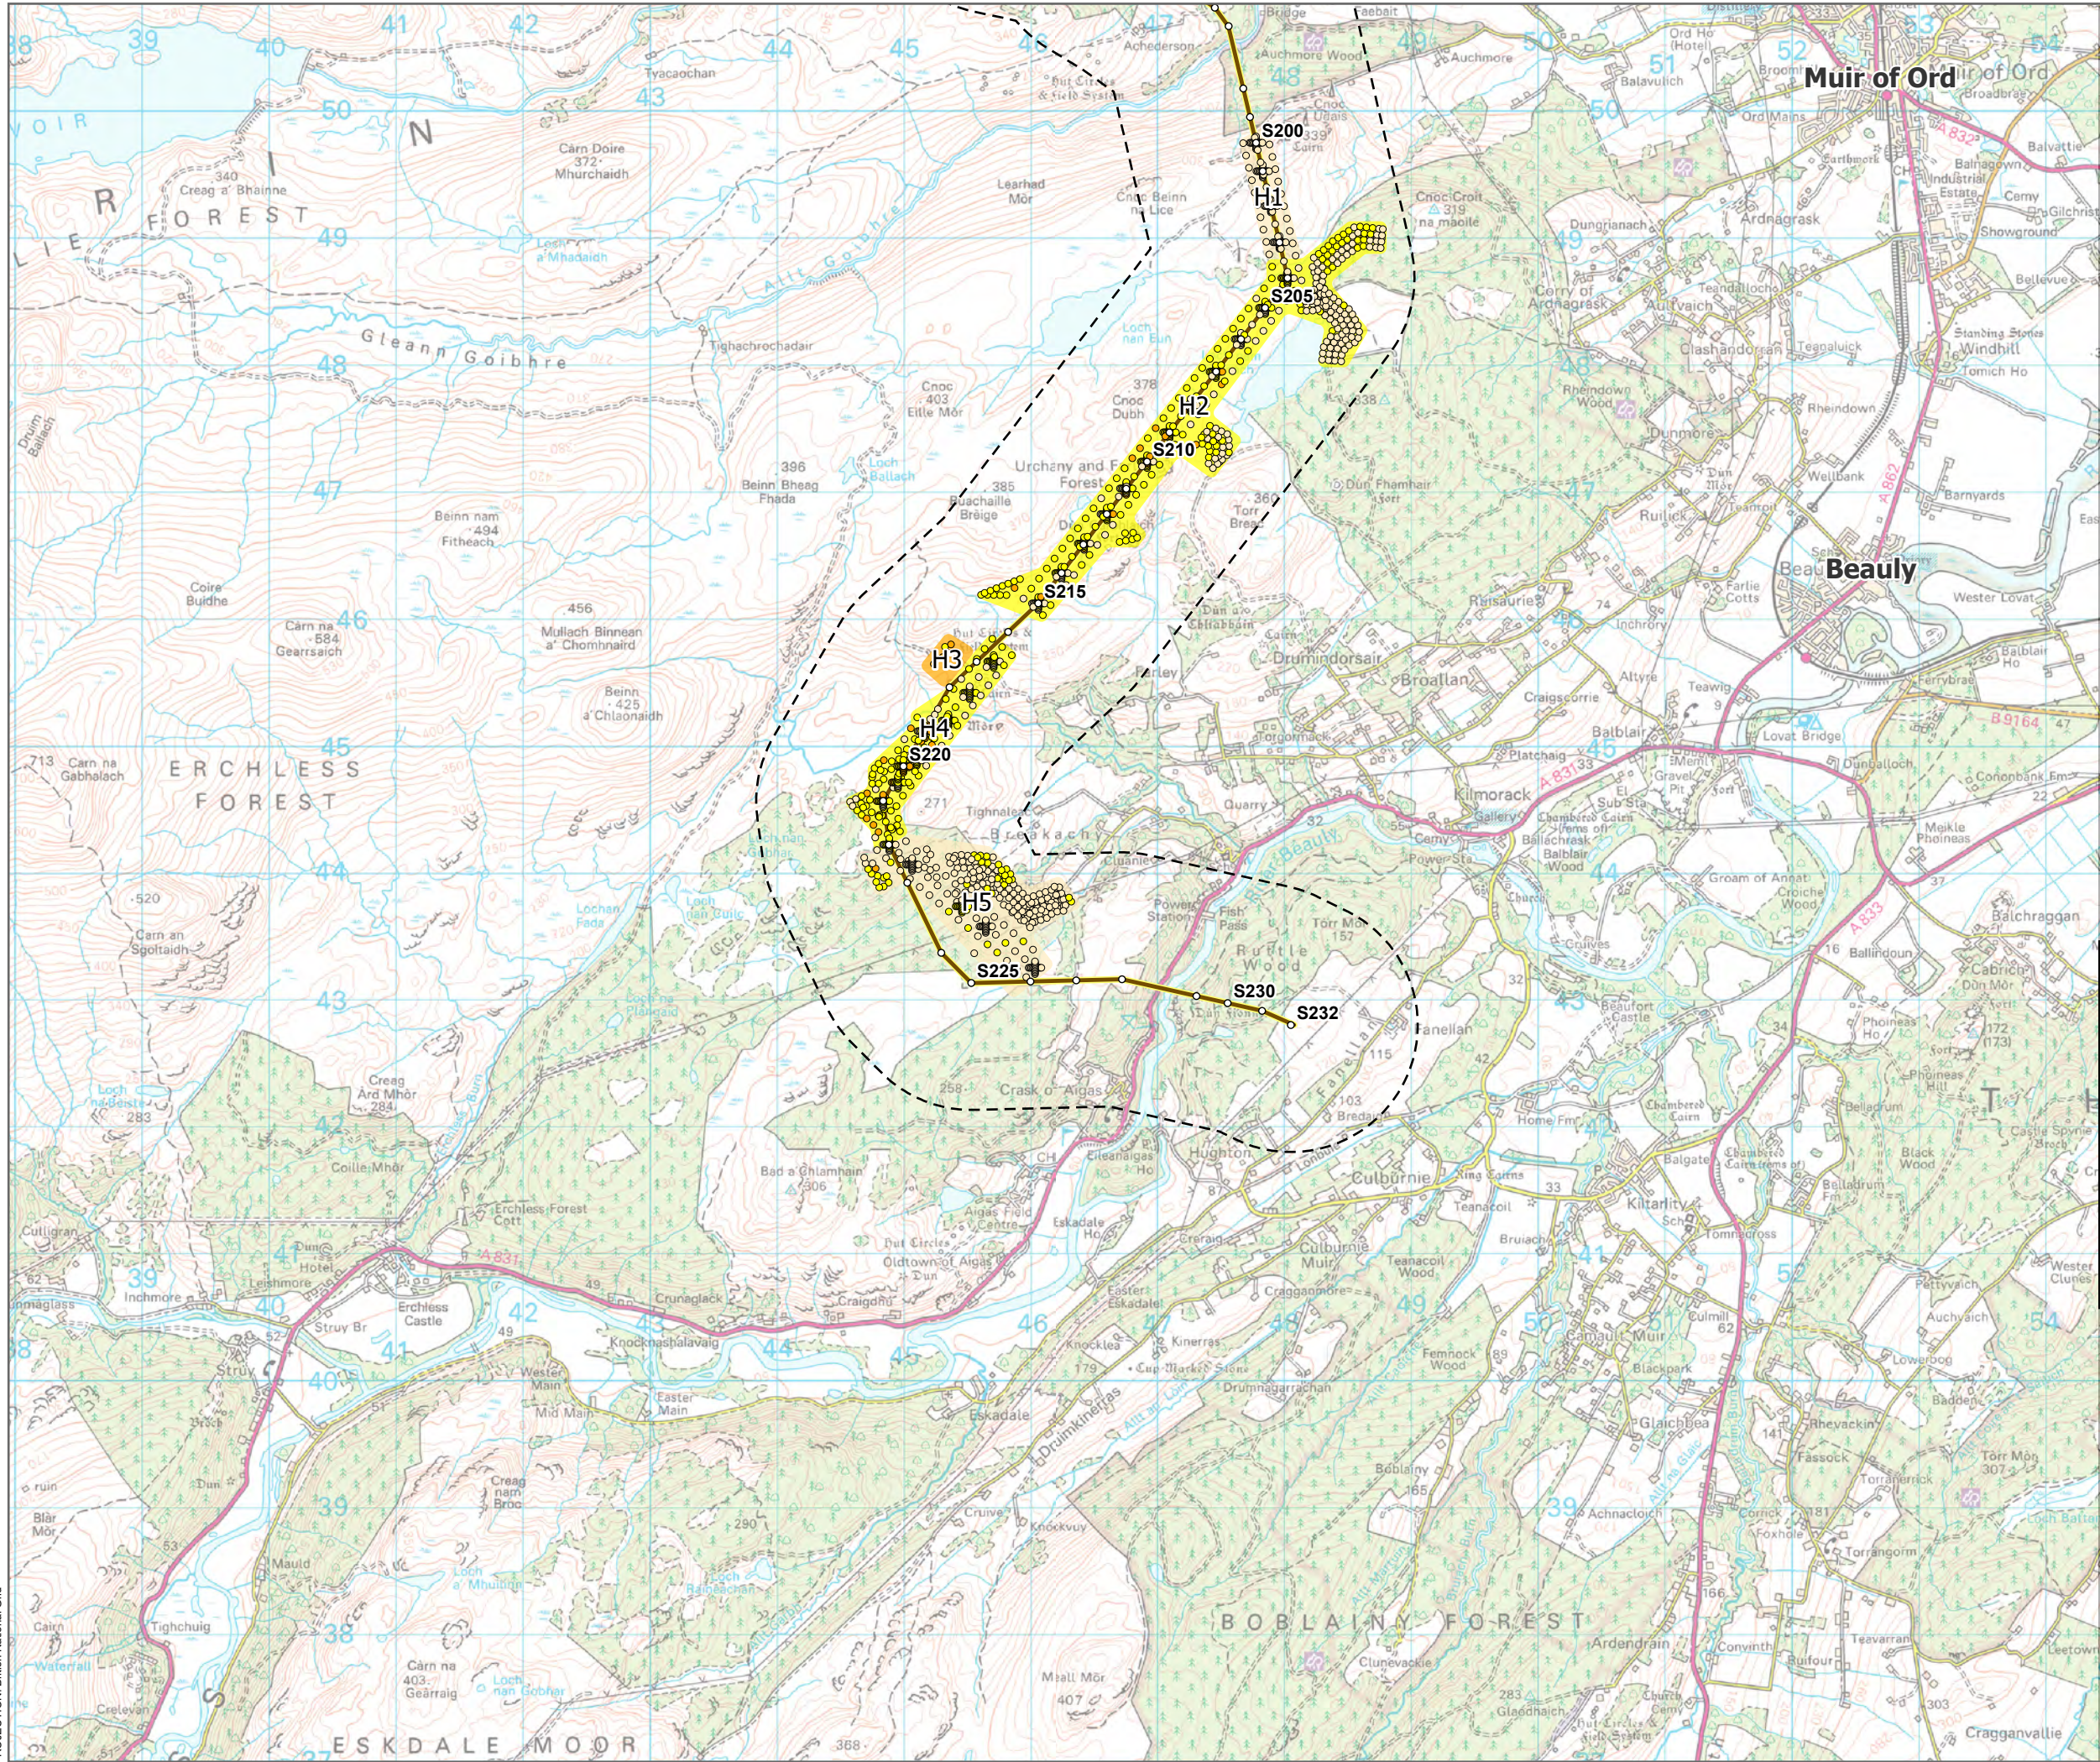

○ Tower Location

— Alignment Section E

--- Alignment Section Break

--- Study Area (1 km Buffer)

Hazard Ranking Zone

Negligible

Low

Moderate

High

Hazard Ranking Point

○ Negligible

● Low

● Moderate

● High

0 500 1,000 1,500 2,000 2,500

Metres

N

SCALE: See Scale Bar	VERSION: A02
SIZE: A3	DRAWN: BW
PROJECT: 0720281	CHECKED: CM
DATE: 07/08/2025	APPROVED: KG

Figure 7 - 12
Spittal - Loch Buidhe - Beaulay 400 kV OHL
Connection
Peat Landslide Hazard Risk Assessment
Hazard Ranking Plan