




- Tower Location
- Alignment Section B
- - - Limit of Deviation
- Temporary Tower Compound Area
- Equipotential Zone (EPZ) (Pulling Position)
- Temporary Access Track - Cut/Fill
- Temporary Access Track - Floating
- Temporary Access Track - EPZ
- Permanent Access Track - Cut/Fill
- Permanent Access Tracks - Floating
- Alignment Section Break





SCALE: See Scale Bar	VERSION: A02
SIZE: A3	DRAWN: BW
PROJECT: 0720281	CHECKED: TA
DATE: 07/08/2025	APPROVED: KG

Figure 1 - 15
Spittal - Loch Buidhe - Beauly 400 kV OHL
Connection
Peat Management Plan
Site Layout

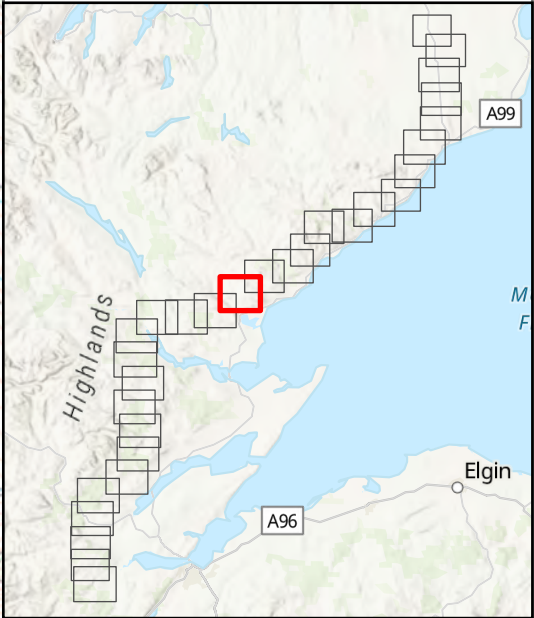

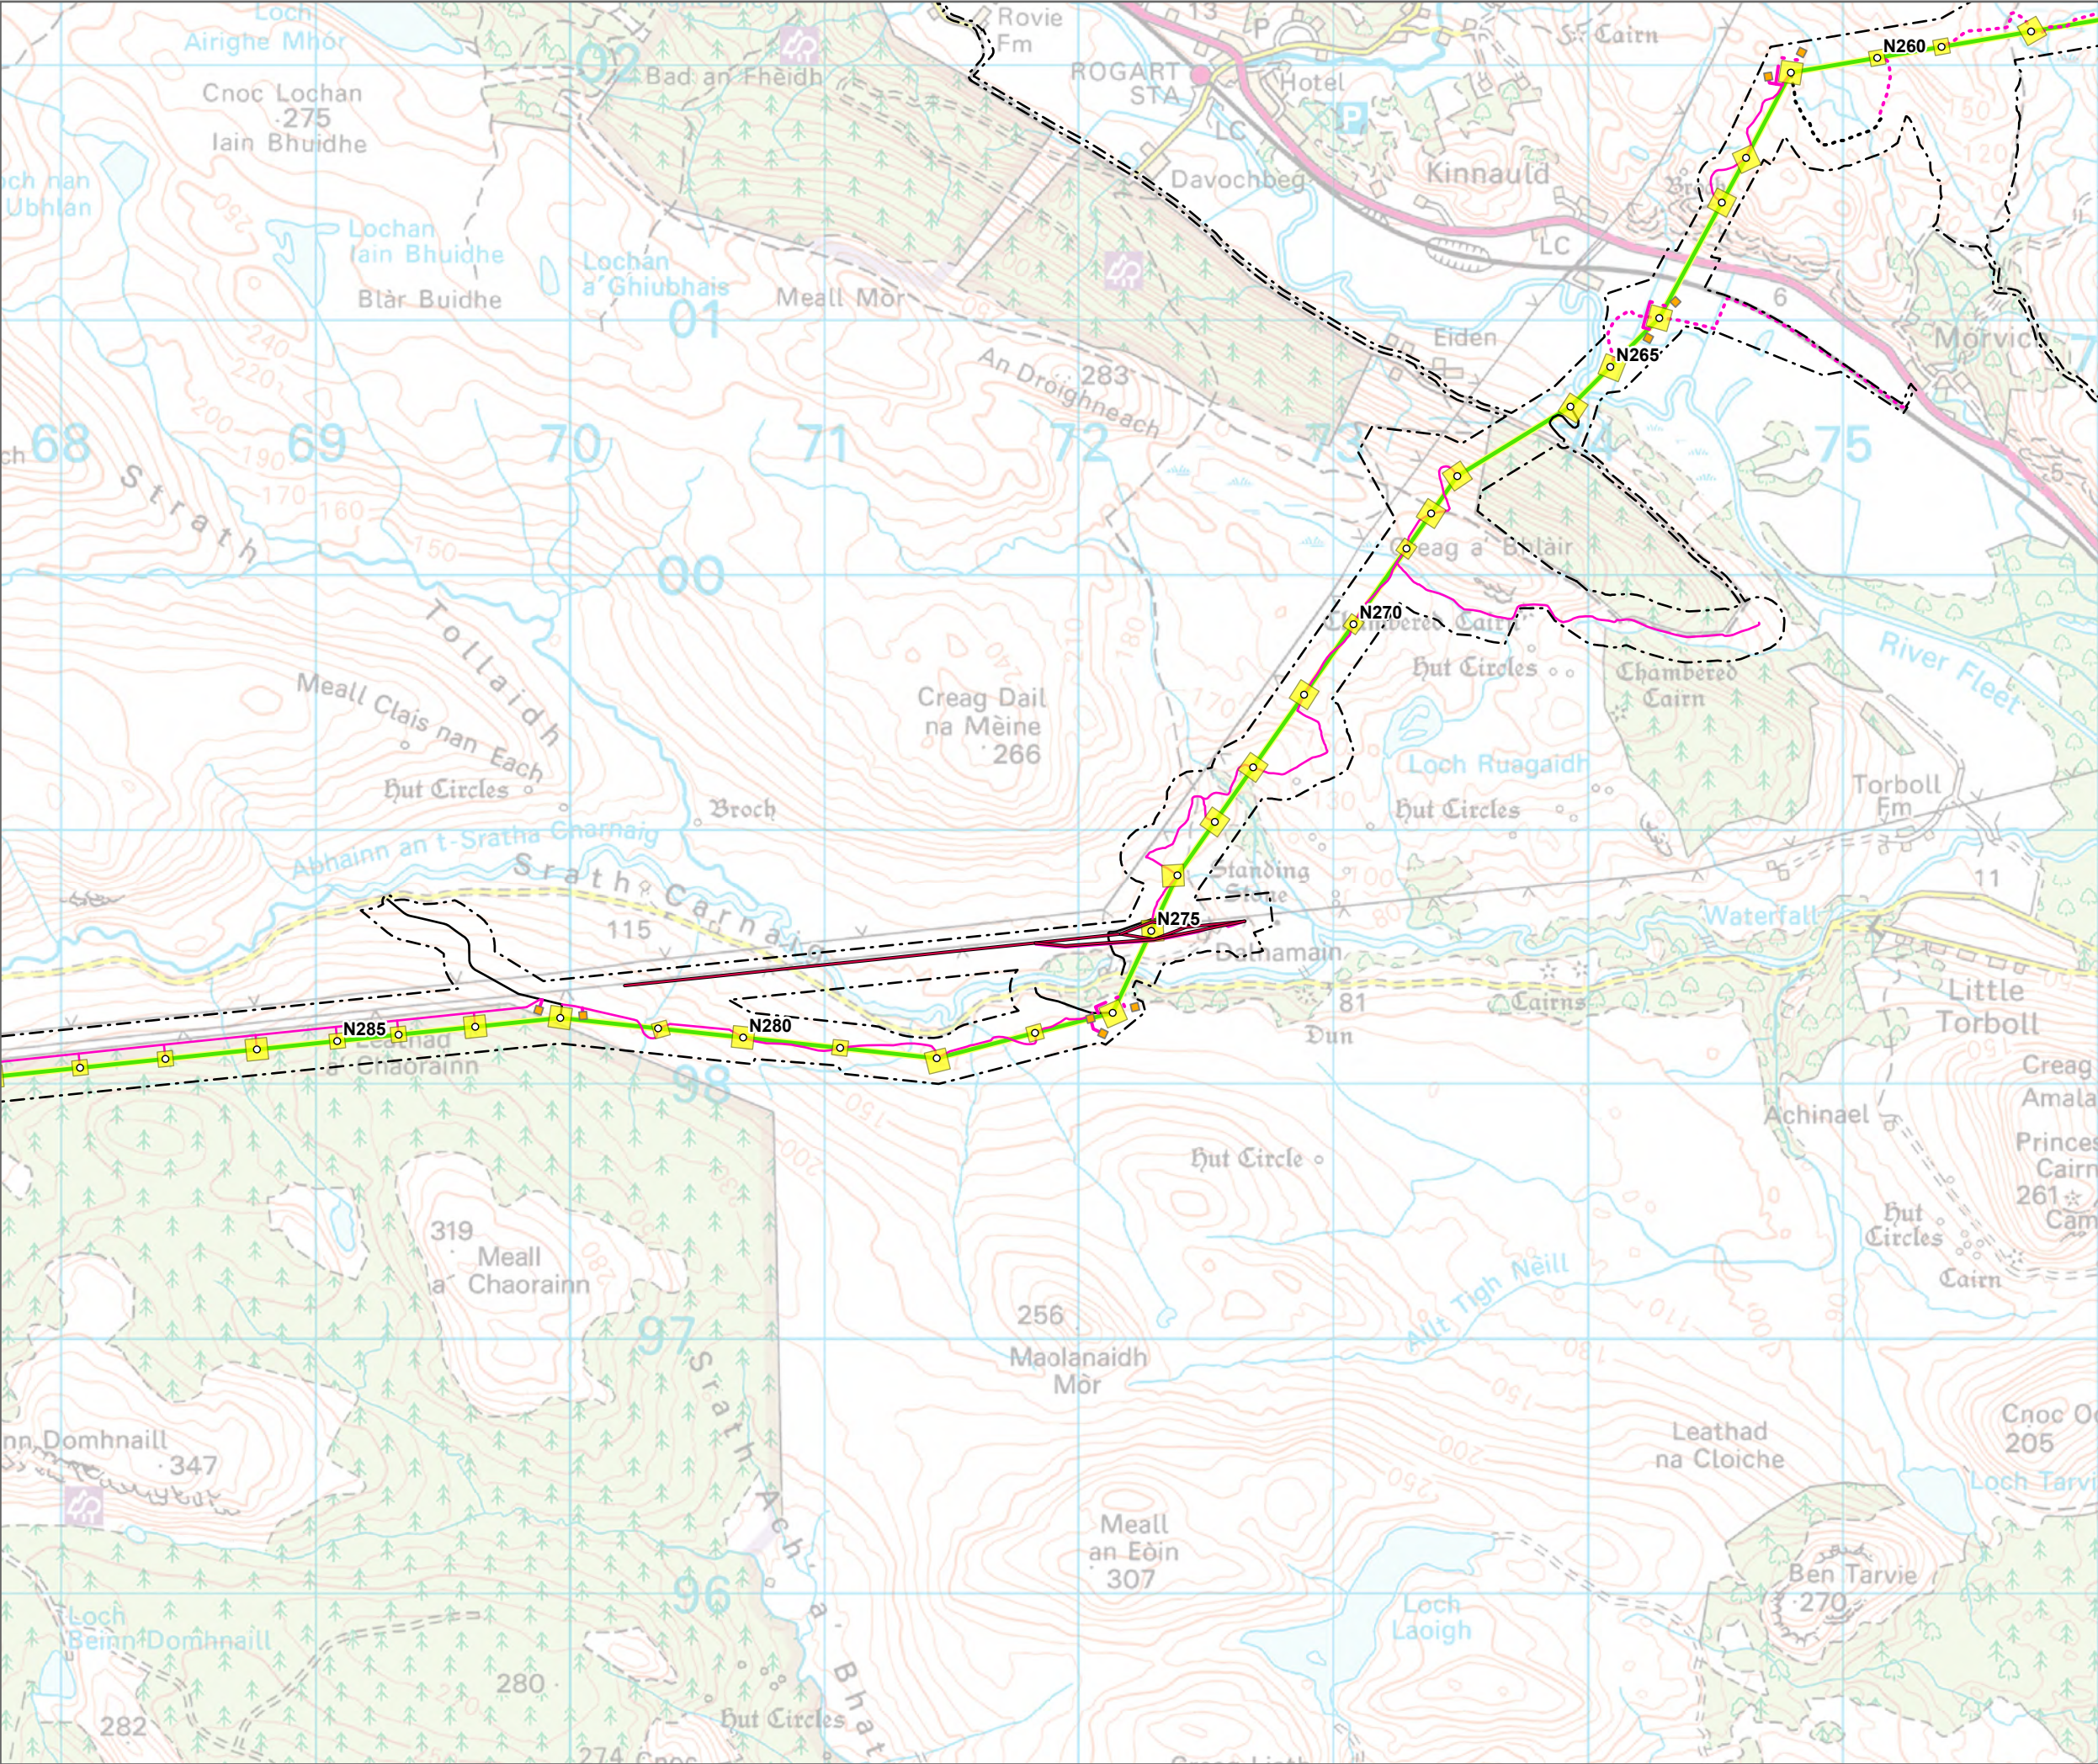

- Tower Location
- Alignment Section B
- Special Arrangement
- - - Limit of Deviation
- Temporary Tower Compound Area
- Equipotential Zone (EPZ) (Pulling Position)
- Temporary Access Track - Cut/Fill
- Temporary Access Track - Floating
- Temporary Access Track - EPZ
- Permanent Access Track - Cut/Fill
- Permanent Access Tracks - Floating
- ~ Alignment Section Break

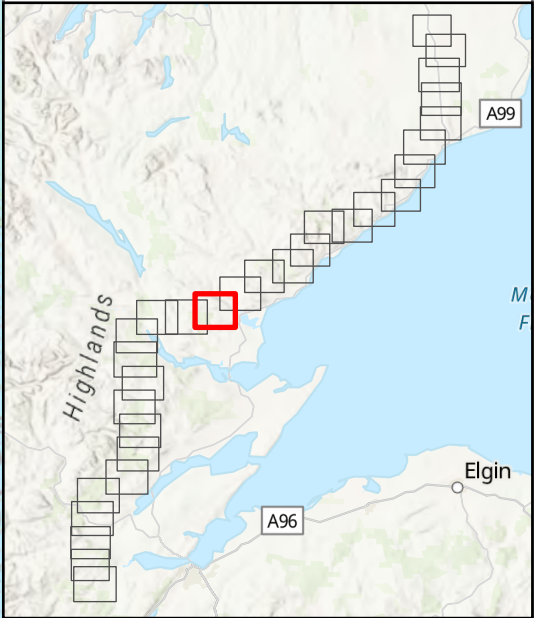


SCALE: See Scale Bar
SIZE: A3
PROJECT: 0720281
DATE: 07/08/2025



VERSION: A02
DRAWN: BW
CHECKED: TA
APPROVED: KG

Figure 1 - 16
Spittal - Loch Buidhe - Beaulieu 400 kV OHL
Connection
Peat Management Plan
Site Layout



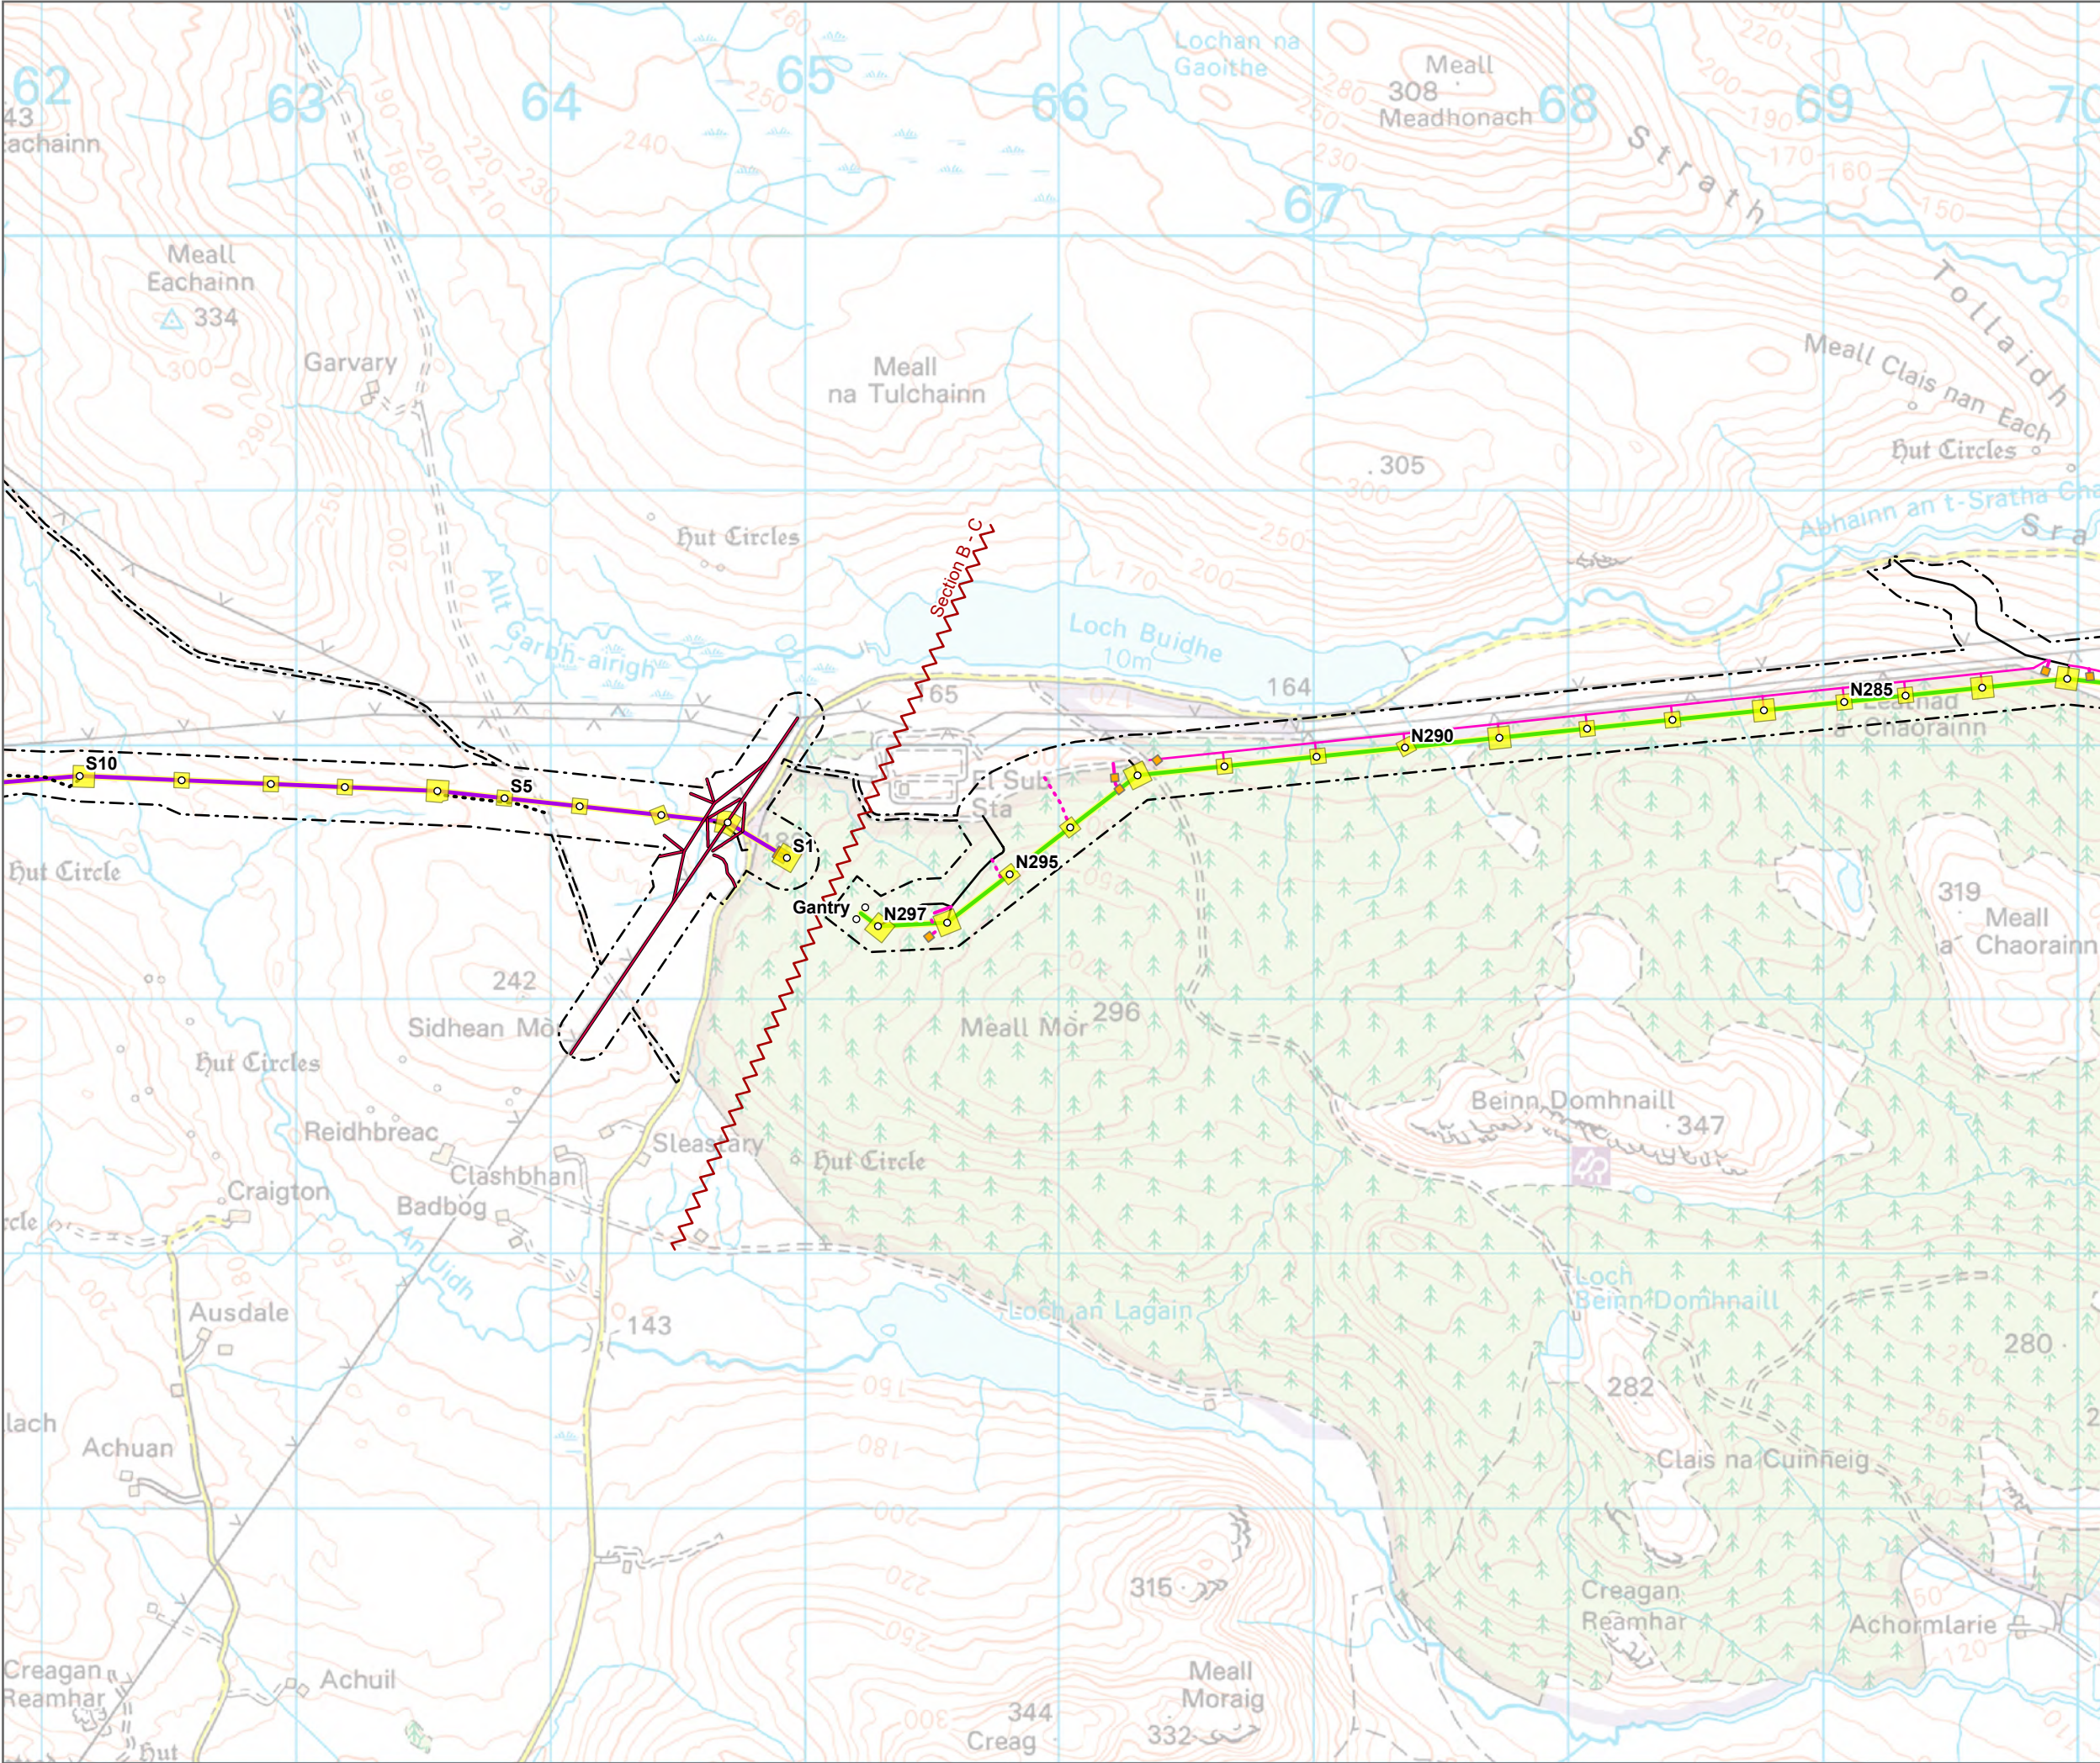

- Tower Location
- Alignment Section B
- Alignment Section C
- Special Arrangement
- - - Limit of Deviation
- Temporary Tower Compound Area
- Equipotential Zone (EPZ) (Pulling Position)
- Temporary Access Track - Cut/Fill
- Temporary Access Track - Floating
- Temporary Access Track - EPZ
- Permanent Access Track - Cut/Fill
- Permanent Access Track - Floating
- Alignment Section Break

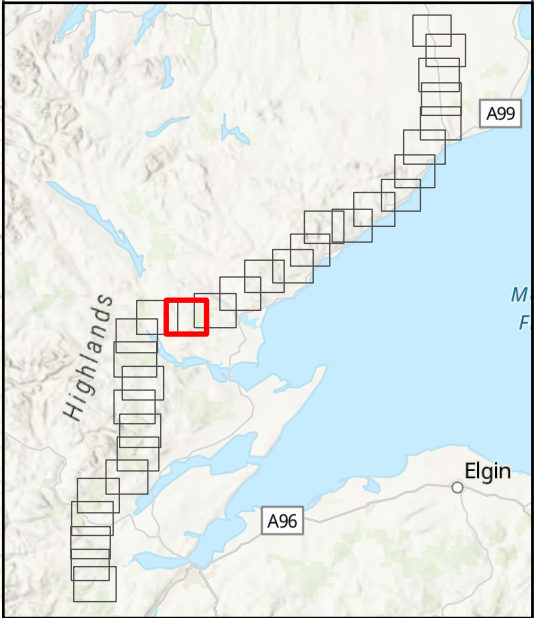


SCALE: See Scale Bar
SIZE: A3
PROJECT: 0720281
DATE: 07/08/2025



VERSION: A02
DRAWN: BW
CHECKED: TA
APPROVED: KG

Figure 1 - 17
Spittal - Loch Buidhe - Beaulieu 400 kV OHL
Connection
Peat Management Plan
Site Layout



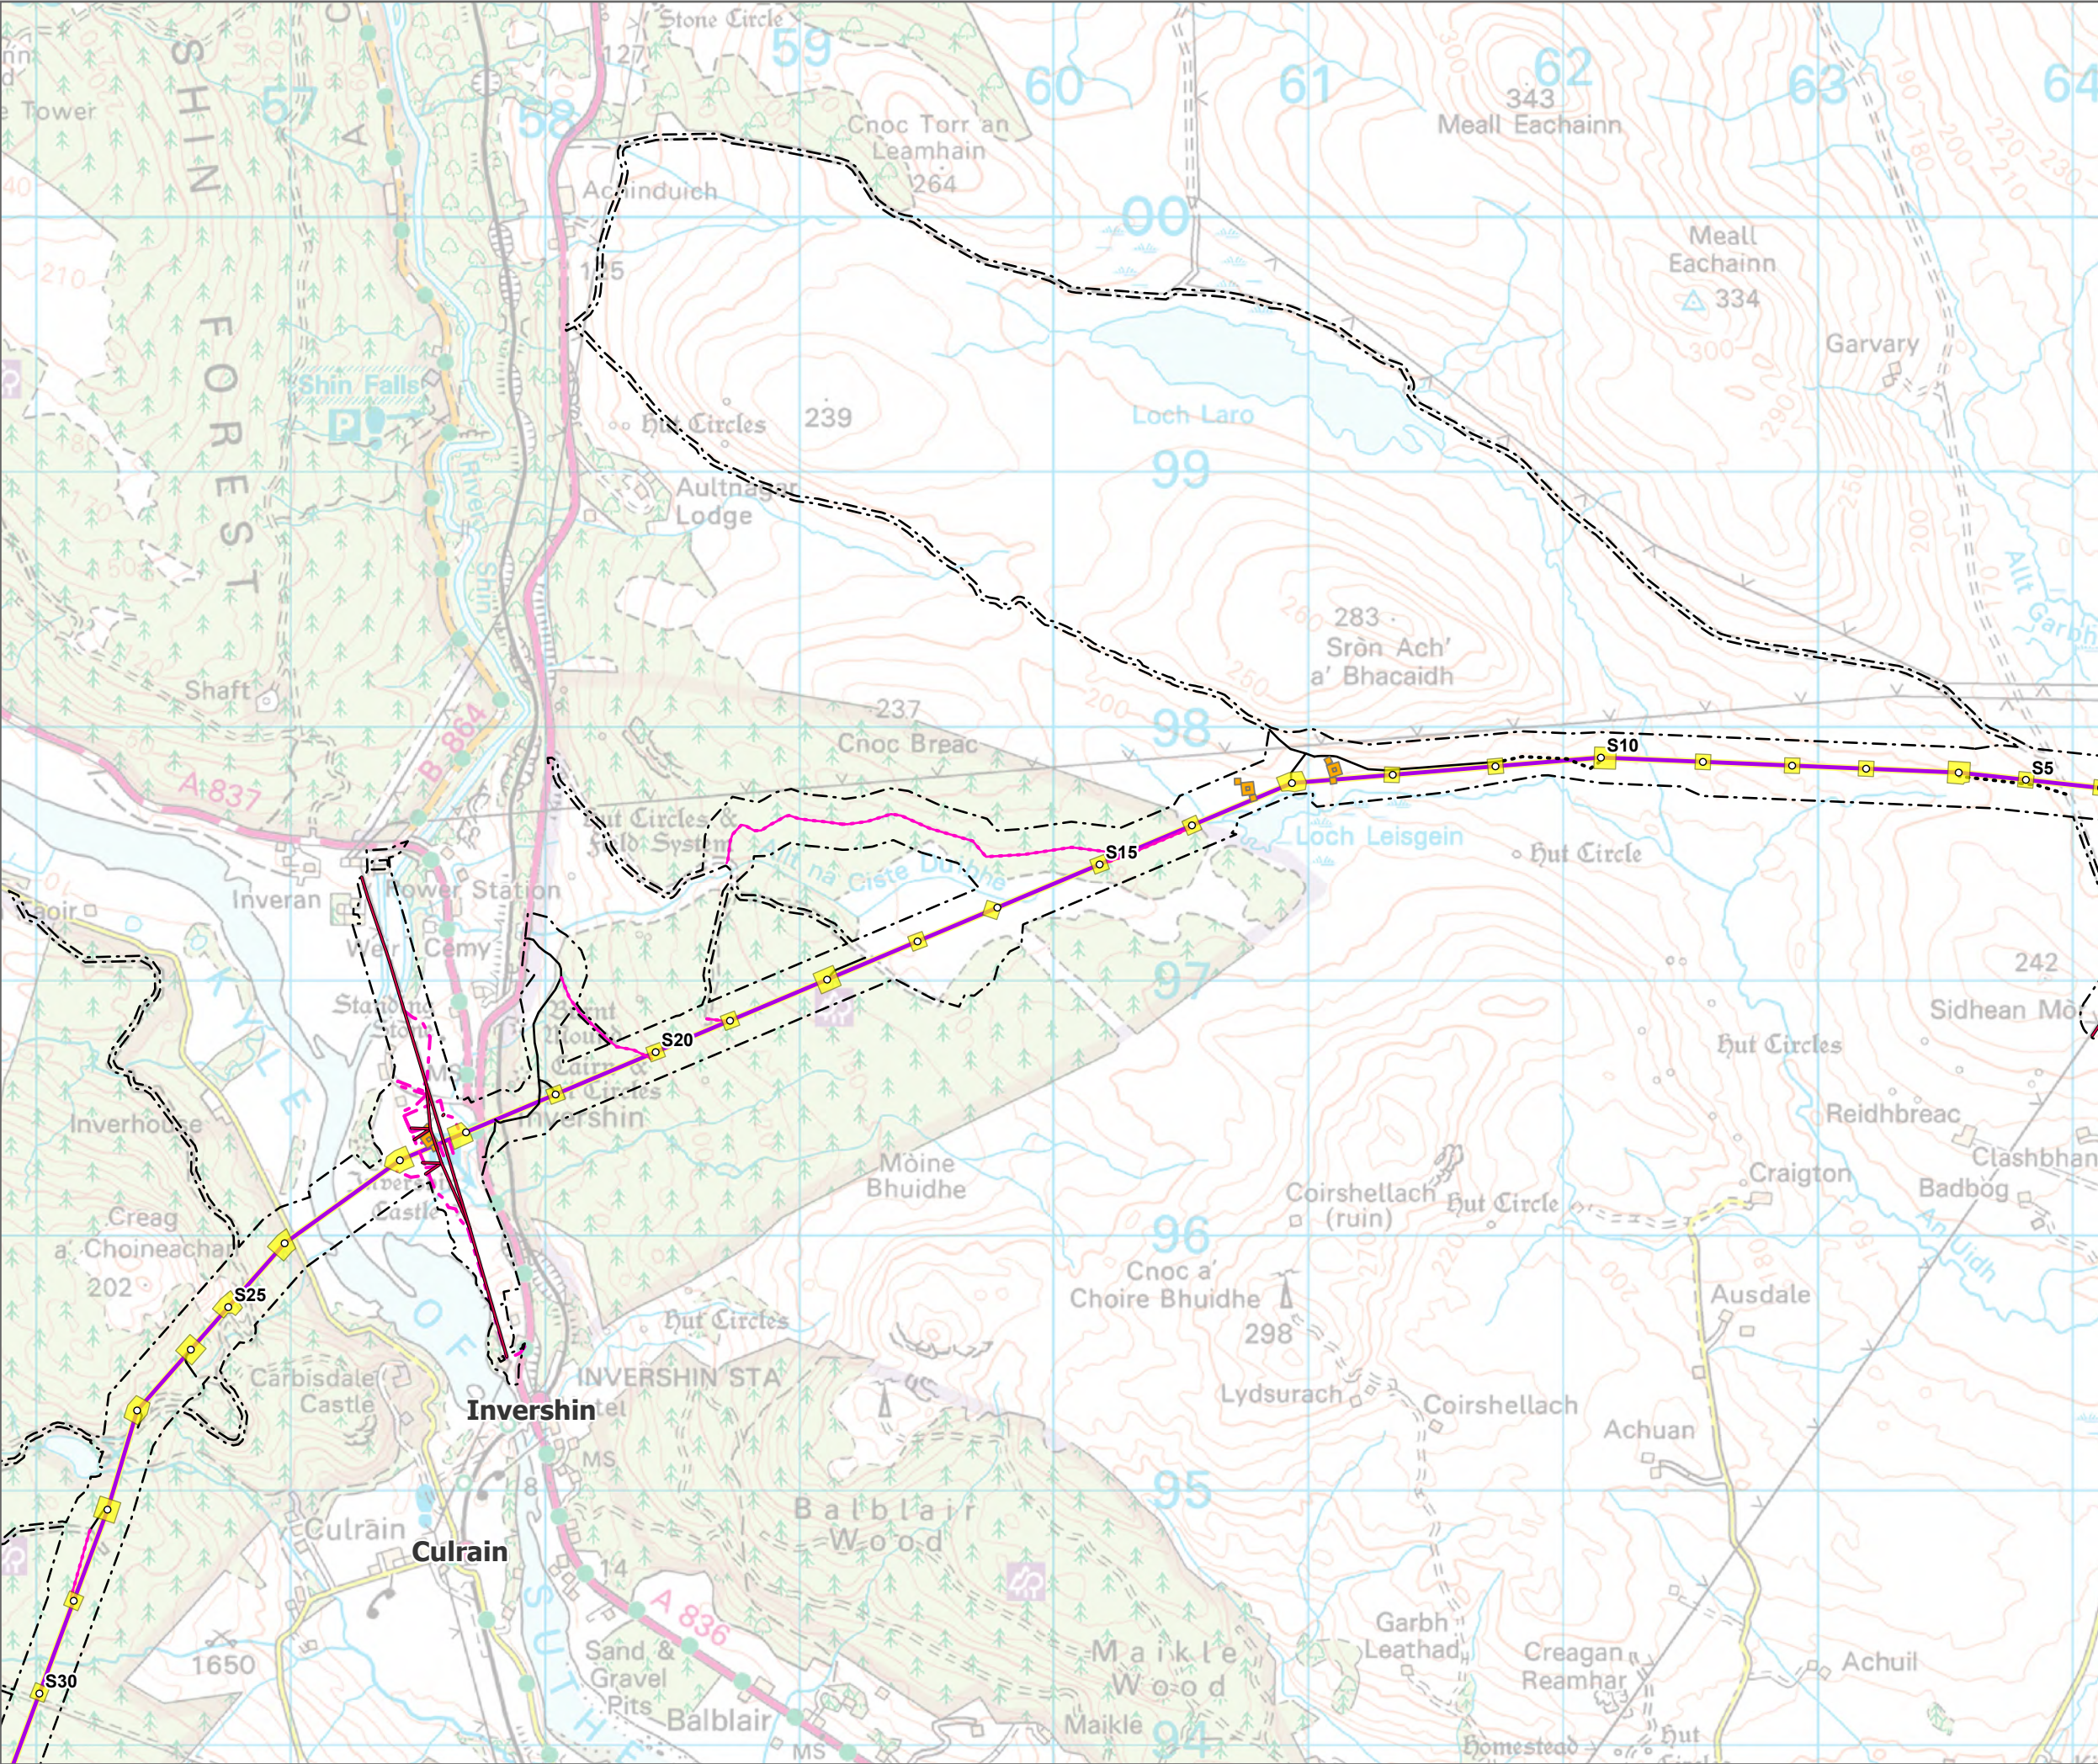


- Tower Location
- Alignment Section C
- Special Arrangement
- - - Limit of Deviation
- Temporary Tower Compound Area
- Equipotential Zone (EPZ) (Pulling Position)
- Temporary Access Track - Cut/Fill
- Temporary Access Track - Floating
- Temporary Access Track - Trackway Panel
- Permanent Access Track - Cut/Fill
- Permanent Access Track - Floating
- Alignment Section Break

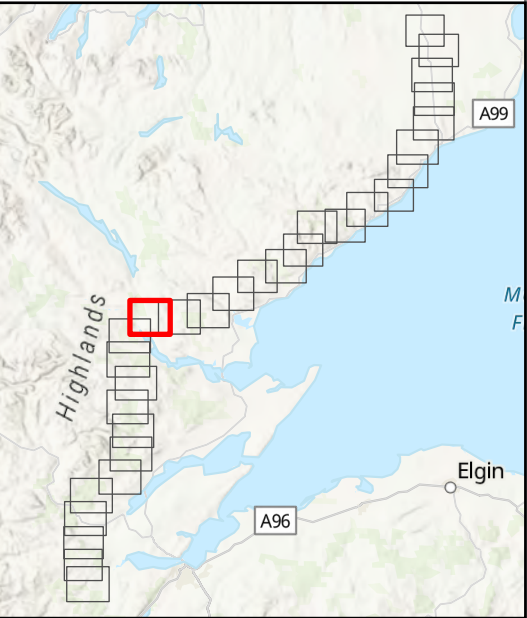



SCALE: See Scale Bar	VERSION: A02
SIZE: A3	DRAWN: BW
PROJECT: 0720281	CHECKED: TA
DATE: 07/08/2025	APPROVED: KG

Figure 1 - 18
Spittal - Loch Buidhe - Beaulieu 400 kV OHL
Connection
Peat Management Plan
Site Layout



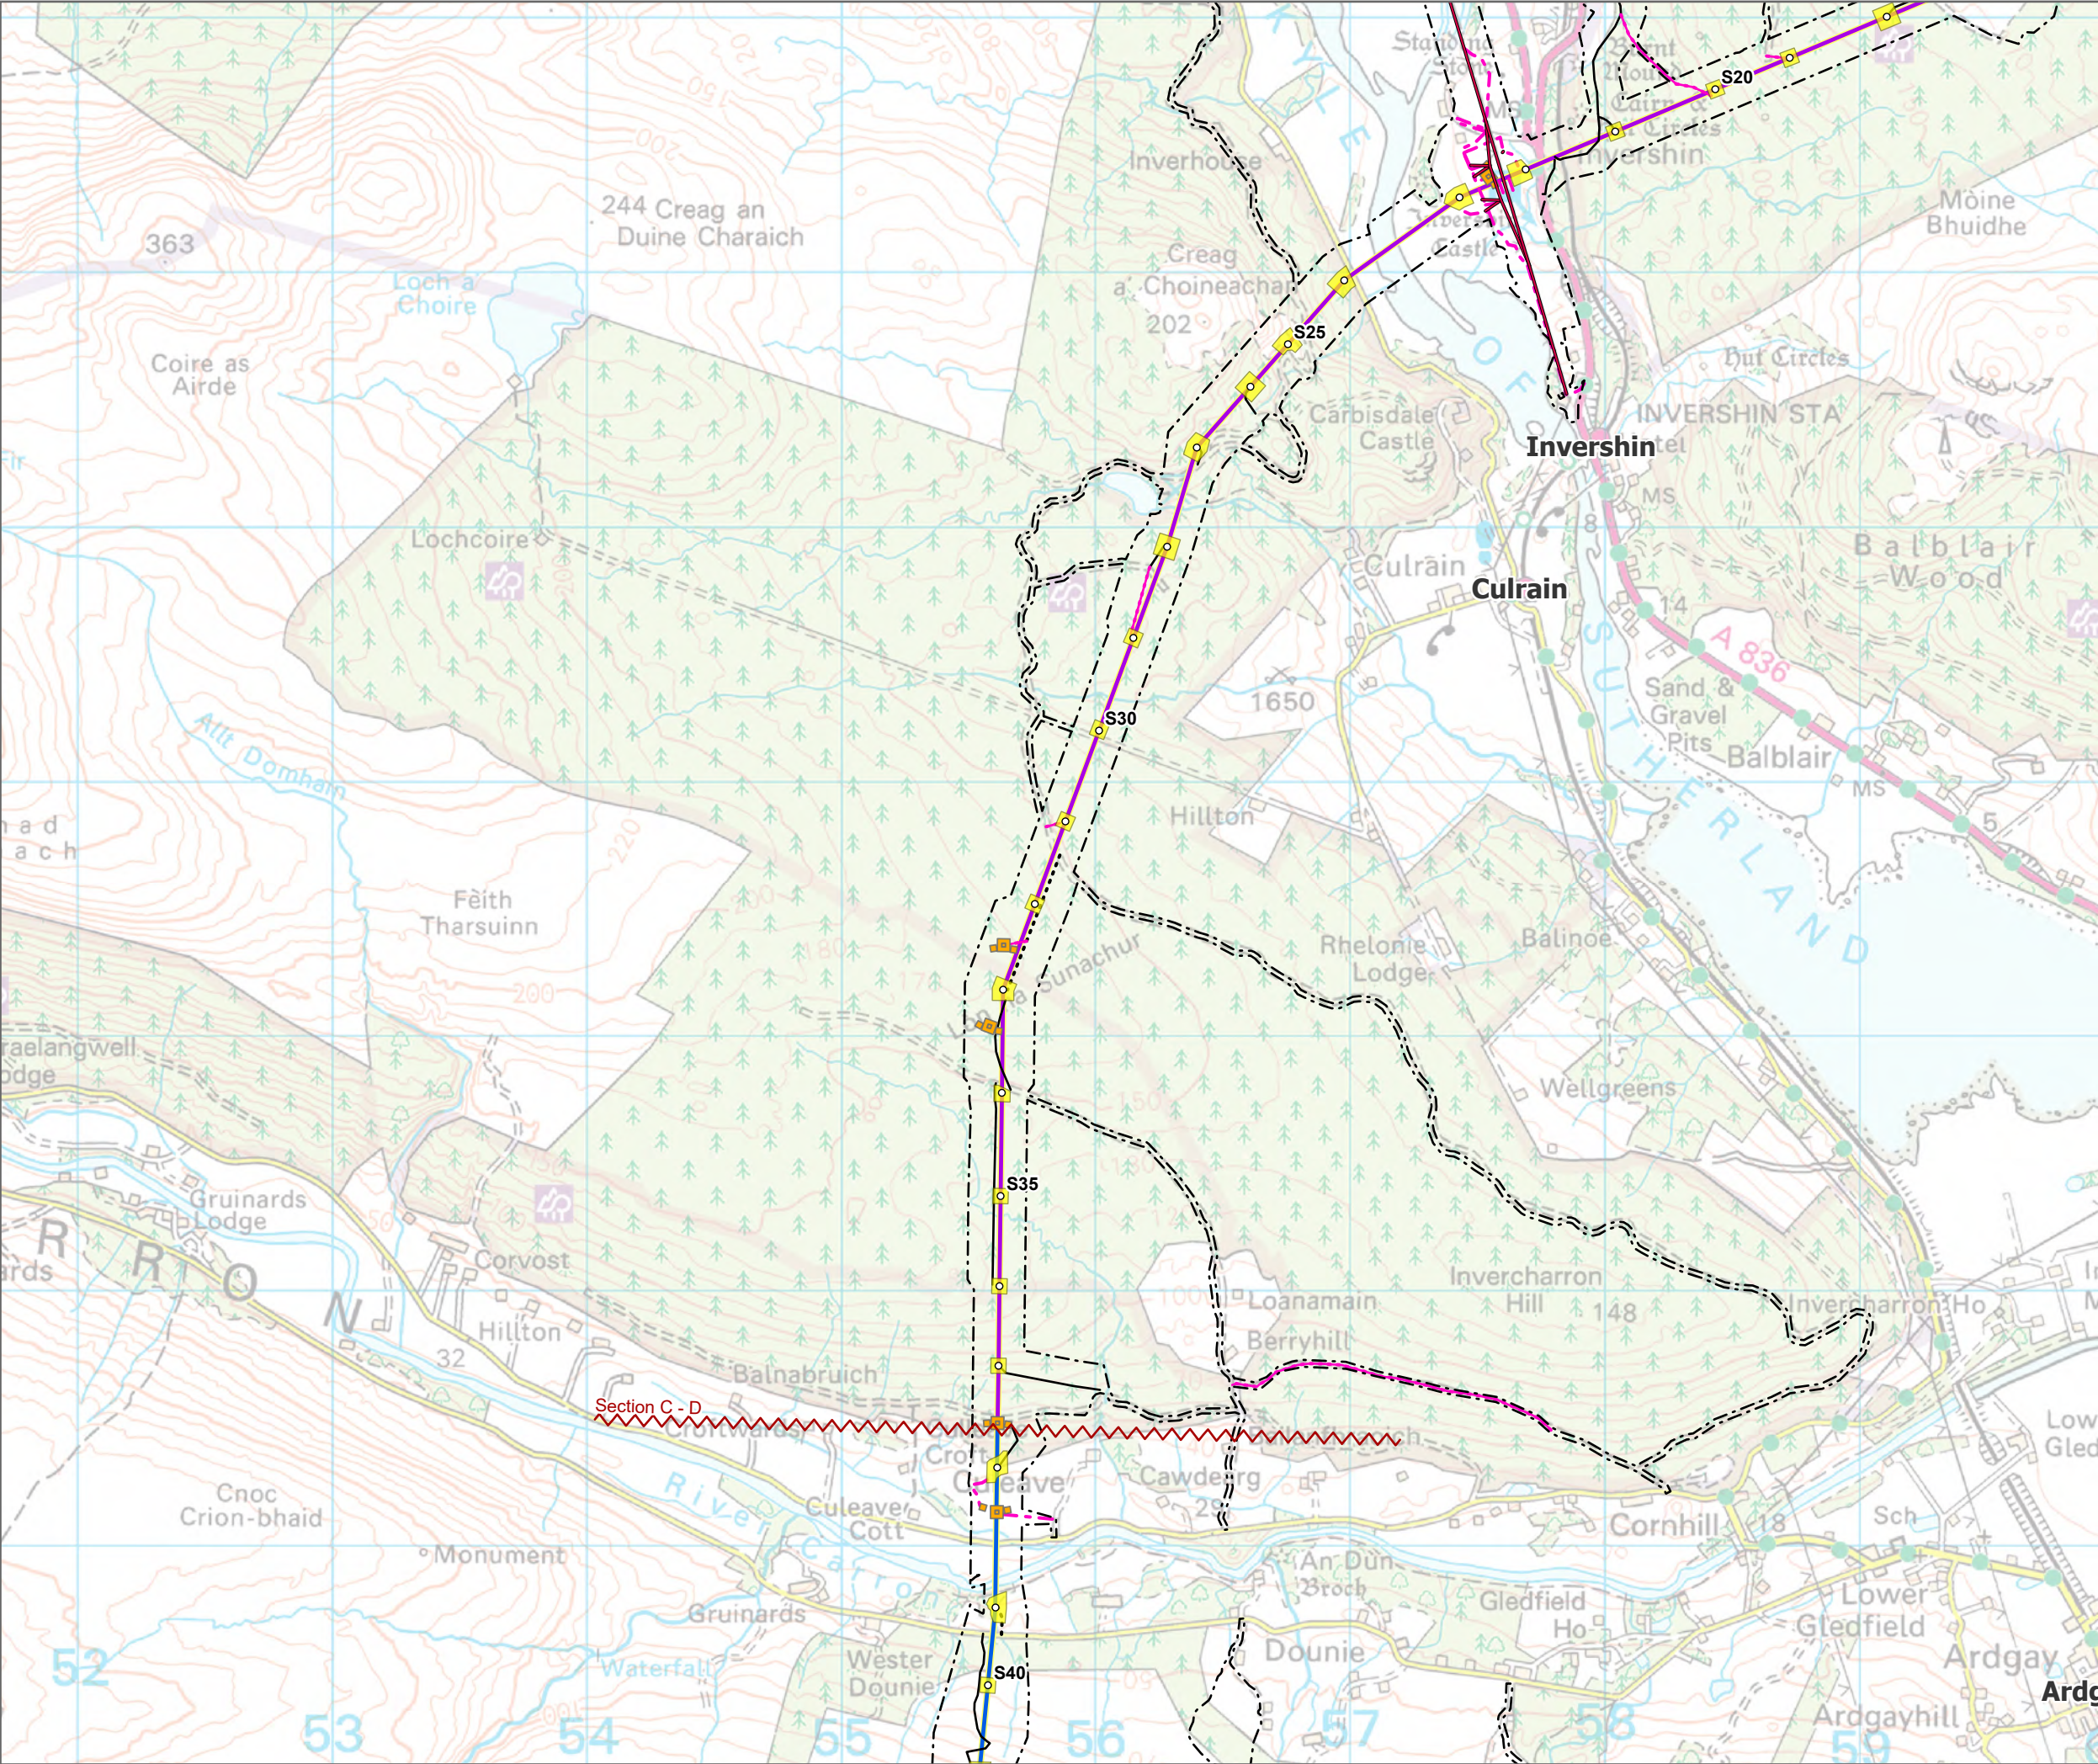

- Tower Location
- Alignment Section C
- Alignment Section D
- Special Arrangement
- - - Limit of Deviation
- Temporary Tower Compound Area
- Equipotential Zone (EPZ) (Pulling Position)
- Temporary Access Track - Cut/Fill
- Temporary Access Track - Floating
- Temporary Access Track - Trackway Panel
- Permanent Access Track - Cut/Fill
- Permanent Access Track - Floating
- Alignment Section Break

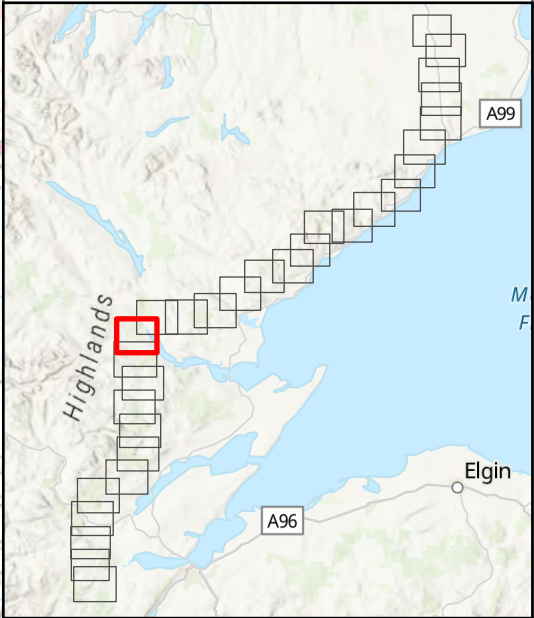


SCALE: See Scale Bar
SIZE: A3
PROJECT: 0720281
DATE: 07/08/2025



VERSION: A02
DRAWN: BW
CHECKED: TA
APPROVED: KG

Figure 1 - 19
Spittal - Loch Buidhe - Beauly 400 kV OHL
Peat Management Plan
Site Layout



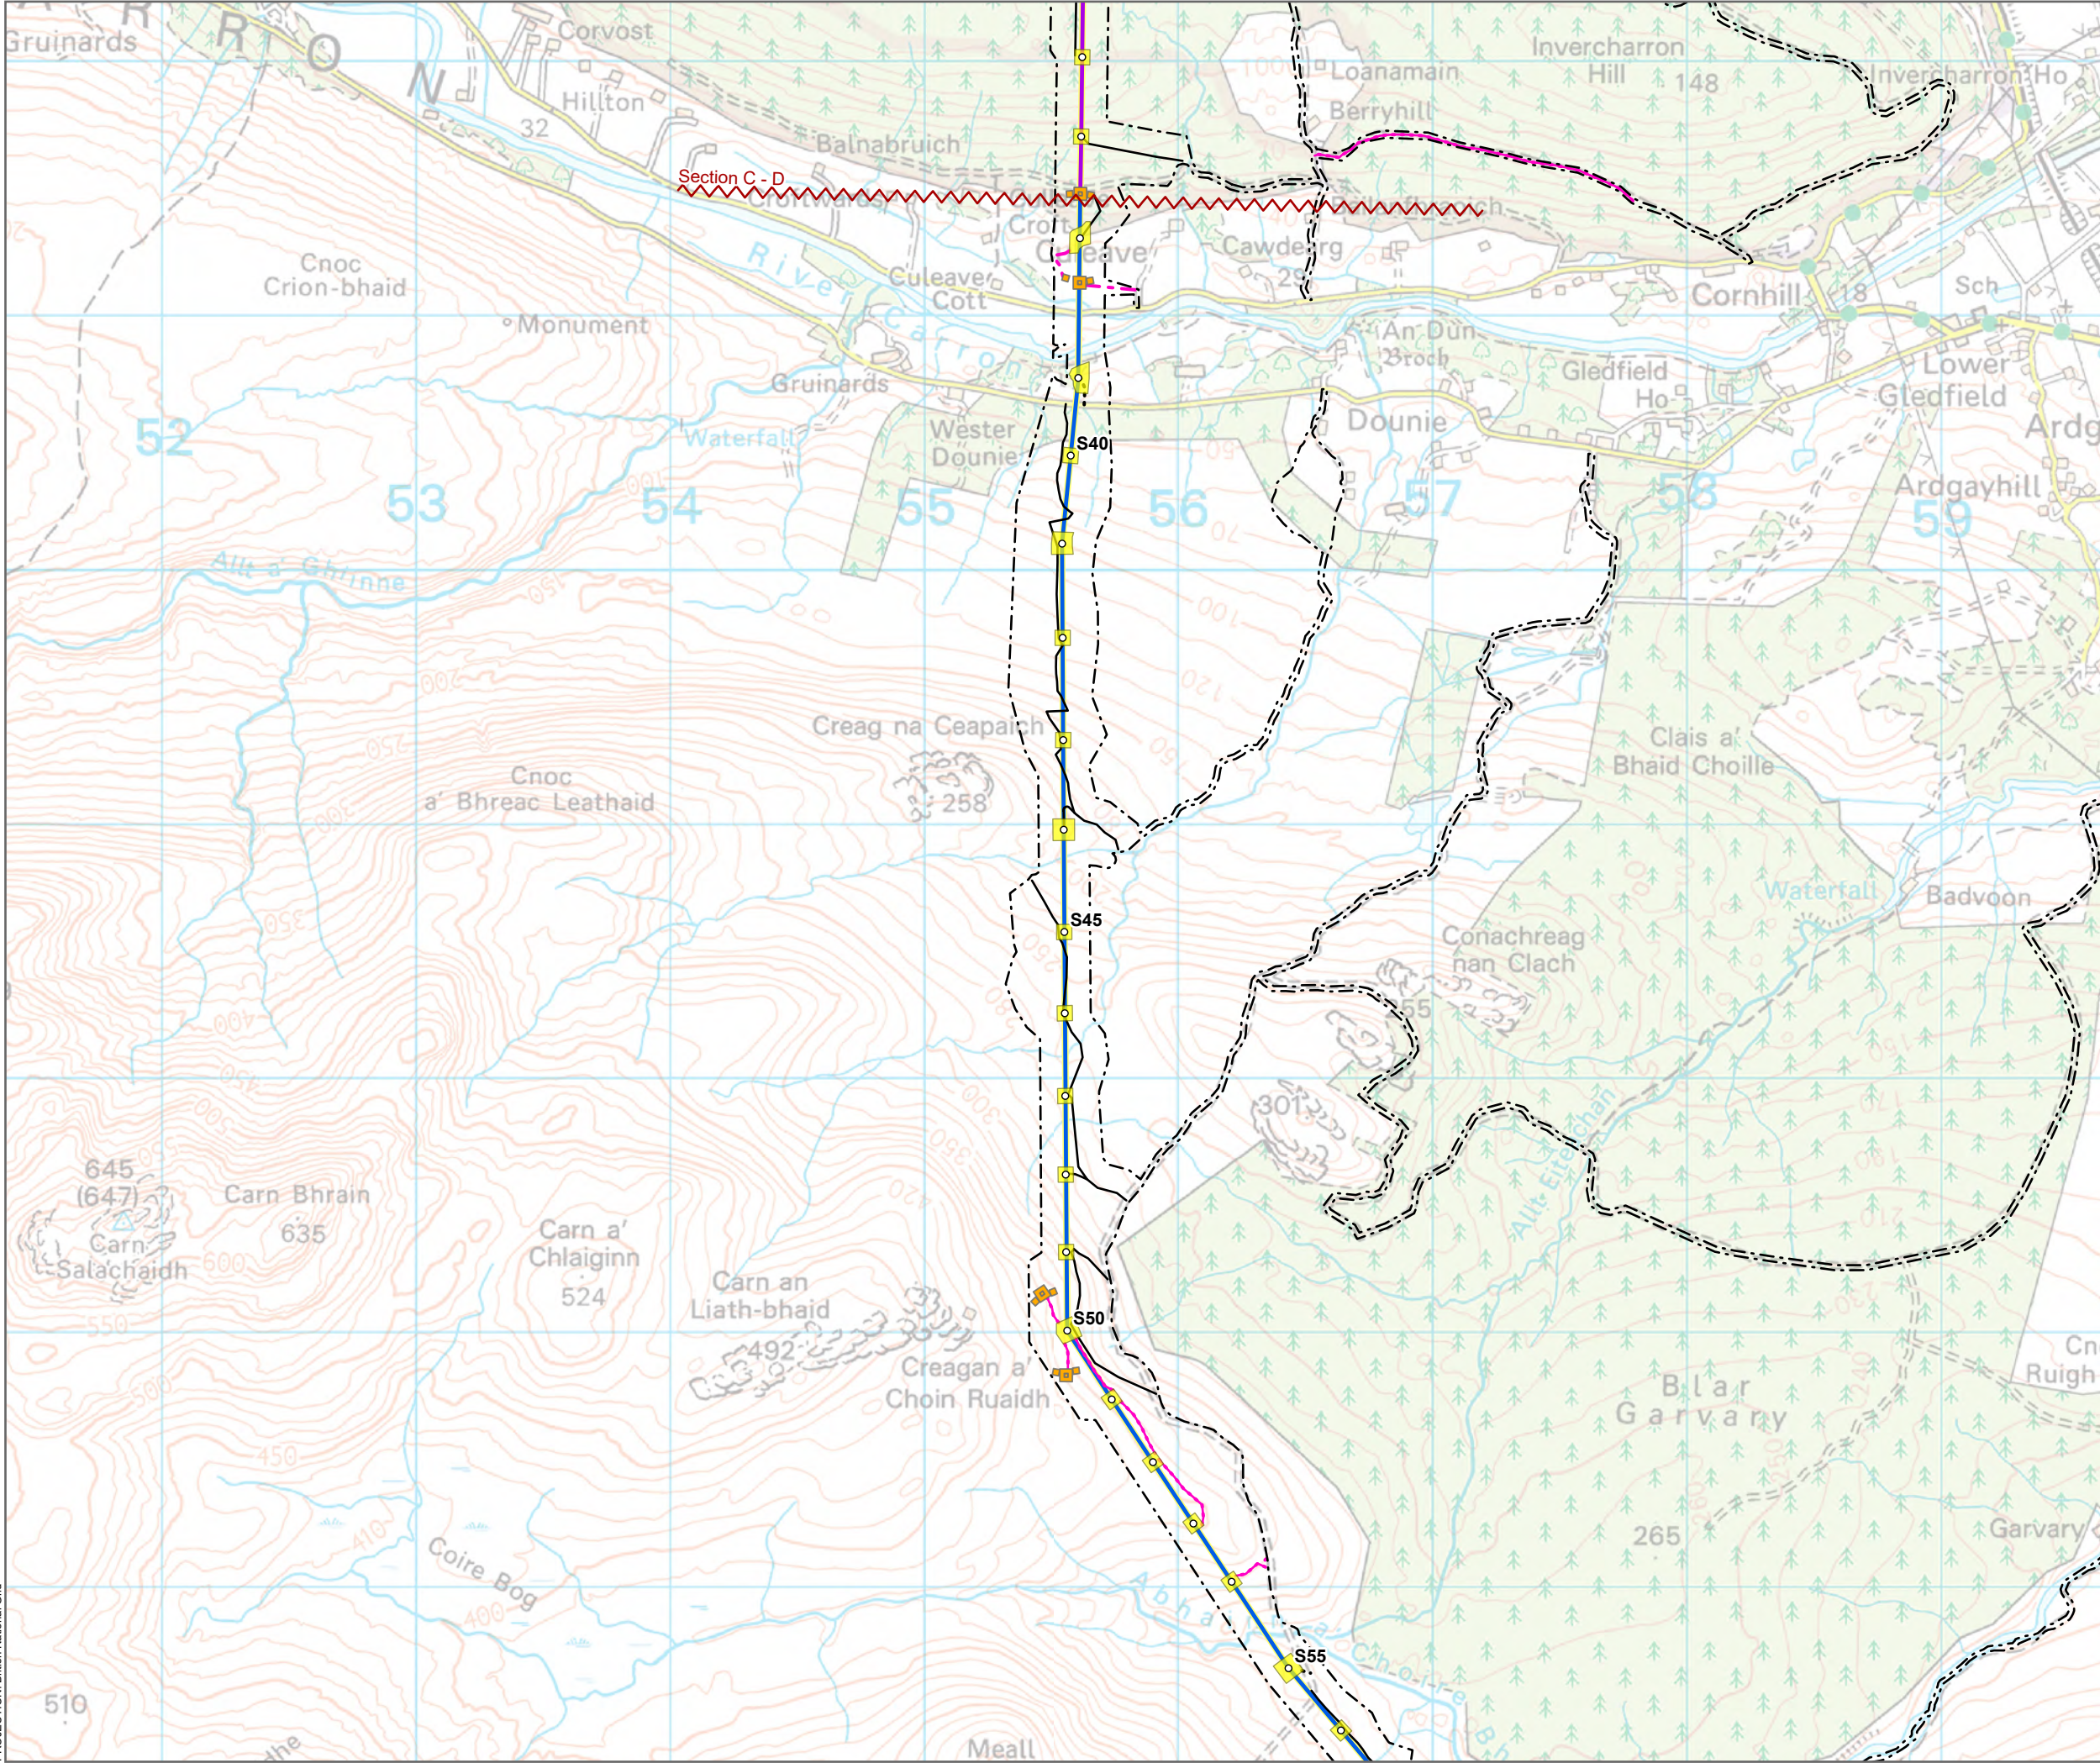


- Tower Location
- Alignment Section C
- Alignment Section D
- - - Limit of Deviation
- Temporary Tower Compound Area
- Equipotential Zone (EPZ) (Pulling Position)
- Temporary Access Track - Cut/Fill
- Temporary Access Track - Floating
- Temporary Access Track - Trackway Panel
- Permanent Access Track - Cut/Fill
- Permanent Access Track - Floating
- Alignment Section Break

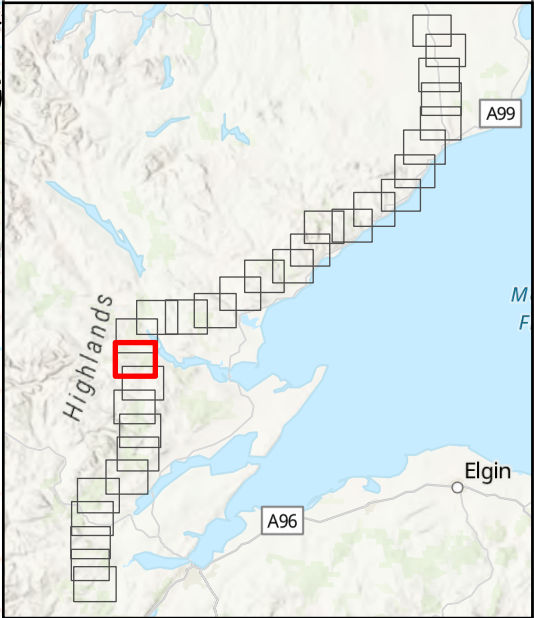



SCALE: See Scale Bar	VERSION: A02
SIZE: A3	DRAWN: BW
PROJECT: 0720281	CHECKED: TA
DATE: 07/08/2025	APPROVED: KG

Figure 1 - 20
Spittal - Loch Buidhe - Beauly 400 kV OHL
Connection
Peat Management Plan
Site Layout



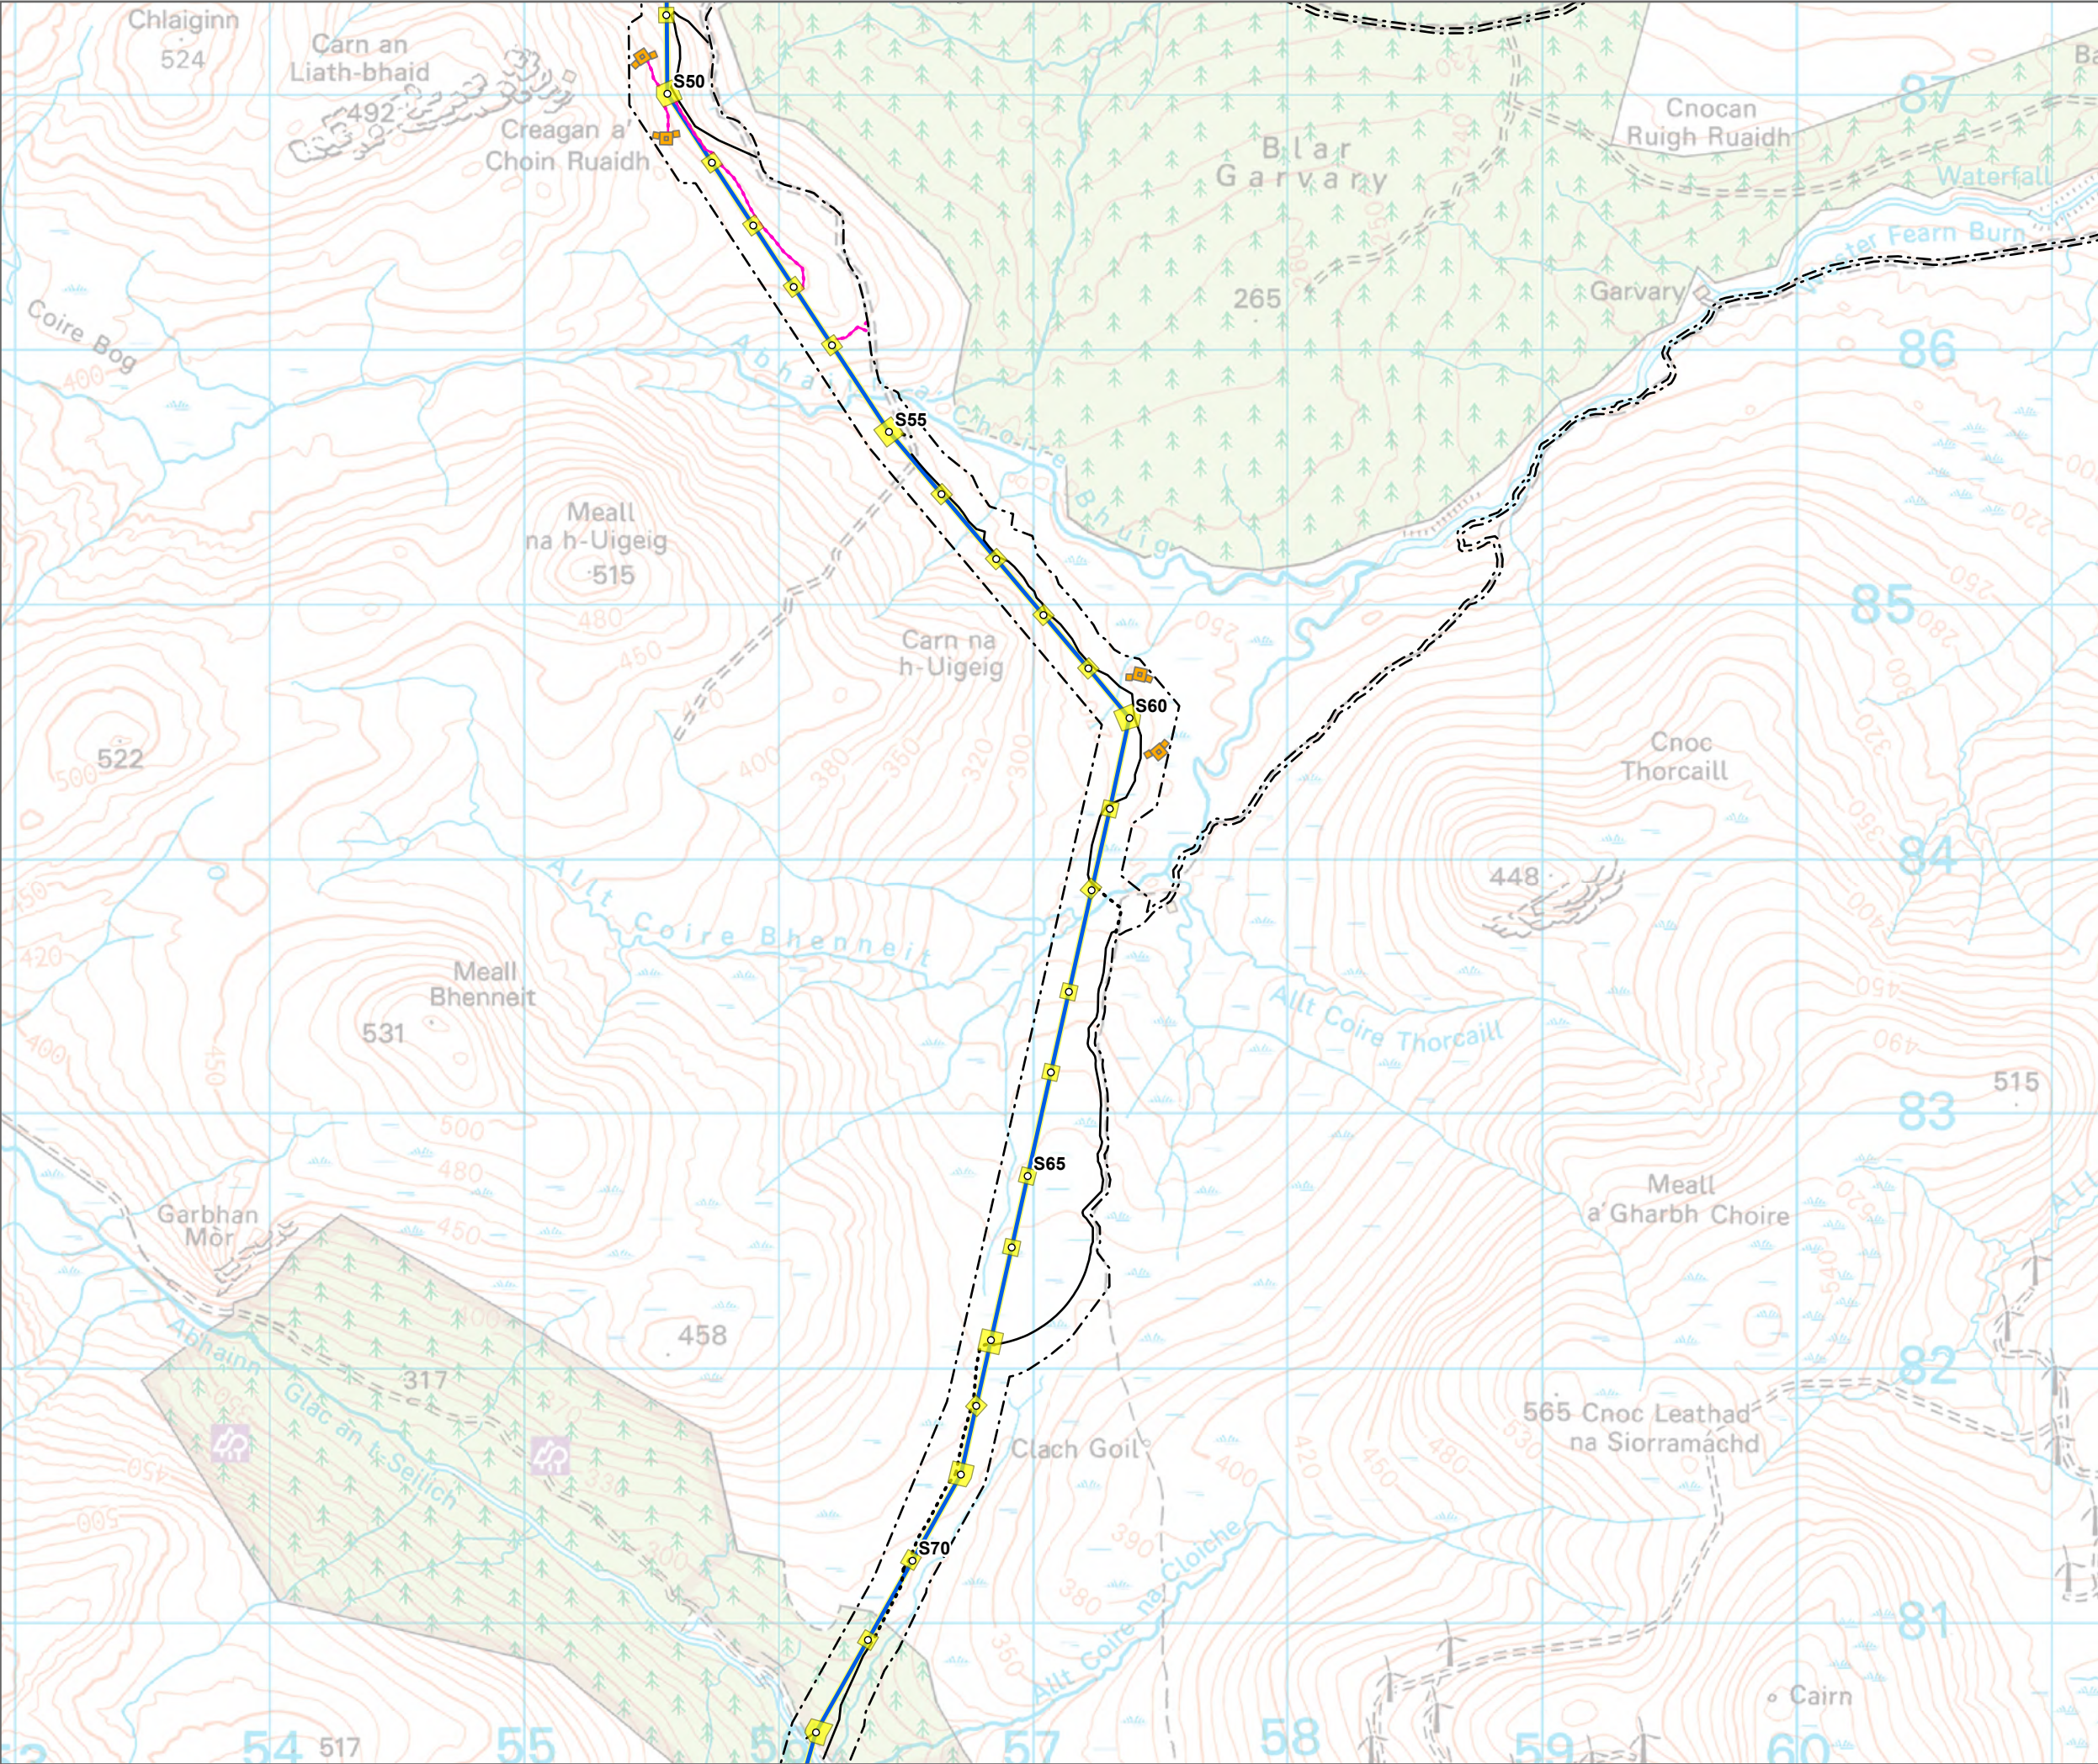


- Tower Location
- Alignment Section D
- - - Limit of Deviation
- Temporary Tower Compound Area
- Equipotential Zone (EPZ) (Pulling Position)
- Temporary Access Track - Cut/Fill
- Temporary Access Track - Floating
- Permanent Access Track - Cut/Fill
- Permanent Access Track - Floating
- ~ Alignment Section Break

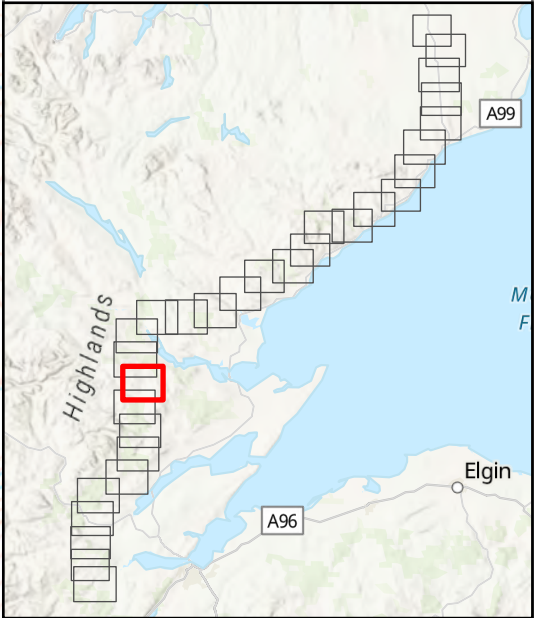



SCALE: See Scale Bar	VERSION: A02
SIZE: A3	DRAWN: BW
PROJECT: 0720281	CHECKED: TA
DATE: 07/08/2025	APPROVED: KG

Figure 1 - 21
Spittal - Loch Buidhe - Beaulieu 400 kV OHL
Connection
Peat Management Plan
Site Layout



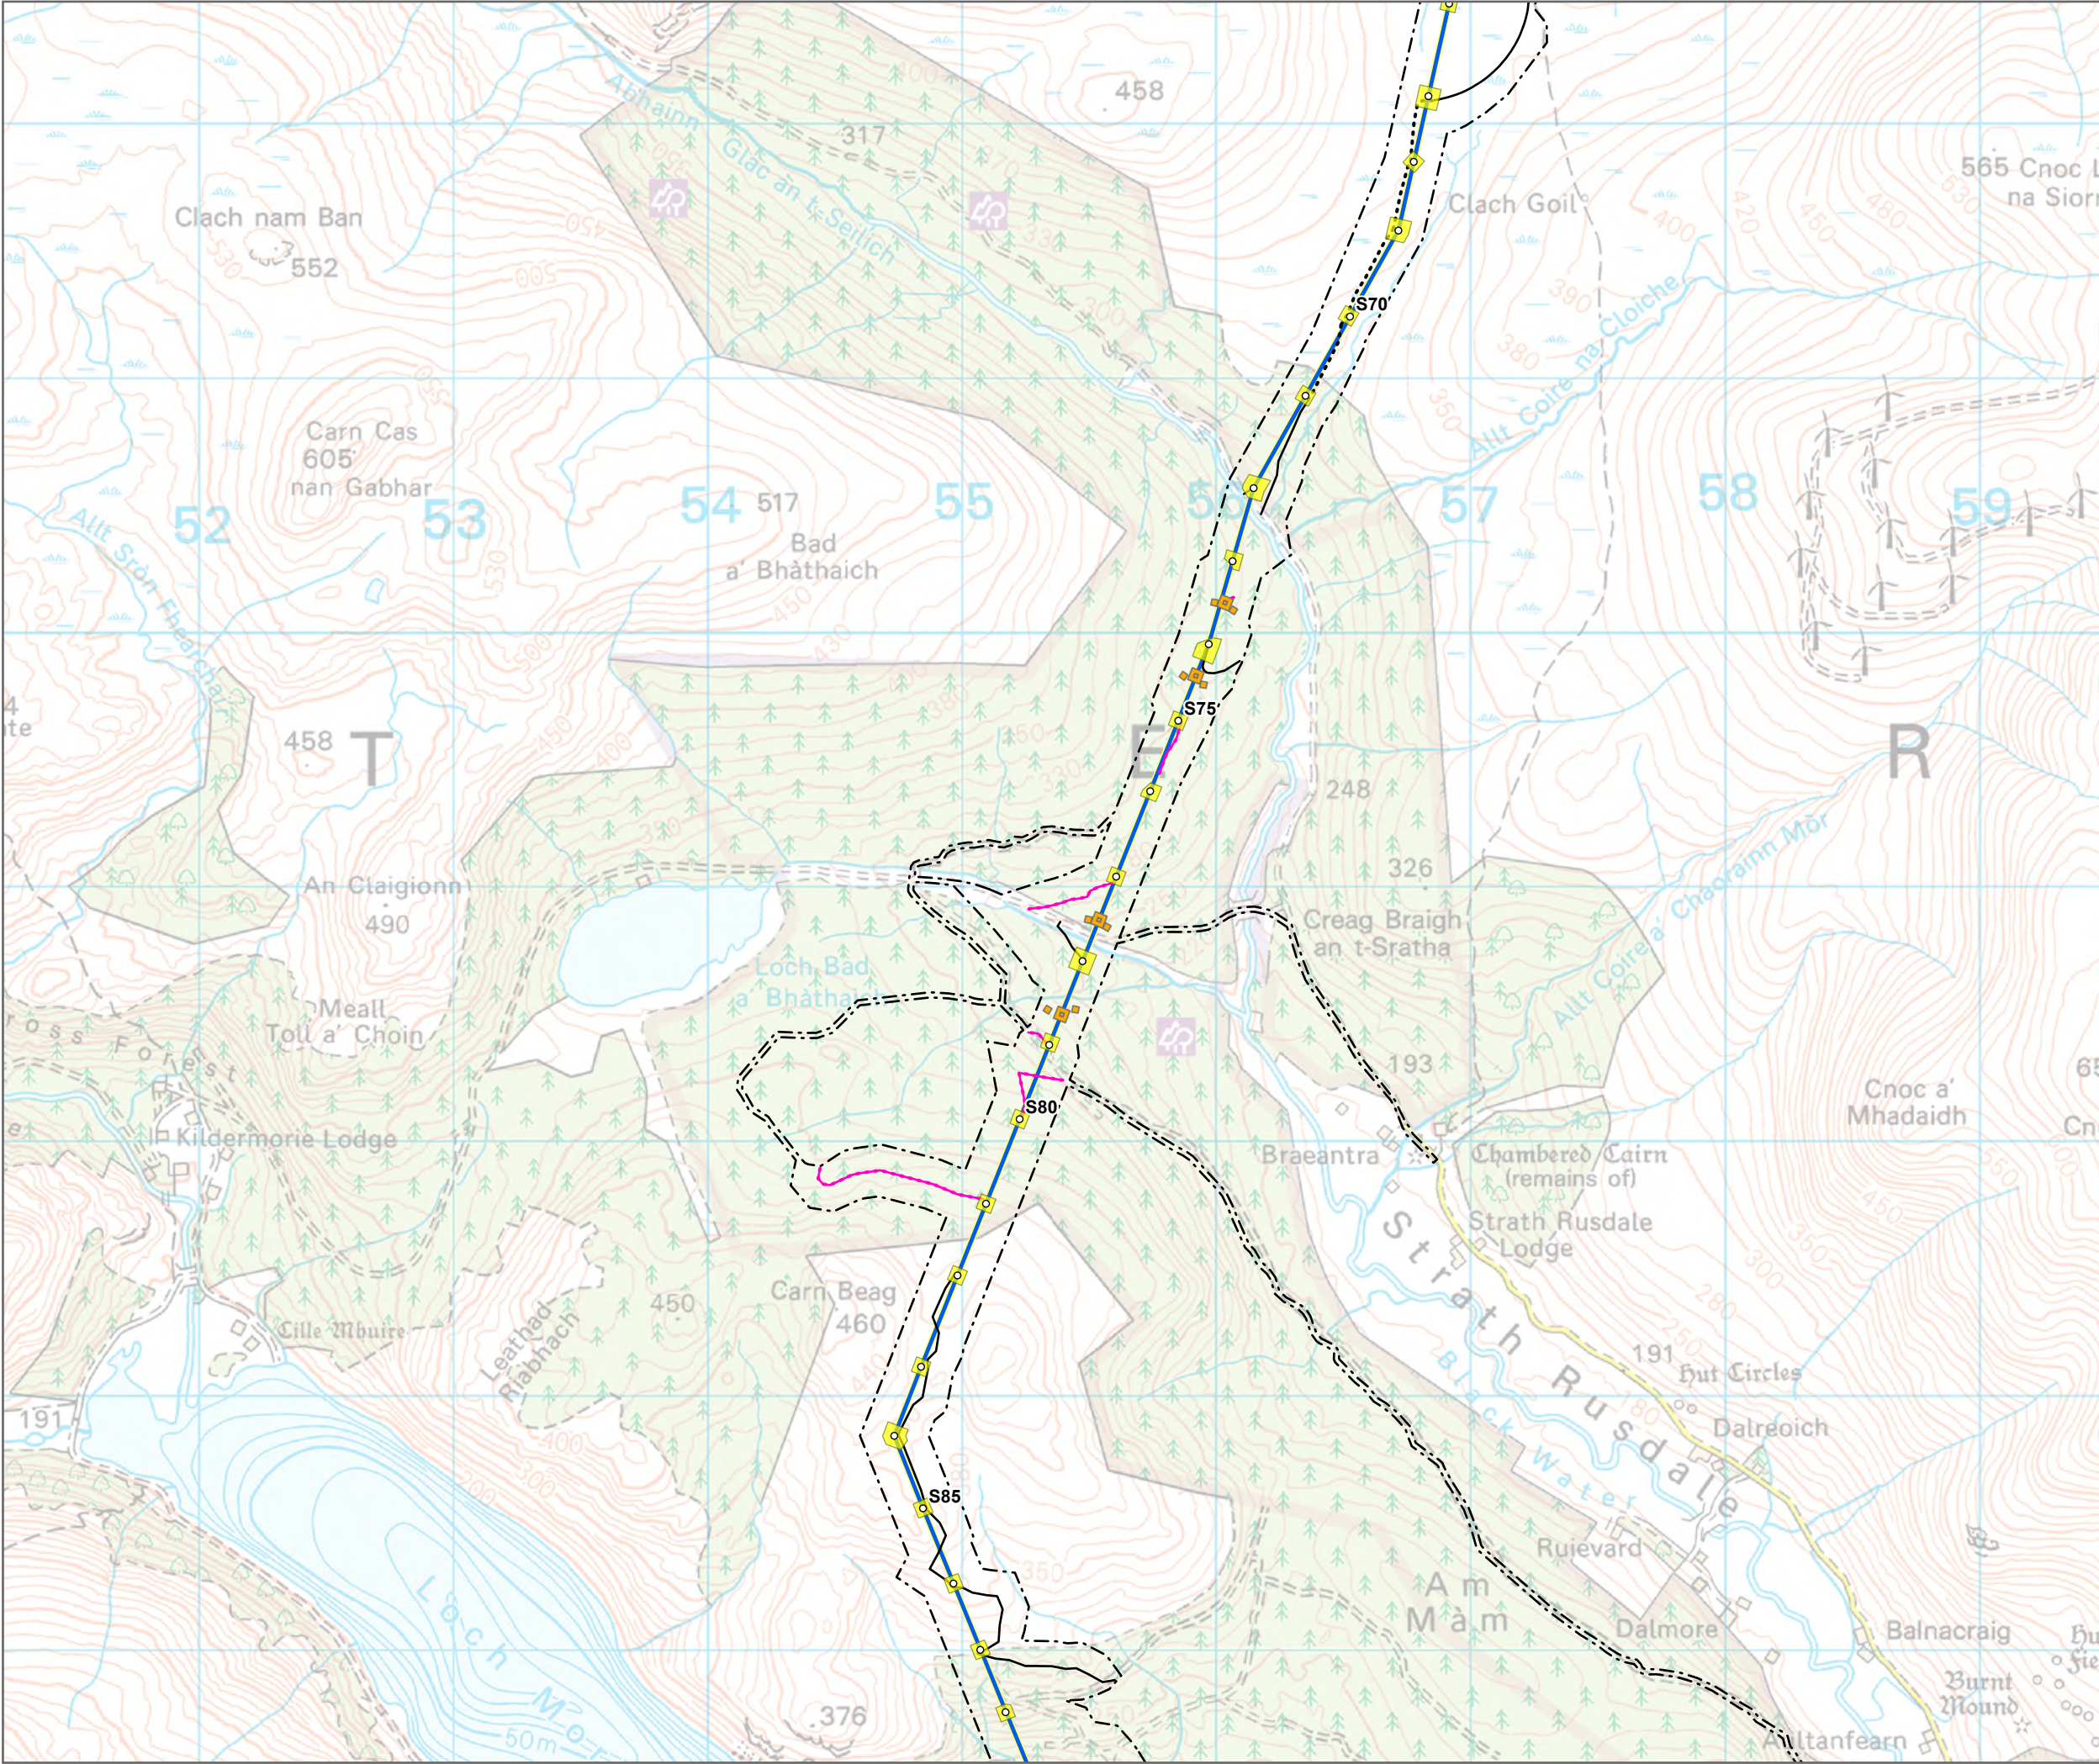


- Tower Location
- Alignment Section D
- - - Limit of Deviation
- Temporary Tower Compound Area
- Equipotential Zone (EPZ) (Pulling Position)
- Temporary Access Track - Cut/Fill
- Temporary Access Track - Floating
- Permanent Access Track - Cut/Fill
- Permanent Access Track - Floating
- Alignment Section Break

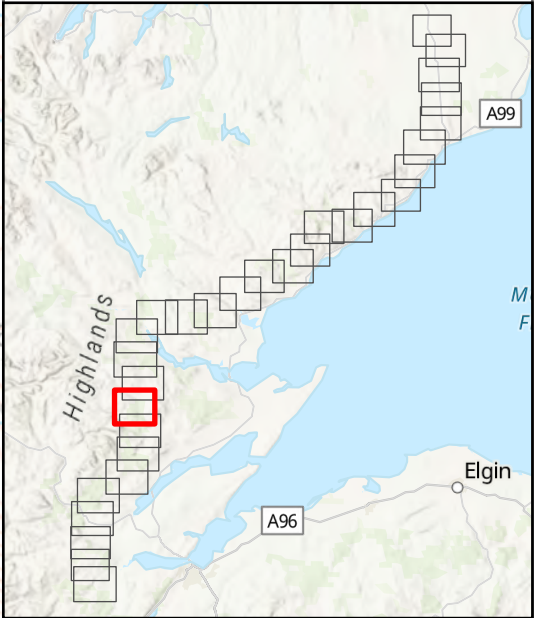



SCALE: See Scale Bar	VERSION: A02
SIZE: A3	DRAWN: BW
PROJECT: 0720281	CHECKED: TA
DATE: 07/08/2025	APPROVED: KG

Figure 1 - 22
Spittal - Loch Buidhe - Beaulieu 400 kV OHL
Connection
Peat Management Plan
Site Layout



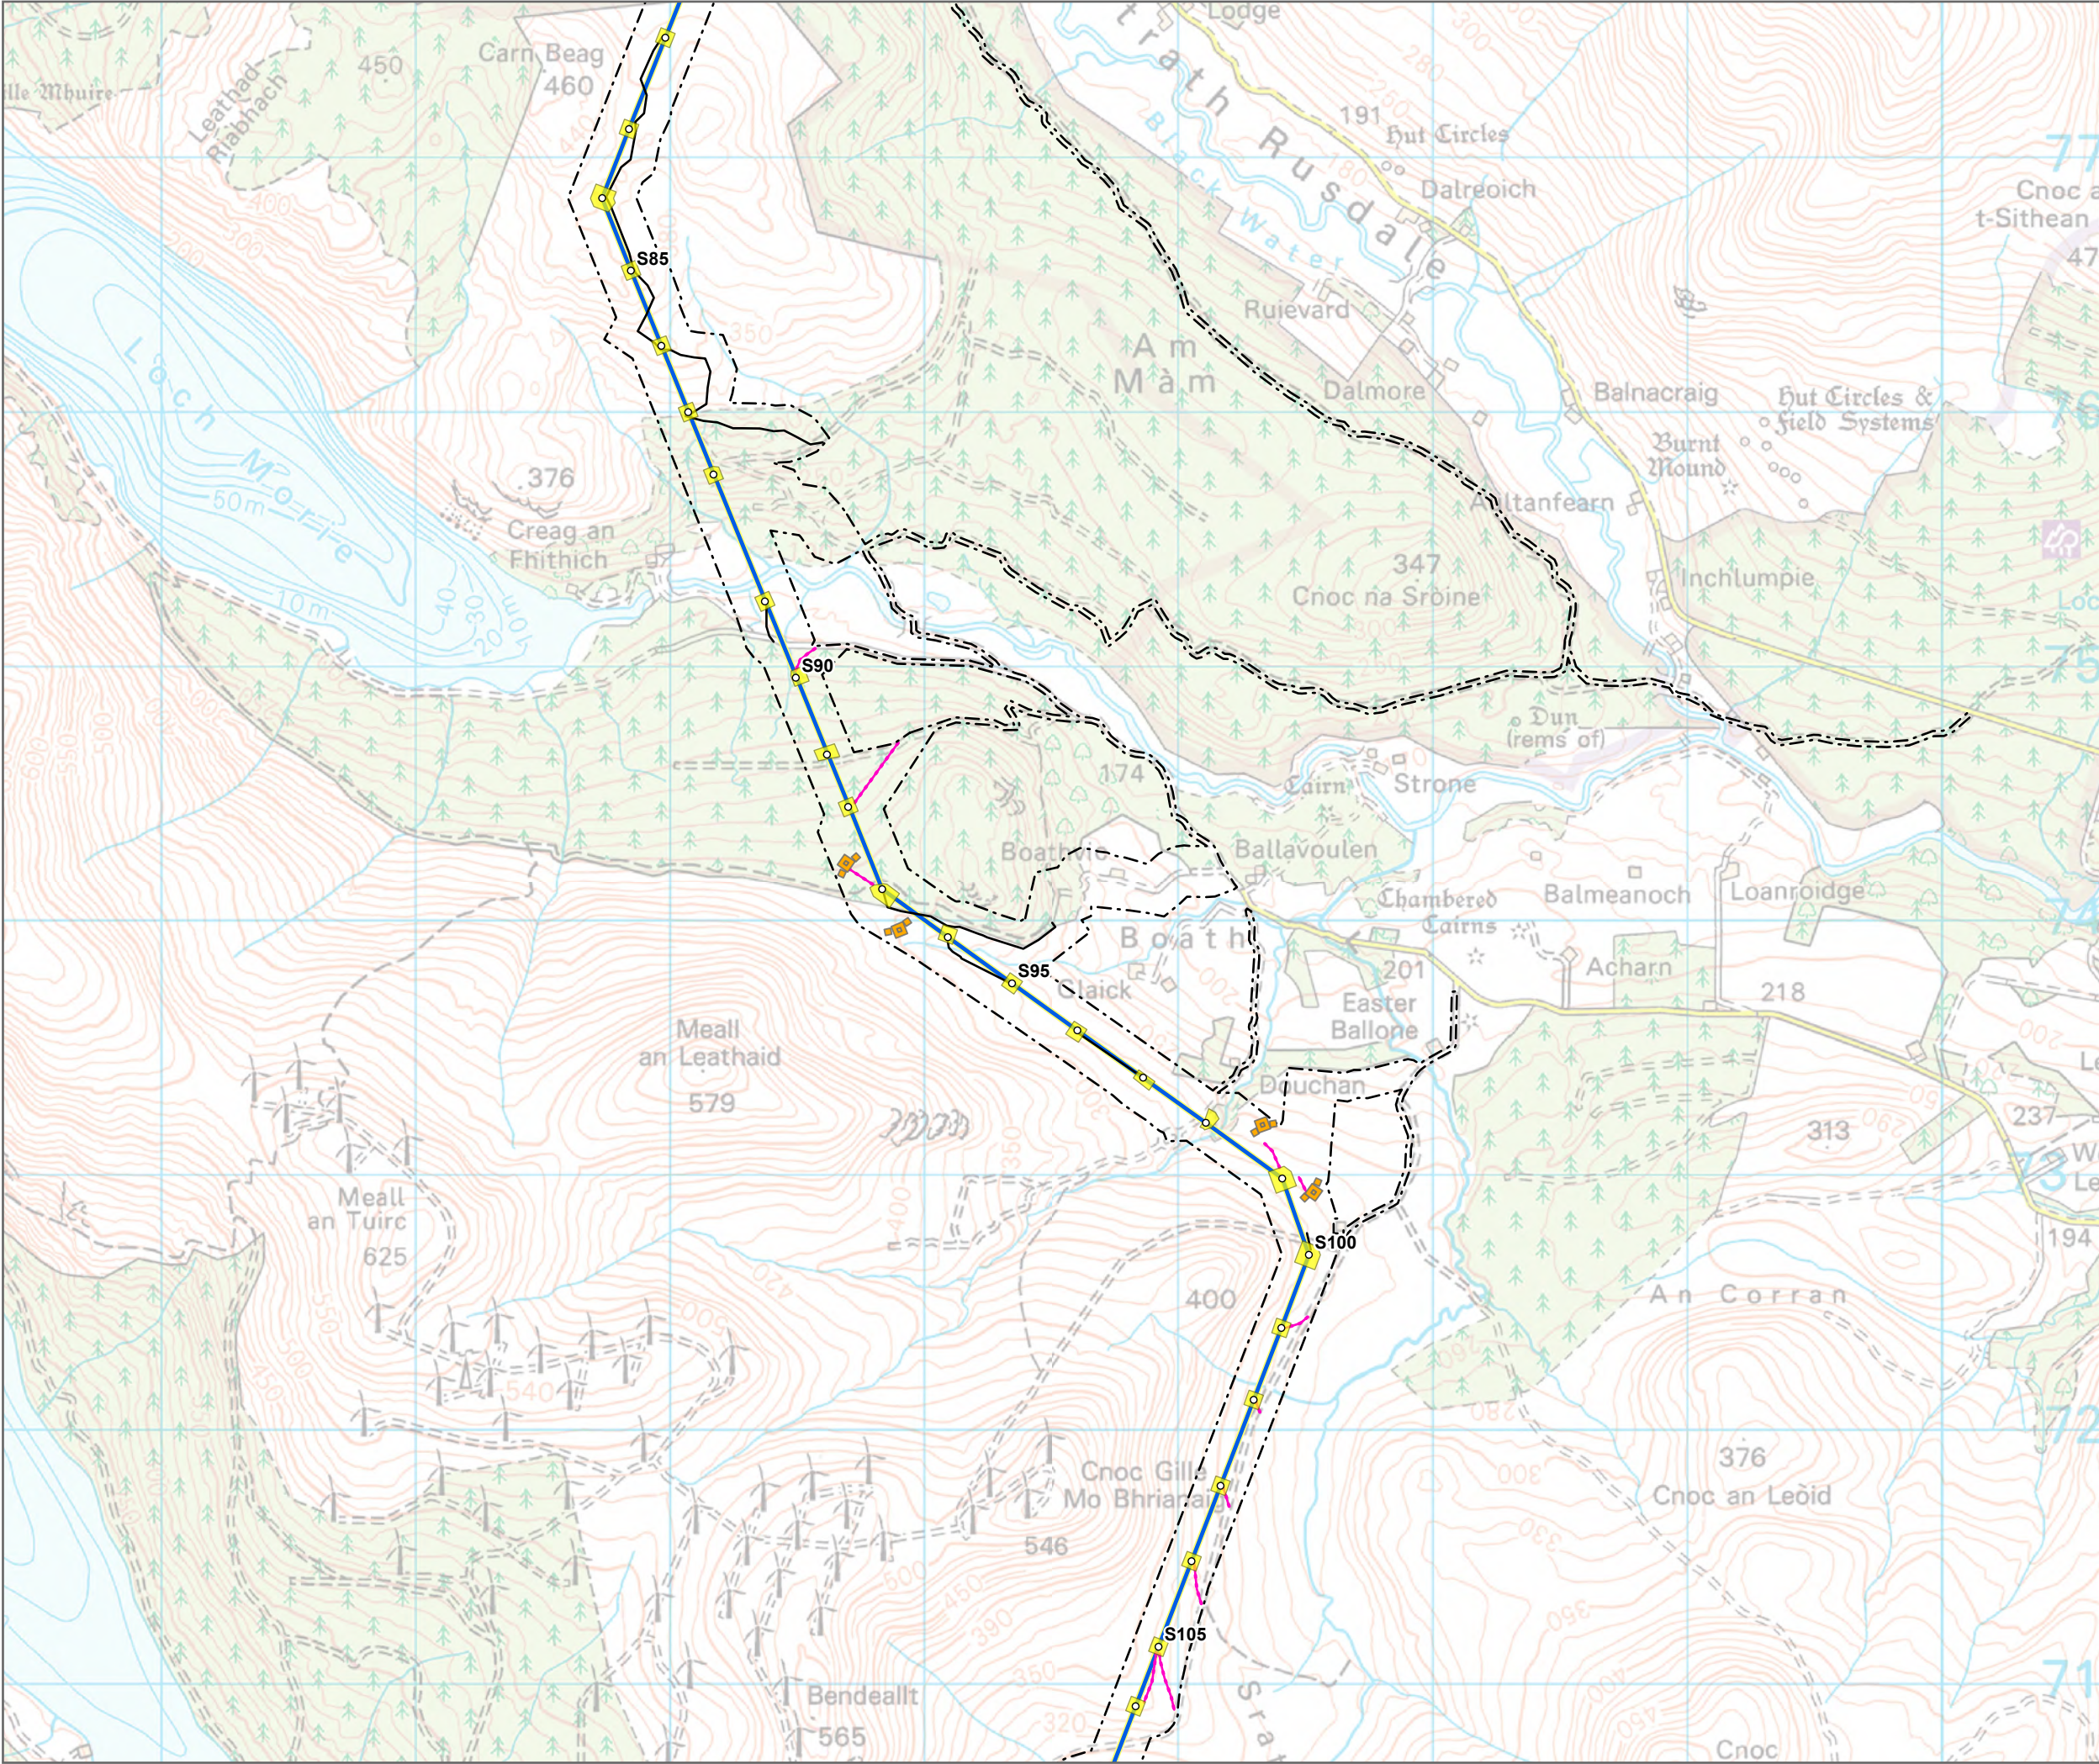


- Tower Location
- Alignment Section D
- - - Limit of Deviation
- Temporary Tower Compound Area
- Equipotential Zone (EPZ) (Pulling Position)
- Temporary Access Track - Cut/Fill
- ... Temporary Access Track - Floating
- Permanent Access Track - Cut/Fill
- ~ Alignment Section Break

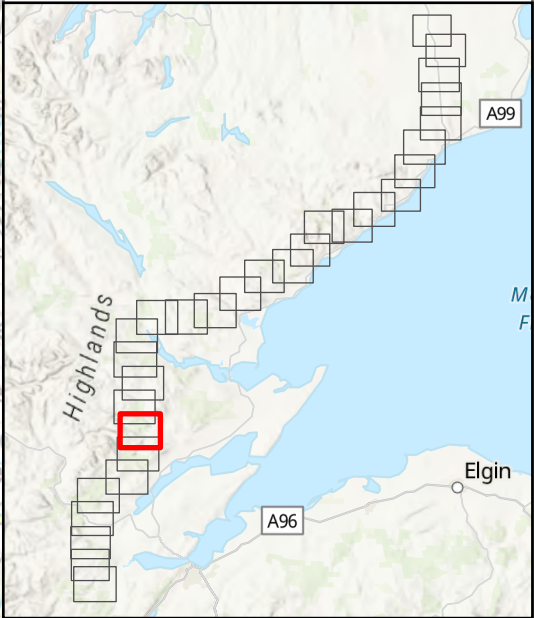



SCALE: See Scale Bar	VERSION: A02
SIZE: A3	DRAWN: BW
PROJECT: 0720281	CHECKED: TA
DATE: 07/08/2025	APPROVED: KG

Figure 1 - 23
Spittal - Loch Buidhe - Beaulie 400 kV OHL
Connection
Peat Management Plan
Site Layout



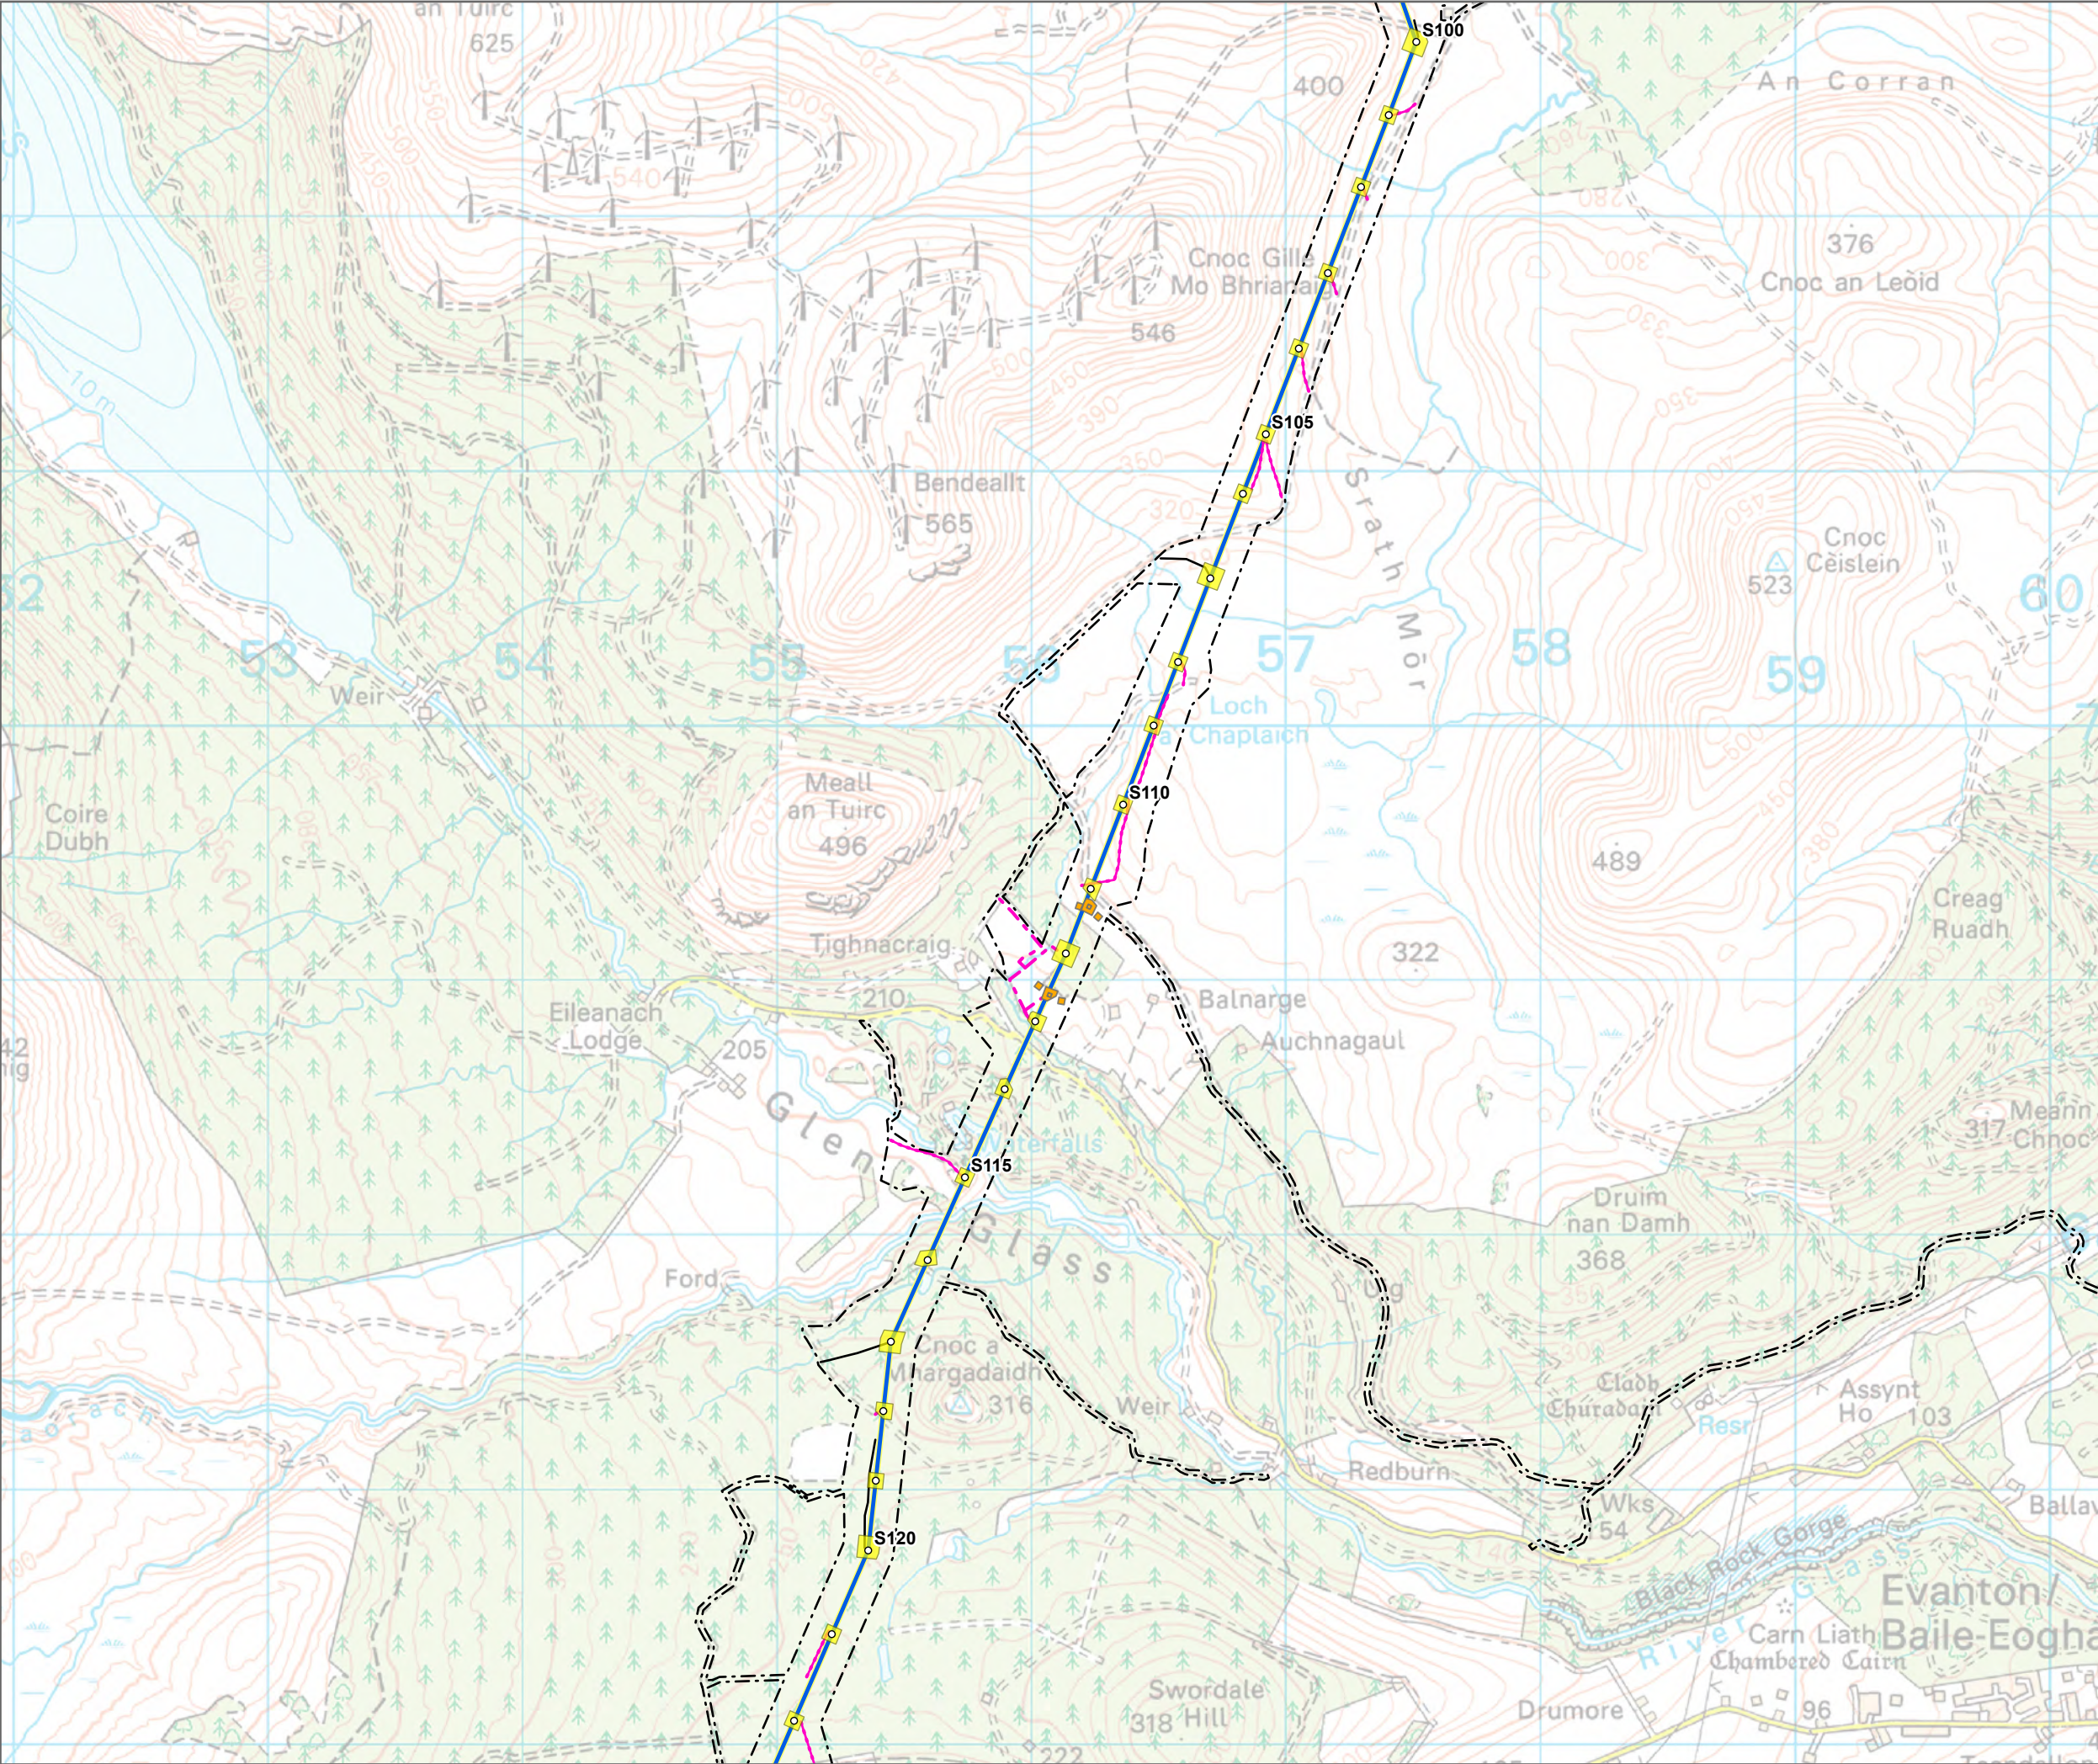

- Tower Location
- Alignment Section D
- - - Limit of Deviation
- Temporary Tower Compound Area
- Equipotential Zone (EPZ) (Pulling Position)
- Temporary Access Track - Cut/Fill
- ... Temporary Access Track - Floating
- Temporary Access Track - Trackway Panel
- Permanent Access Track - Cut/Fill
- ... Permanent Access Track - Floating
- ~ Alignment Section Break

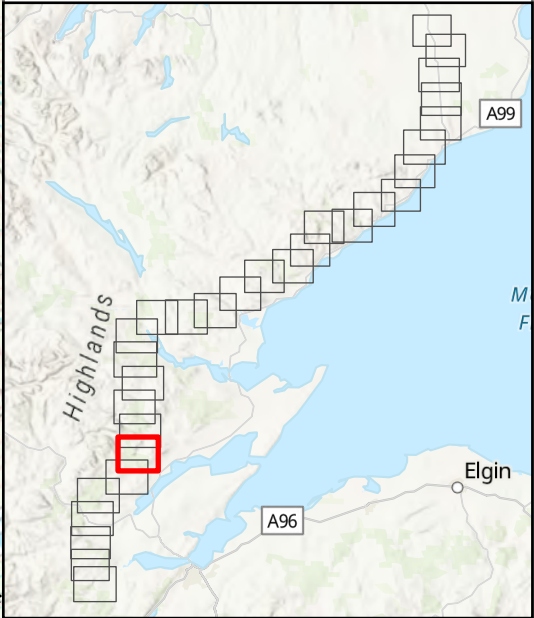


SCALE: See Scale Bar
SIZE: A3
PROJECT: 0720281
DATE: 07/08/2025



VERSION: A02
DRAWN: BW
CHECKED: TA
APPROVED: KG

Figure 1 - 24
Spittal - Loch Buidhe - Beaulay 400 kV OHL
Connection
Peat Management Plan
Site Layout



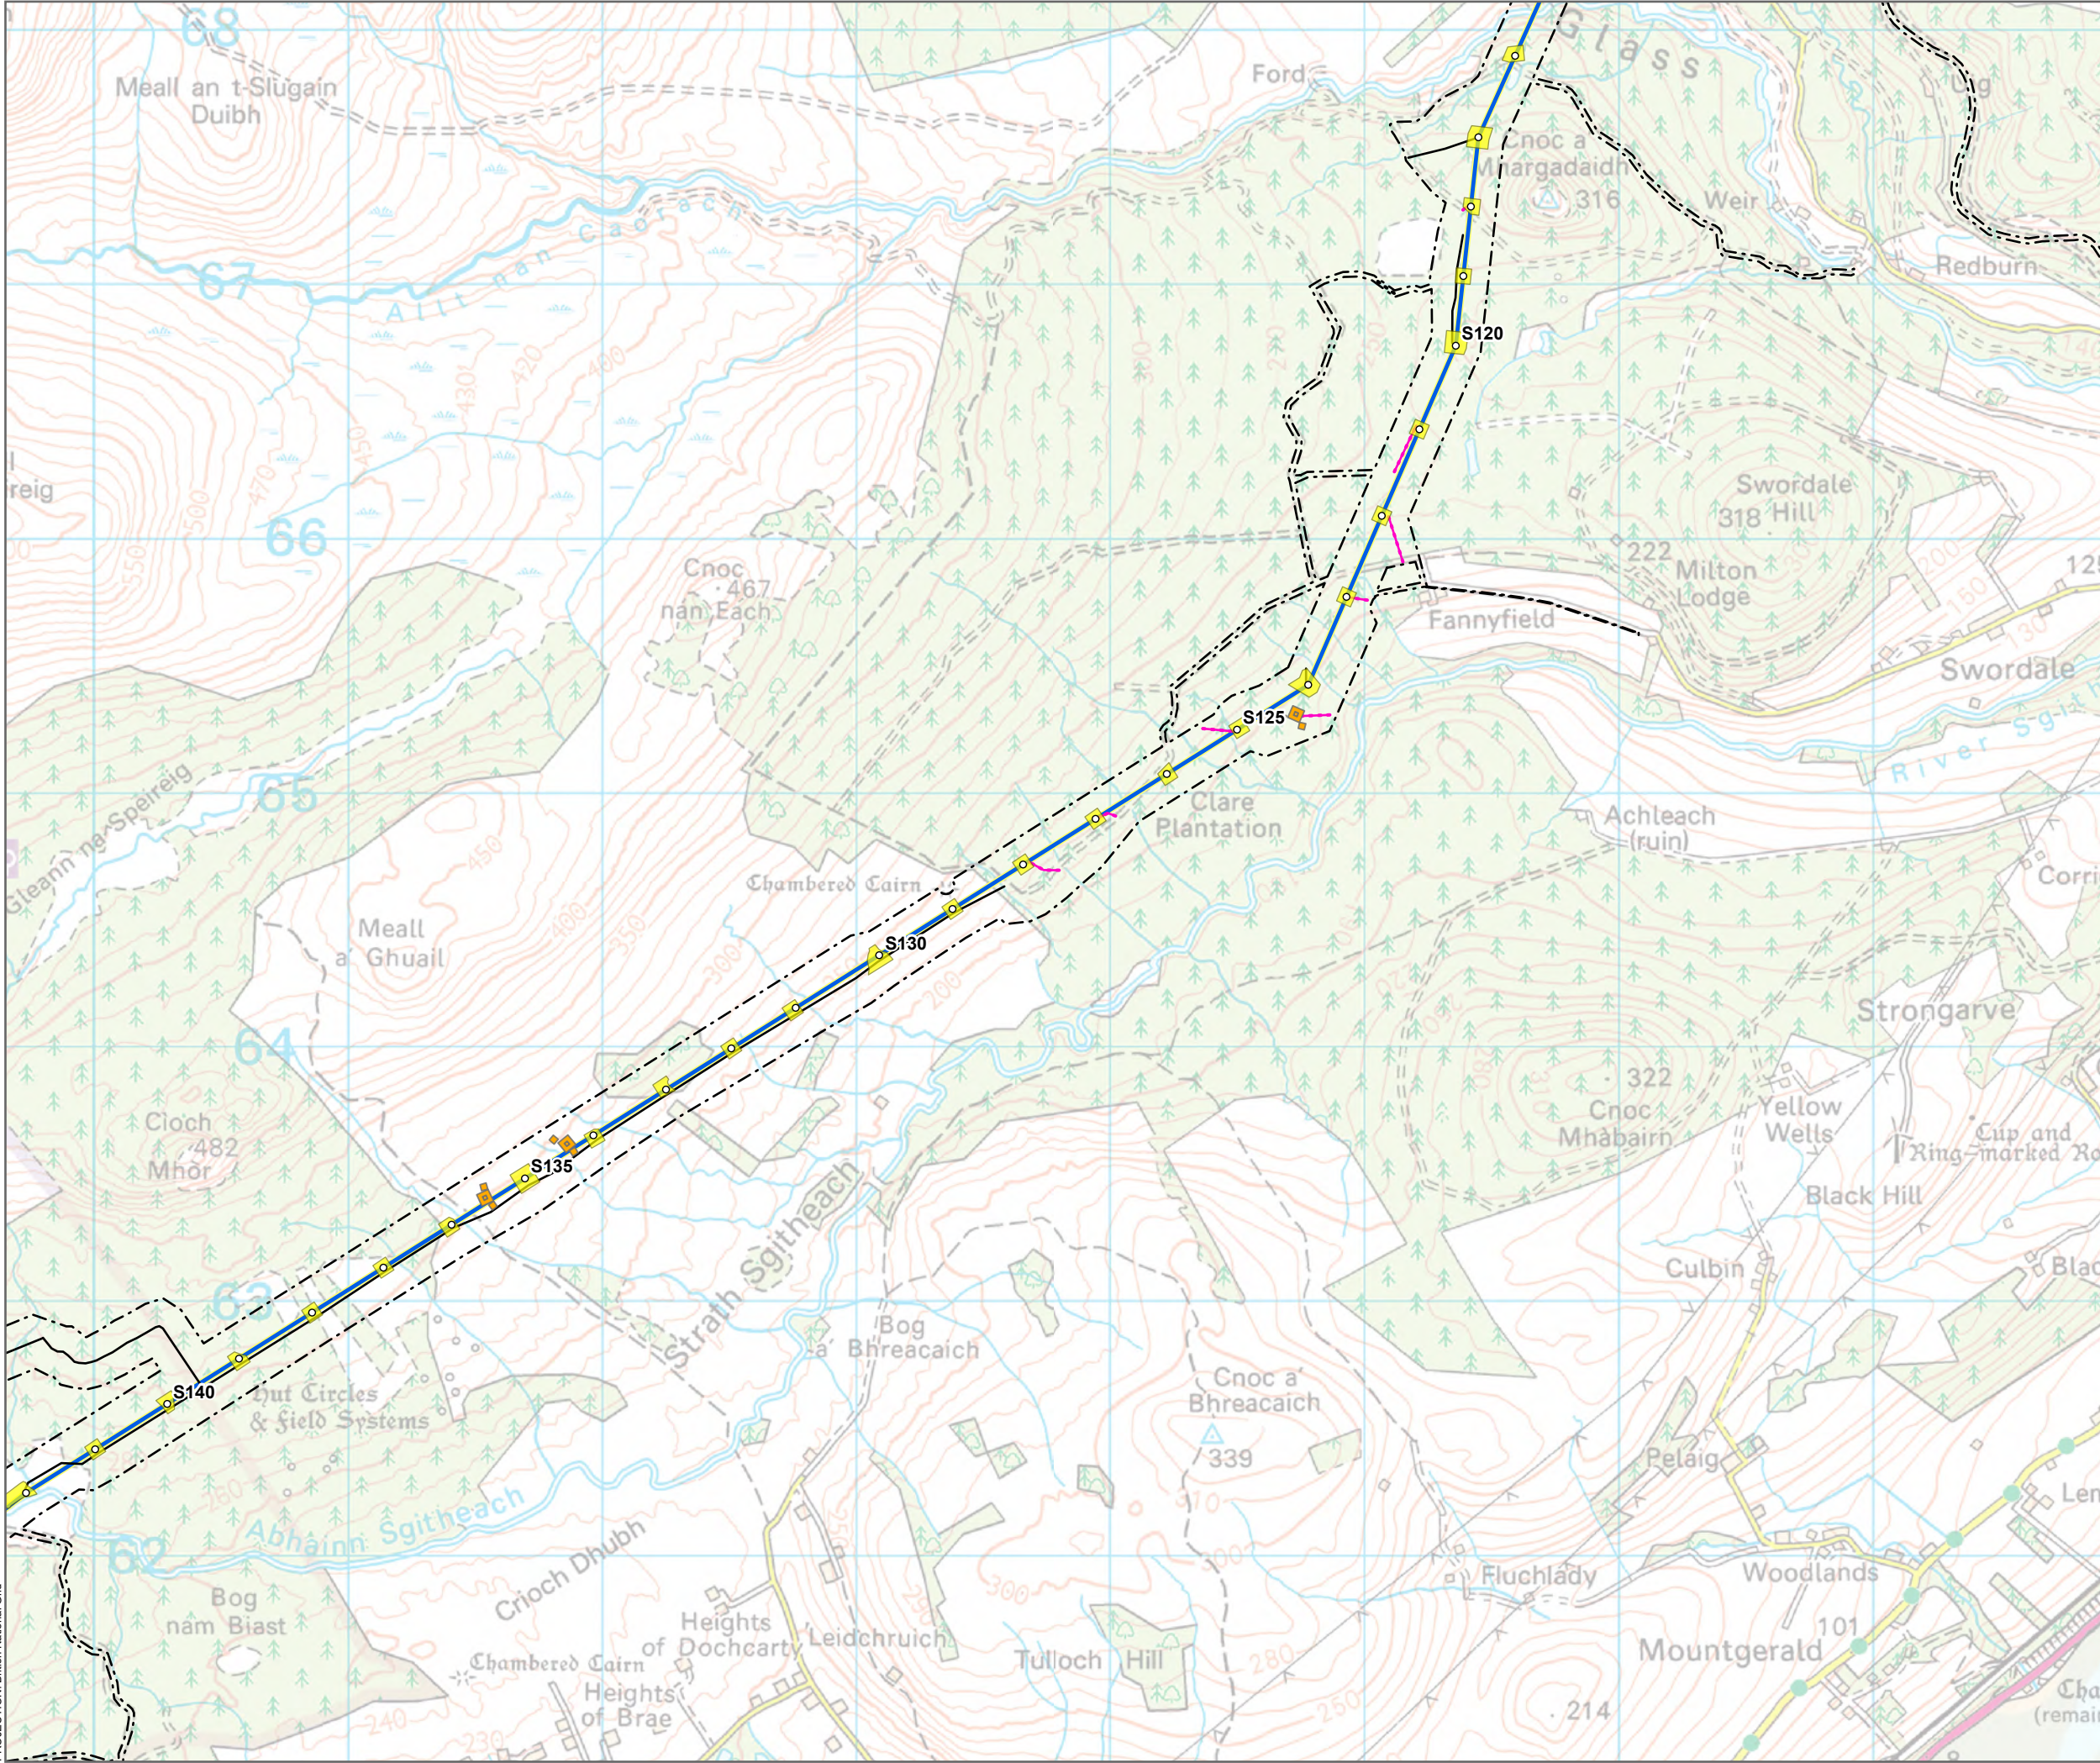

- Tower Location
- Alignment Section D
- - - Limit of Deviation
- Temporary Tower Compound Area
- Equipotential Zone (EPZ) (Pulling Position)
- Temporary Access Track - Cut/Fill
- Temporary Access Track - Floating
- Permanent Access Track - Cut/Fill
- Permanent Access Track - Floating
- Alignment Section Break

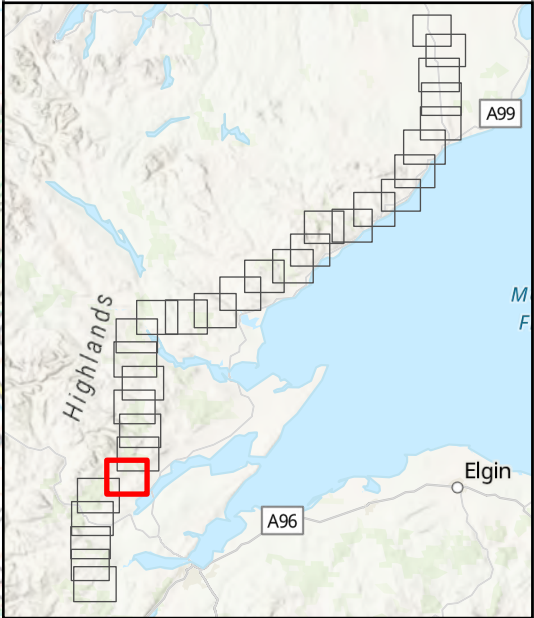


SCALE: See Scale Bar	VERSION: A02
SIZE: A3	DRAWN: BW
PROJECT: 0720281	CHECKED: TA
DATE: 07/08/2025	APPROVED: KG



Figure 1 - 25
Spittal - Loch Buidhe - Beaulieu 400 kV OHL
Connection
Peat Management Plan
Site Layout



PROJECTION: British National Grid

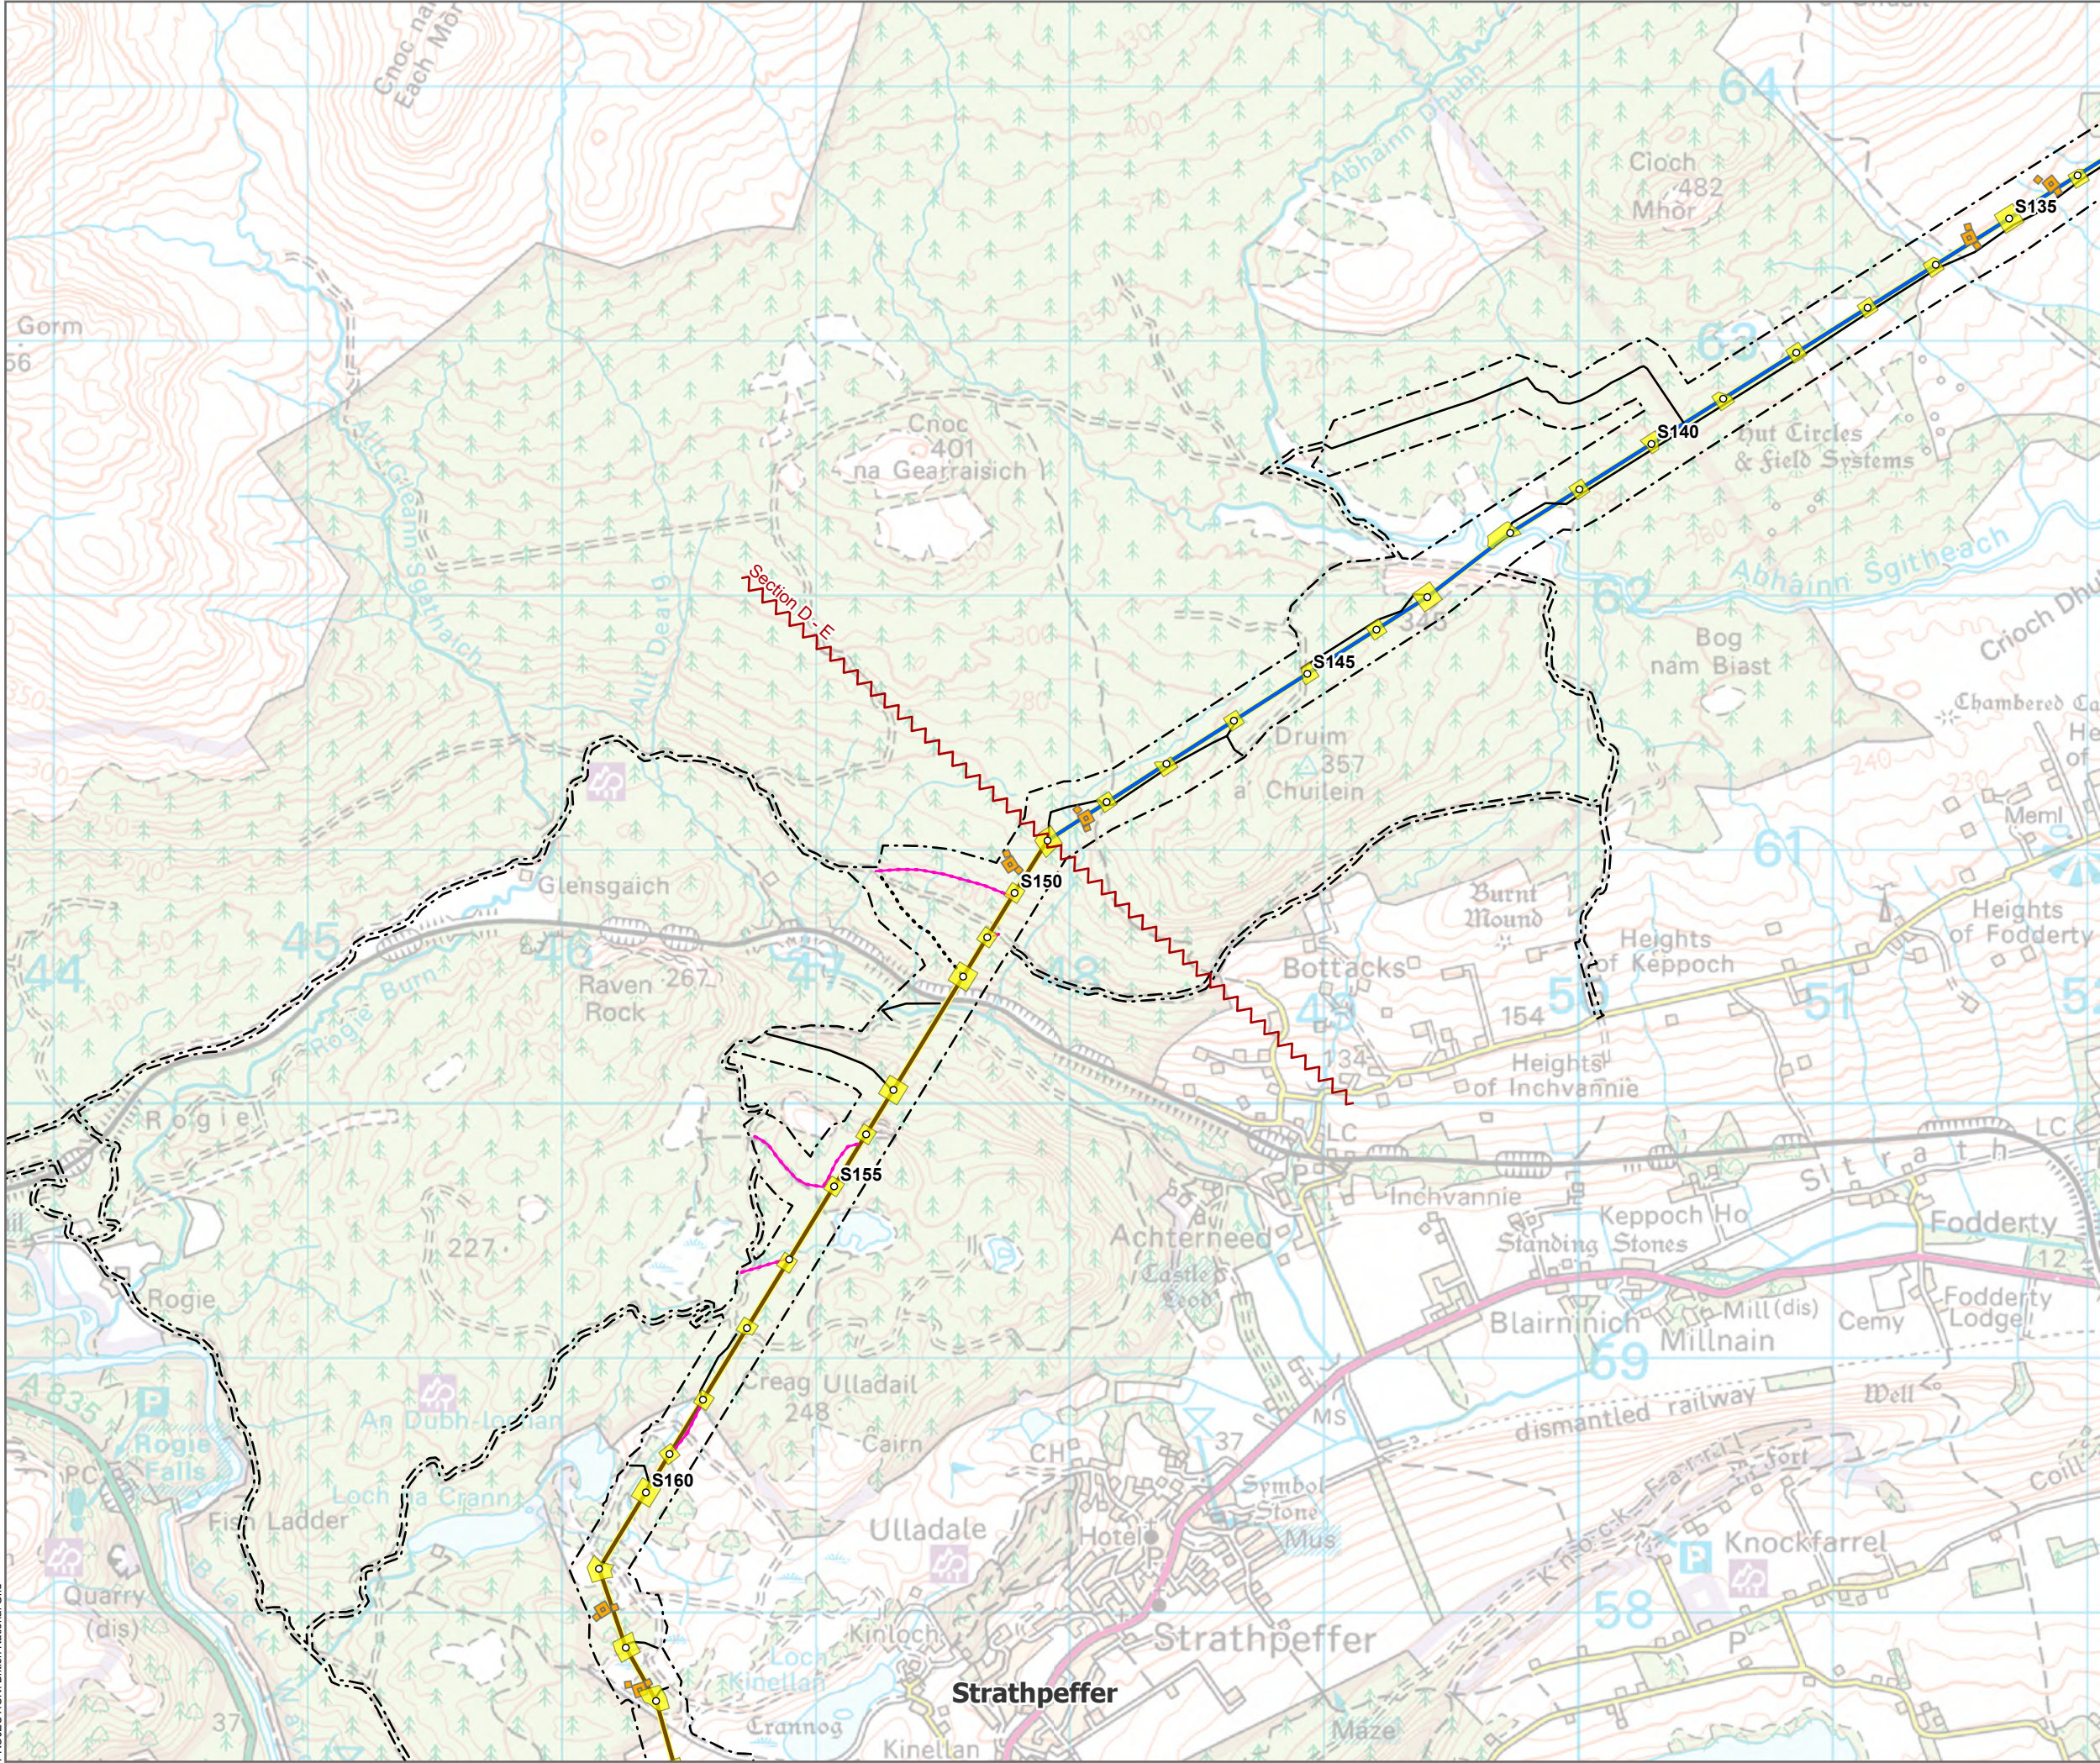


- Tower Location
- Alignment Section D
- Alignment Section E
- - - Limit of Deviation
- Temporary Tower Compound Area
- Equipotential Zone (EPZ) (Pulling Position)
- Temporary Access Track - Cut/Fill
- Temporary Access Track - Floating
- Permanent Access Track - Cut/Fill
- Permanent Access Track - Floating
- Alignment Section Break

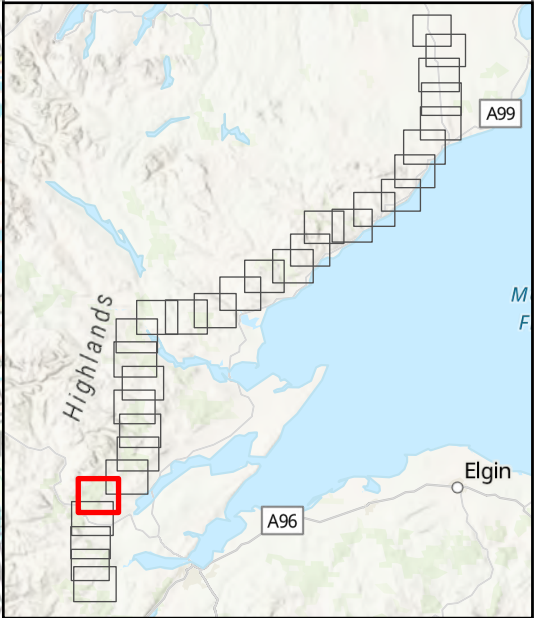



SCALE: See Scale Bar	VERSION: A02
SIZE: A3	DRAWN: BW
PROJECT: 0720281	CHECKED: TA
DATE: 07/08/2025	APPROVED: KG

Figure 1 - 26
Spittal - Loch Buidhe - Beauly 400 kV OHL
Connection
Peat Management Plan
Site Layout



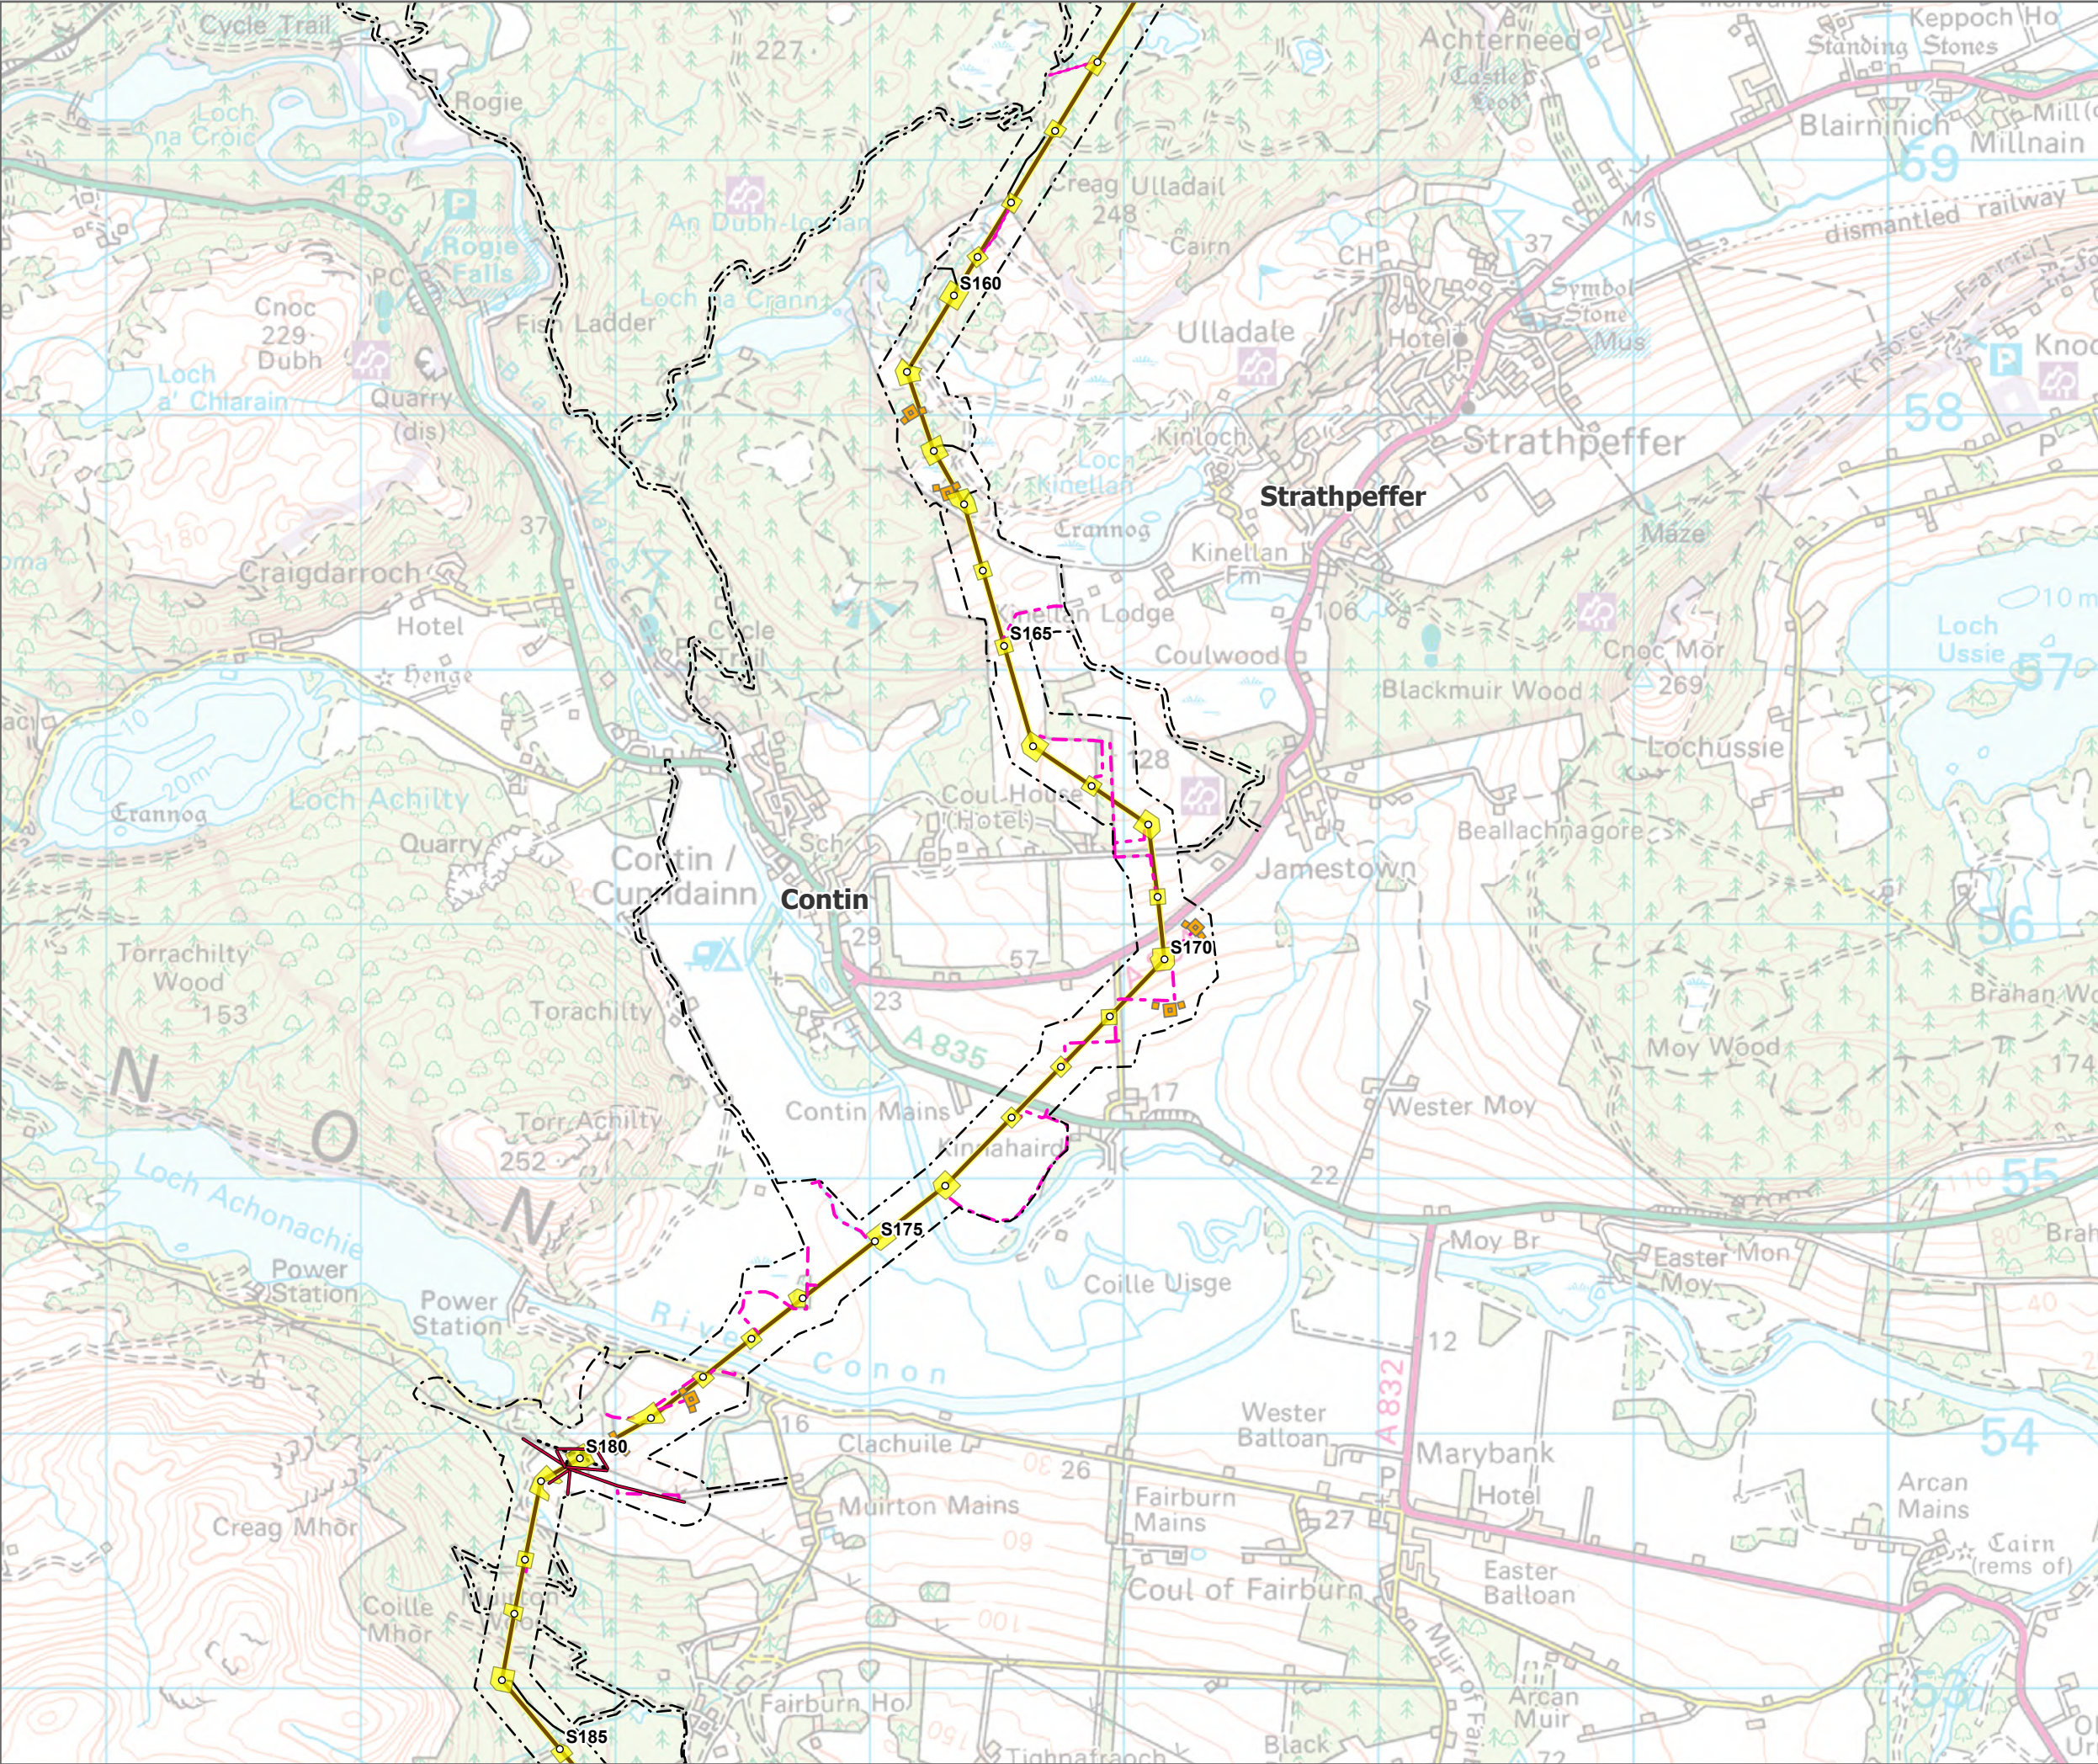

- Tower Location
- Alignment Section E
- Special Arrangement
- - - Limit of Deviation
- Temporary Tower Compound Area
- Equipotential Zone (EPZ) (Pulling Position)
- Temporary Access Track - Cut/Fill
- Temporary Access Track - Floating
- Temporary Access Track - Trackway Panel
- Permanent Access Track - Cut/Fill
- Permanent Access Track - Floating
- Alignment Section Break

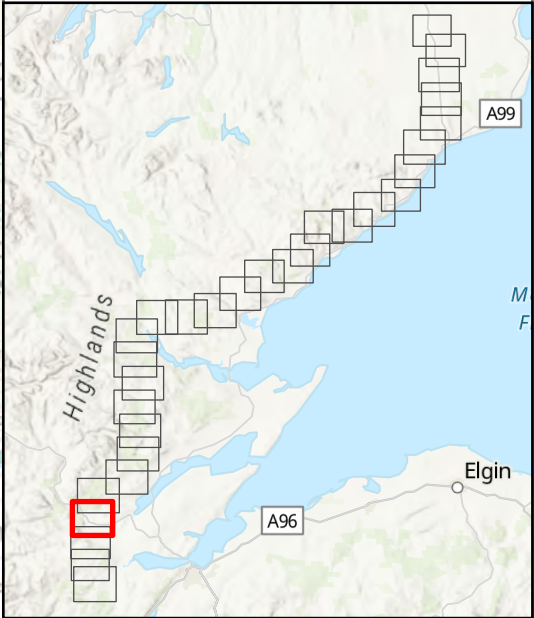

SCALE: See Scale Bar
SIZE: A3
PROJECT: 0720281
DATE: 07/08/2025

VERSION: A02
DRAWN: BW
CHECKED: TA
APPROVED: KG

Figure 1 - 27
Spittal - Loch Buidhe - Beauly 400 kV OHL
Connection
Peat Management Plan
Site Layout

